


VL414 Island Configuration.

(2) VL414111 downdraft + (2) AR400742 inline blower

21. April 2020

Configuration	2xVL414111-2xAR400742-3 varios	Min. Work depth	- mm	Ventilation mode	Extraction
Type reference cooktops	VR414- VG 425 – VP 414	Type reference ventilation appliance	VL 414 111	Type reference remote fan unit	AR 400 742


Installation view

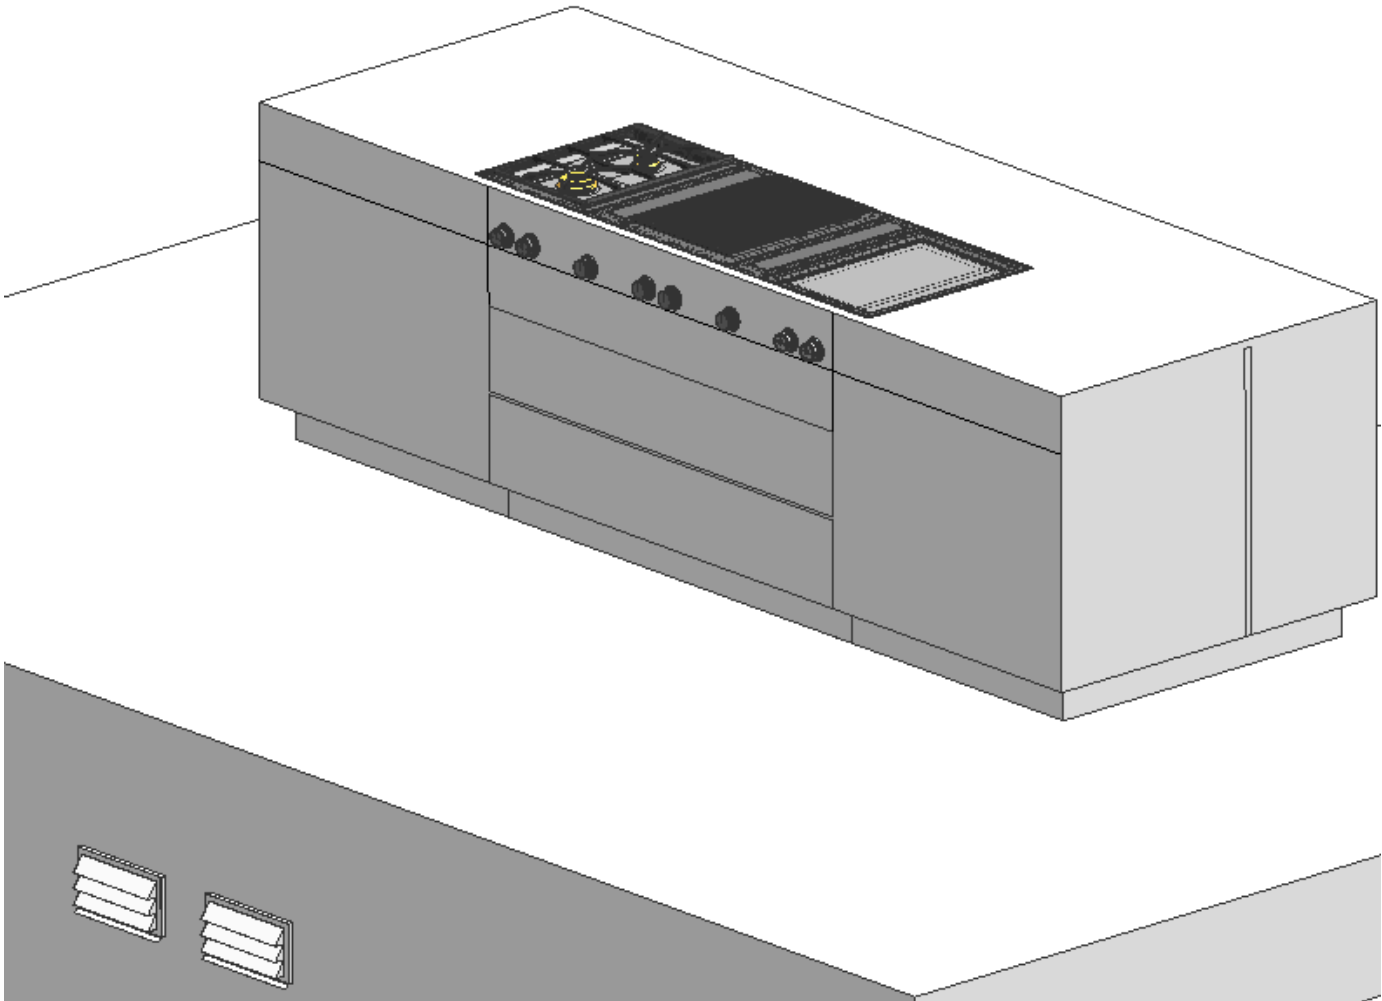

21. April 2020


Configuration	2xVL414111-2xAR400742-3 varios	Min. Work depth	- mm	Ventilation mode	Extraction
Type reference cooktops	VR414- VG 425 – VP 414	Type reference ventilation appliance	VL 414 111	Type reference remote fan unit	AR 400 742

Installation view

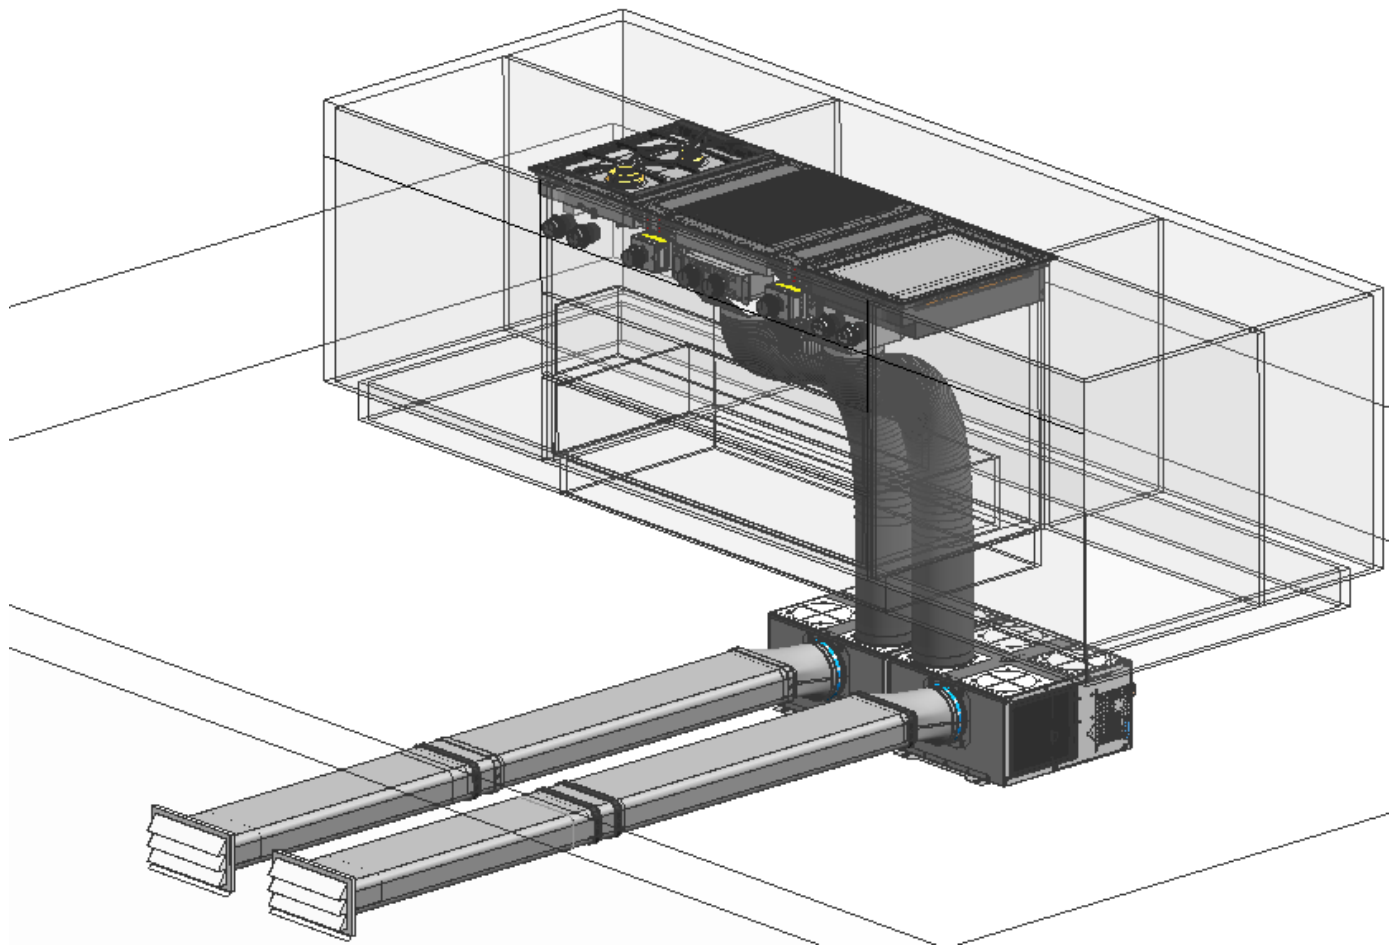


21. April 2020

Configuration	2xVL414111-2xAR400742-3 varios	Min. Work depth	- mm	Ventilation mode	Extraction
Type reference cooktops	VR414- VG 425 – VP 414	Type reference ventilation appliance	VL 414 111	Type reference remote fan unit	AR 400 742

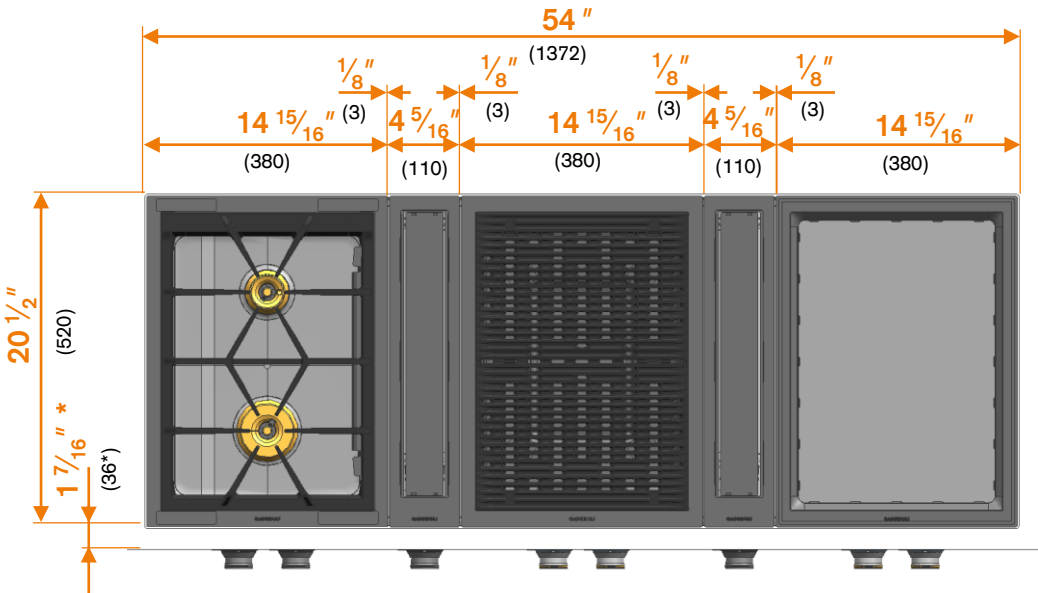


Cut out dimension. **Flush mounting**

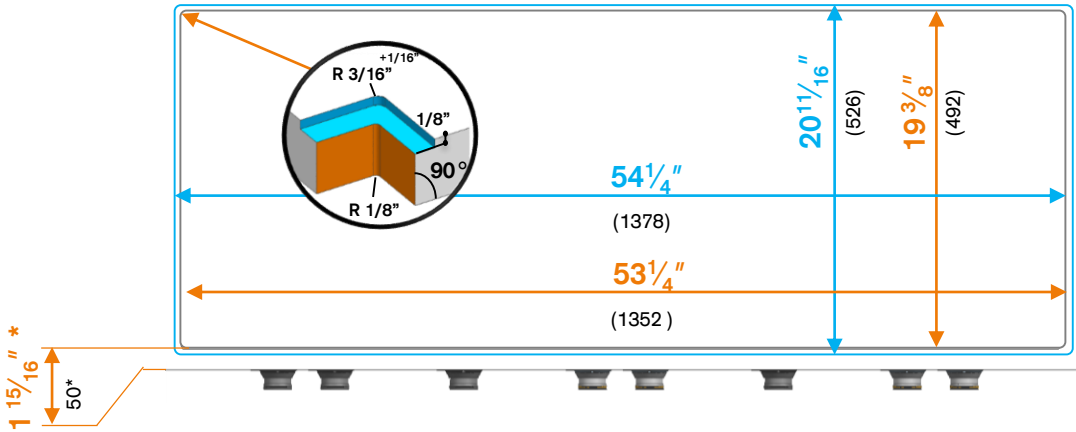

* : Minimum Distance
** : Recommended distance

21. April 2020


Configuration	2xVL414111-2xAR400742-3 varios	Min. Work depth	- mm	Ventilation mode	Extraction
Type reference cooktops	VR414- VG 425 - VP 414	Type reference ventilation appliance	VL 414 111	Type reference remote fan unit	AR 400 742

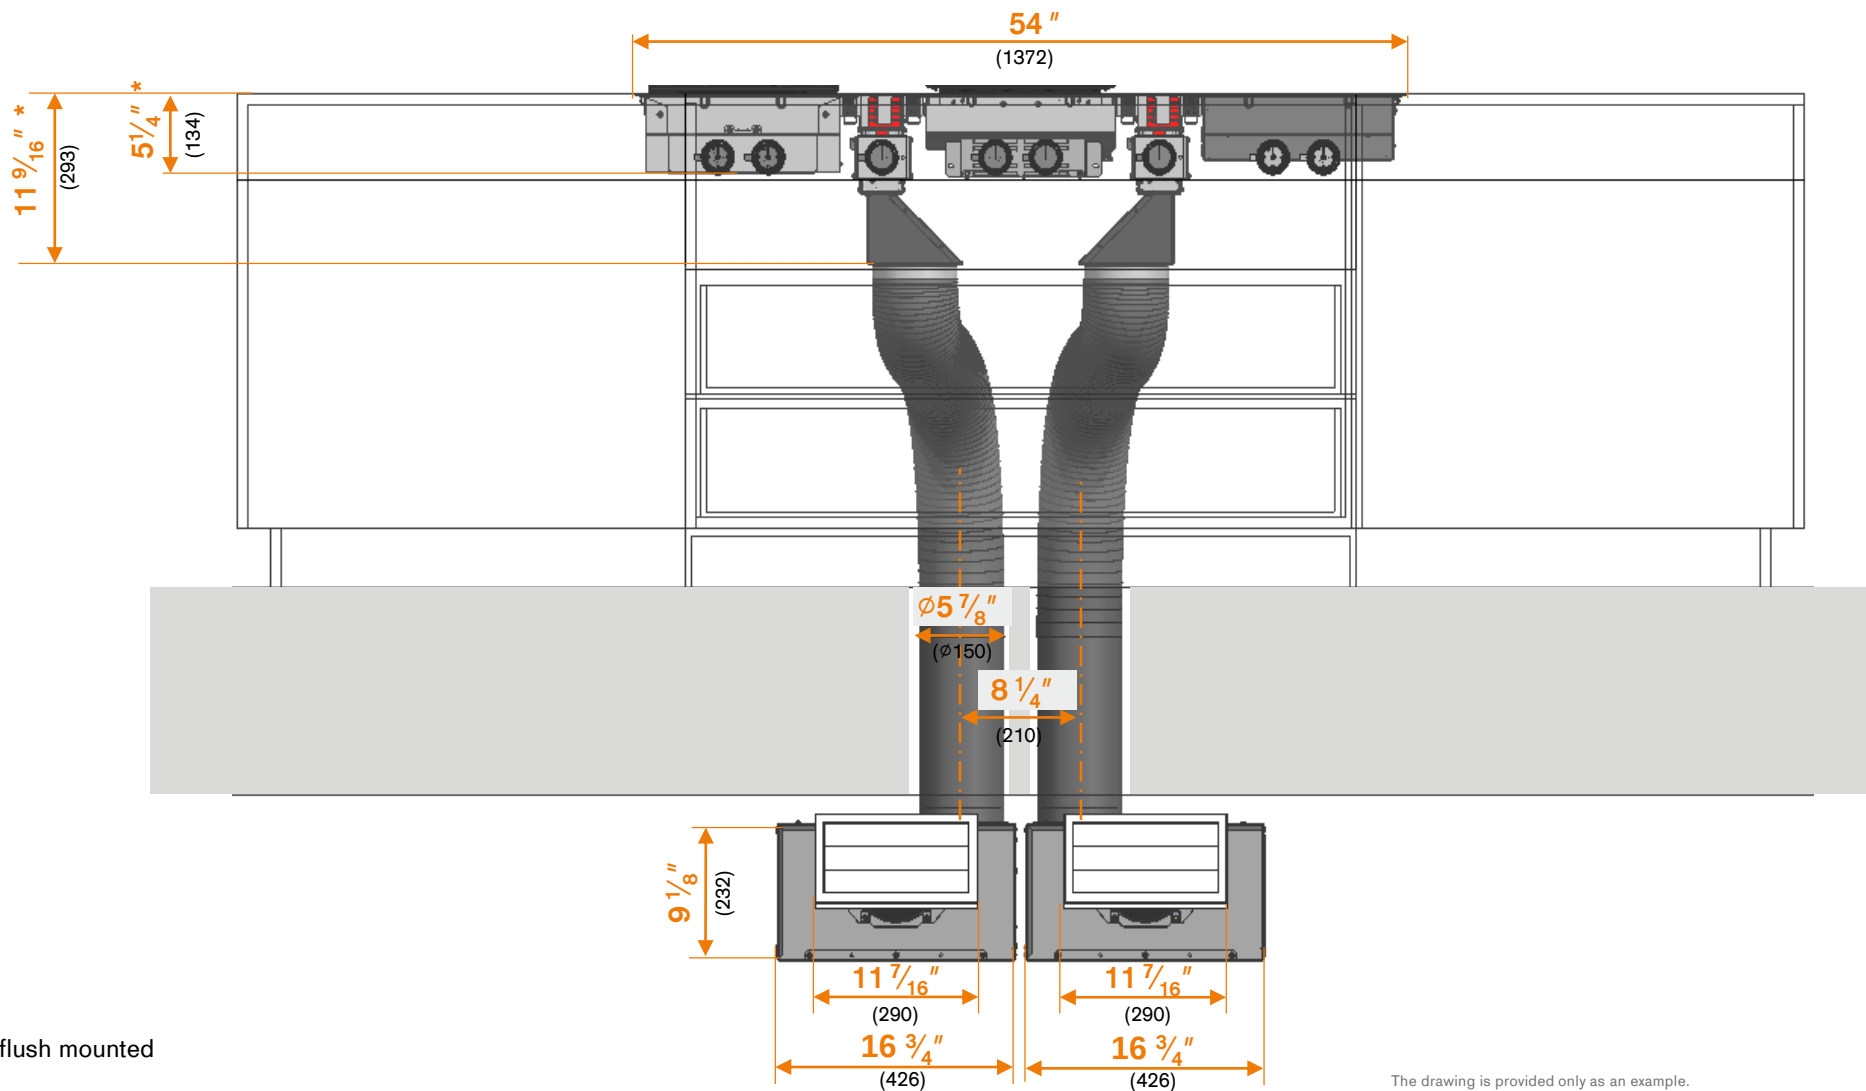

* : For flush mounted



21. April 2020

Configuration	2xVL414111-2xAR400742-3 varios	Min. Work depth	- mm	Ventilation mode	Extraction
Type reference cooktops	VR414- VG 425 – VP 414	Type reference ventilation appliance	VL 414 111	Type reference remote fan unit	AR 400 742

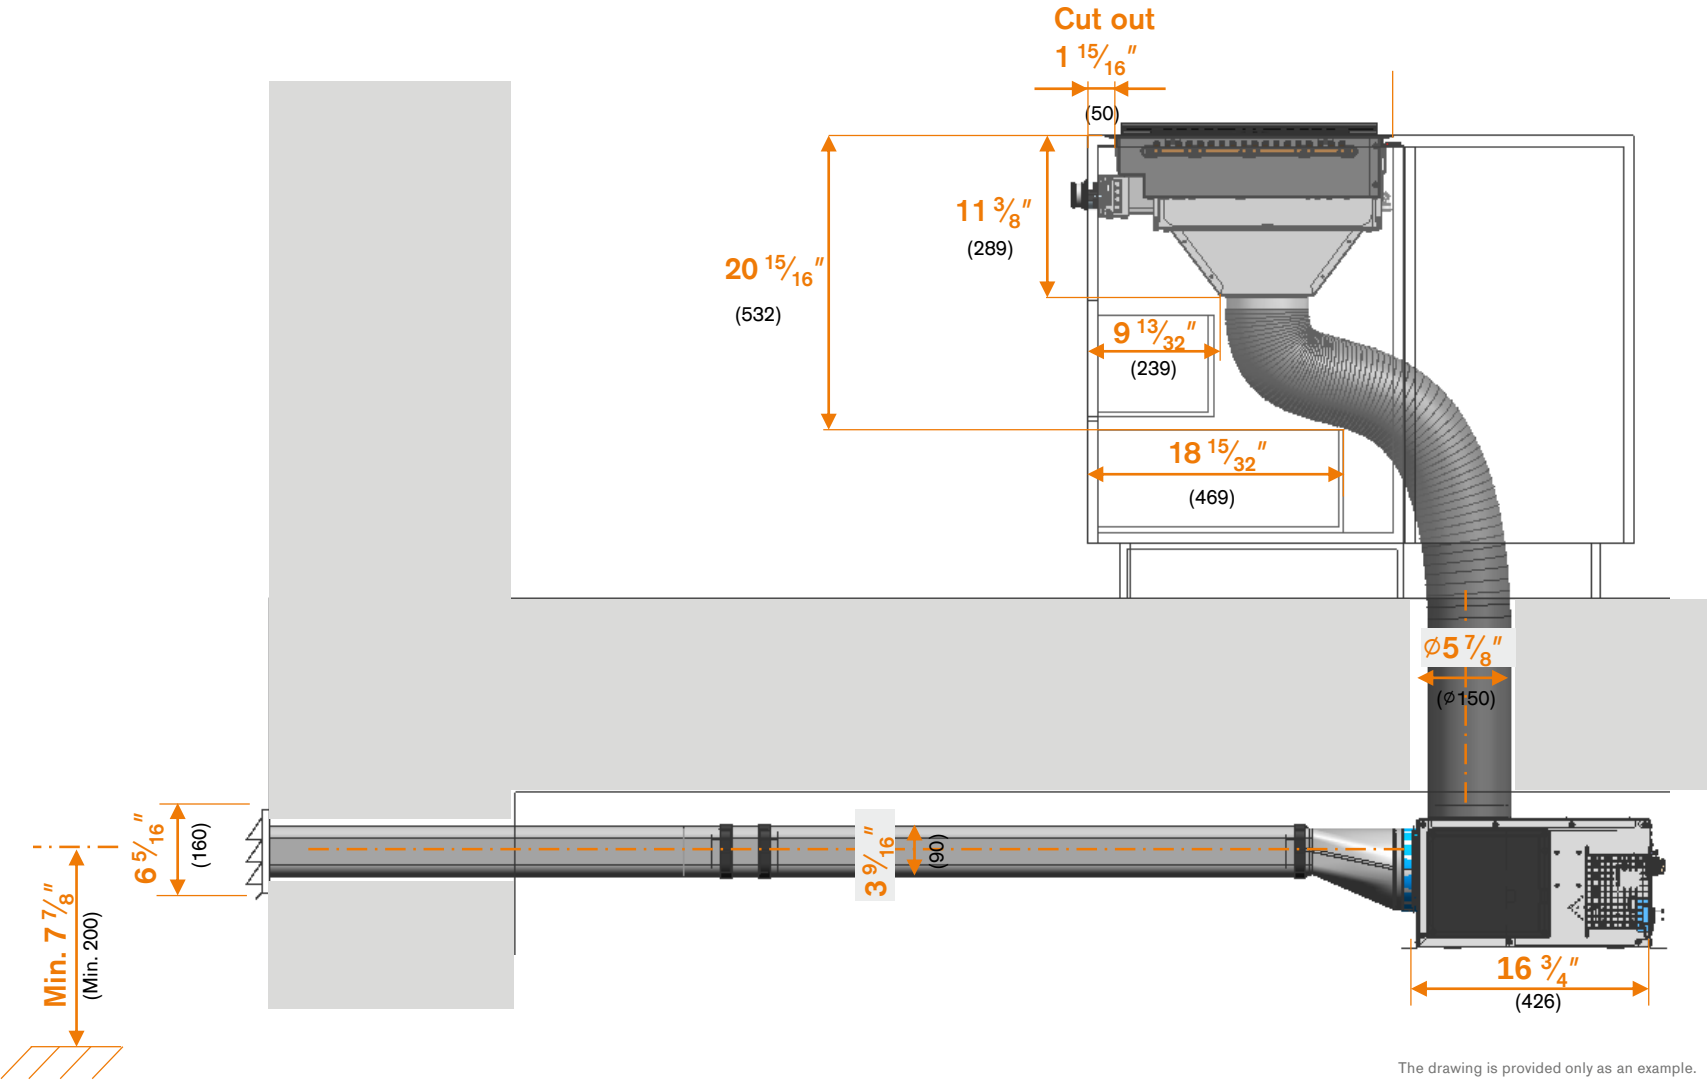

21. April 2020

Configuration	2xVL414111-2xAR400742-3 varios	Min. Work depth	- mm	Ventilation mode	Extraction
Type reference cooktops	VR414- VG 425 - VP 414	Type reference ventilation appliance	VL 414 111	Type reference remote fan unit	AR 400 742

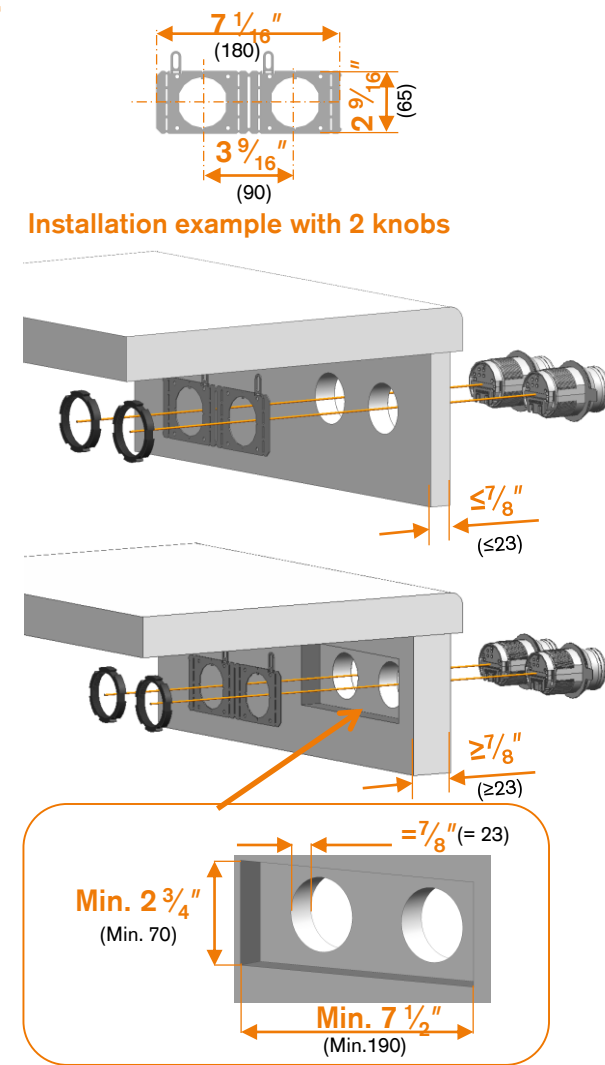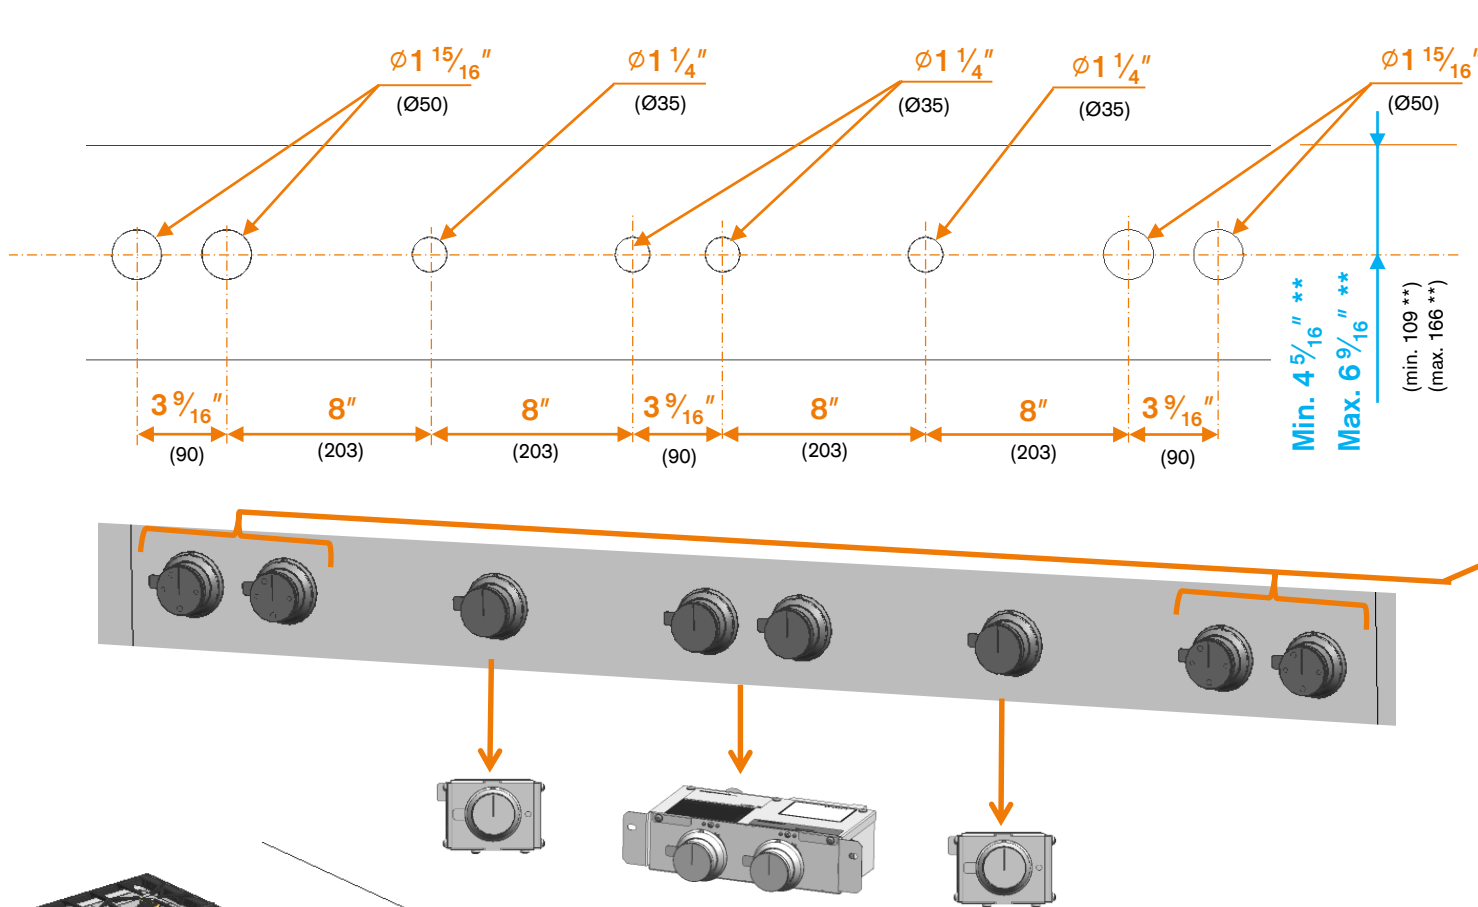

* : for a surface installation
 ** : for a flush mounting installation


BSH Hausgeräte GmbH, Carl-Wery-Strasse 34, 81739 Munich, Germany
 Chairman of the Supervisory Board: Prof. Dr. Stefan Asenkerschbaumer
 Directors: Uwe Raschke (Chairman), Dr. Gerhard Dambach, Matthias Ginthum, Dr. Silke Maurer
 Registered Office: Munich; Registry Court: Amtsgericht München, HRB 75534, WEEE-Reg.-No. DE 57986696

The drawing is provided only as an example.
 Please pay attention to the technical installation drawings in the Gaggenau Models and Dimensions. The technical drawings are not based on customer data and are merely for installation recommendation. The exact installation must be verified by the kitchen studio on an individual customer basis.

21. April 2020

Configuration	2xVL414111-2xAR400742-3 varios	Min. Work depth	- mm	Ventilation mode	Extraction
Type reference cooktops	VR414- VG 425 – VP 414	Type reference ventilation appliance	VL 414 111	Type reference remote fan unit	AR 400 742


Information about remote fan unit AR 400 742

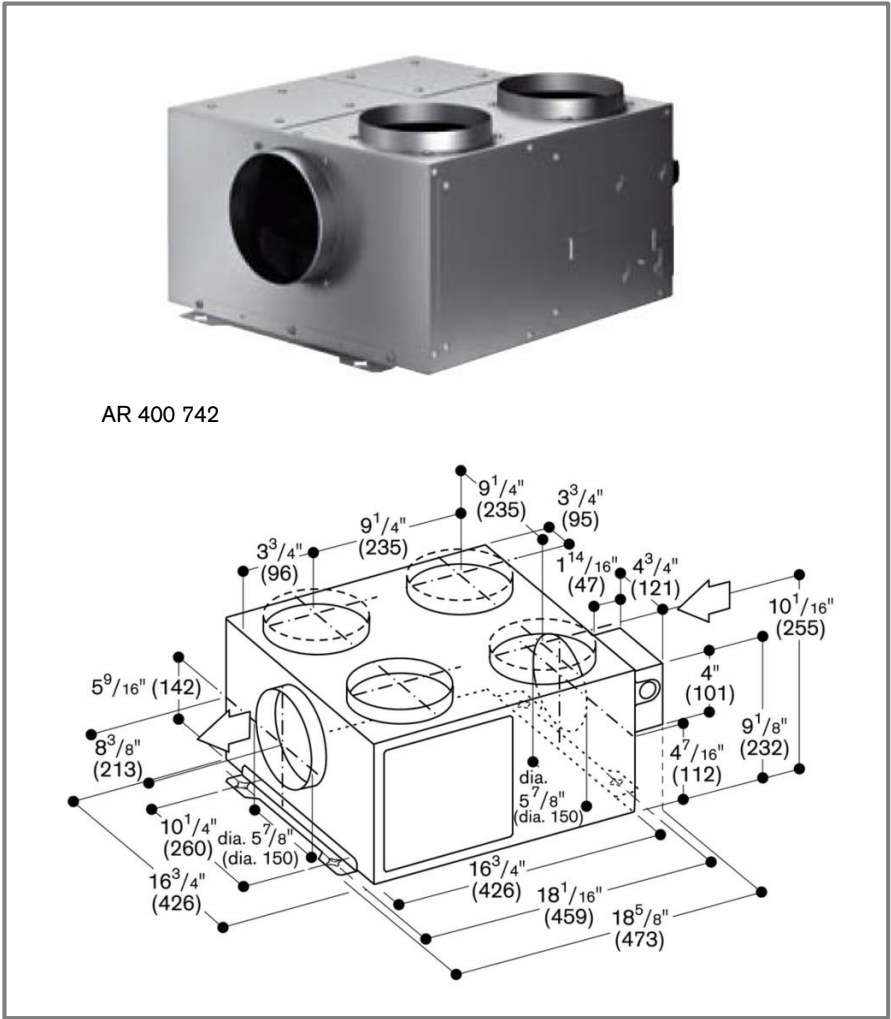

AR 400 742

21. April 2020


Configuration	2xVL414111-2xAR400742-3 varios	Min. Work depth	- mm	Ventilation mode	Extraction
Type reference cooktops	VR414- VG 425 – VP 414	Type reference ventilation appliance	VL 414 111	Type reference remote fan unit	AR 400 742

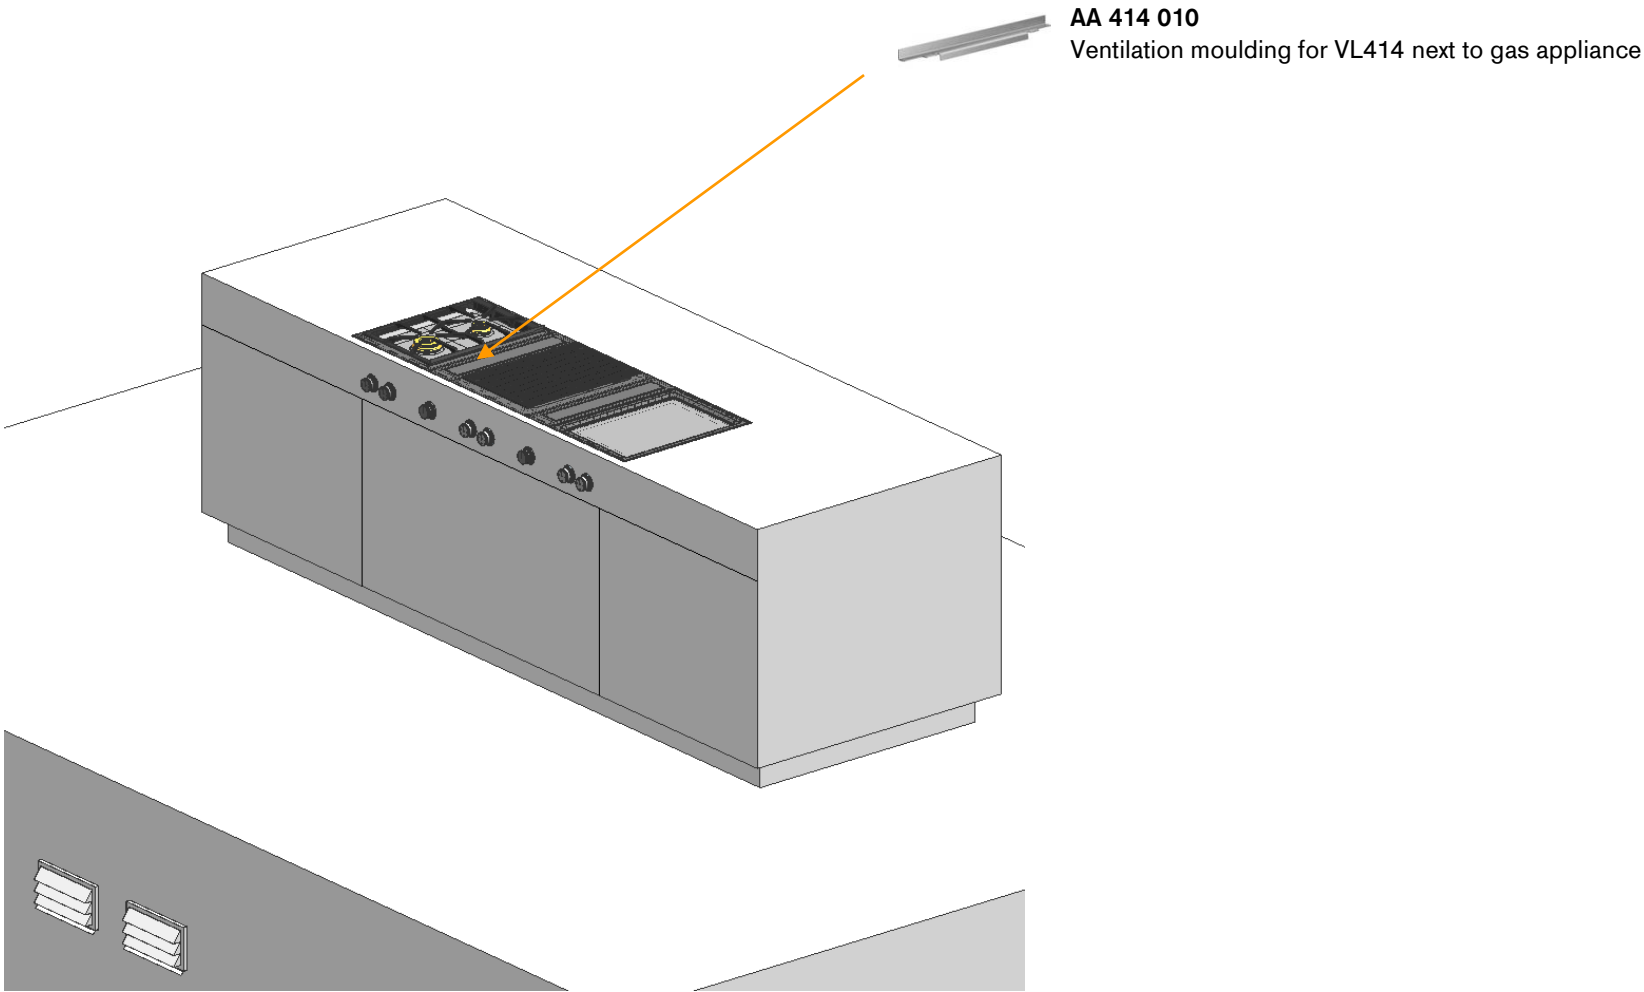

21. April 2020

Configuration	2xVL414111-2xAR400742-3 varios	Min. Work depth	- mm	Ventilation mode	Extraction
Type reference cooktops	VR414- VG 425 - VP 414	Type reference ventilation appliance	VL 414 111	Type reference remote fan unit	AR 400 742

Mounting information

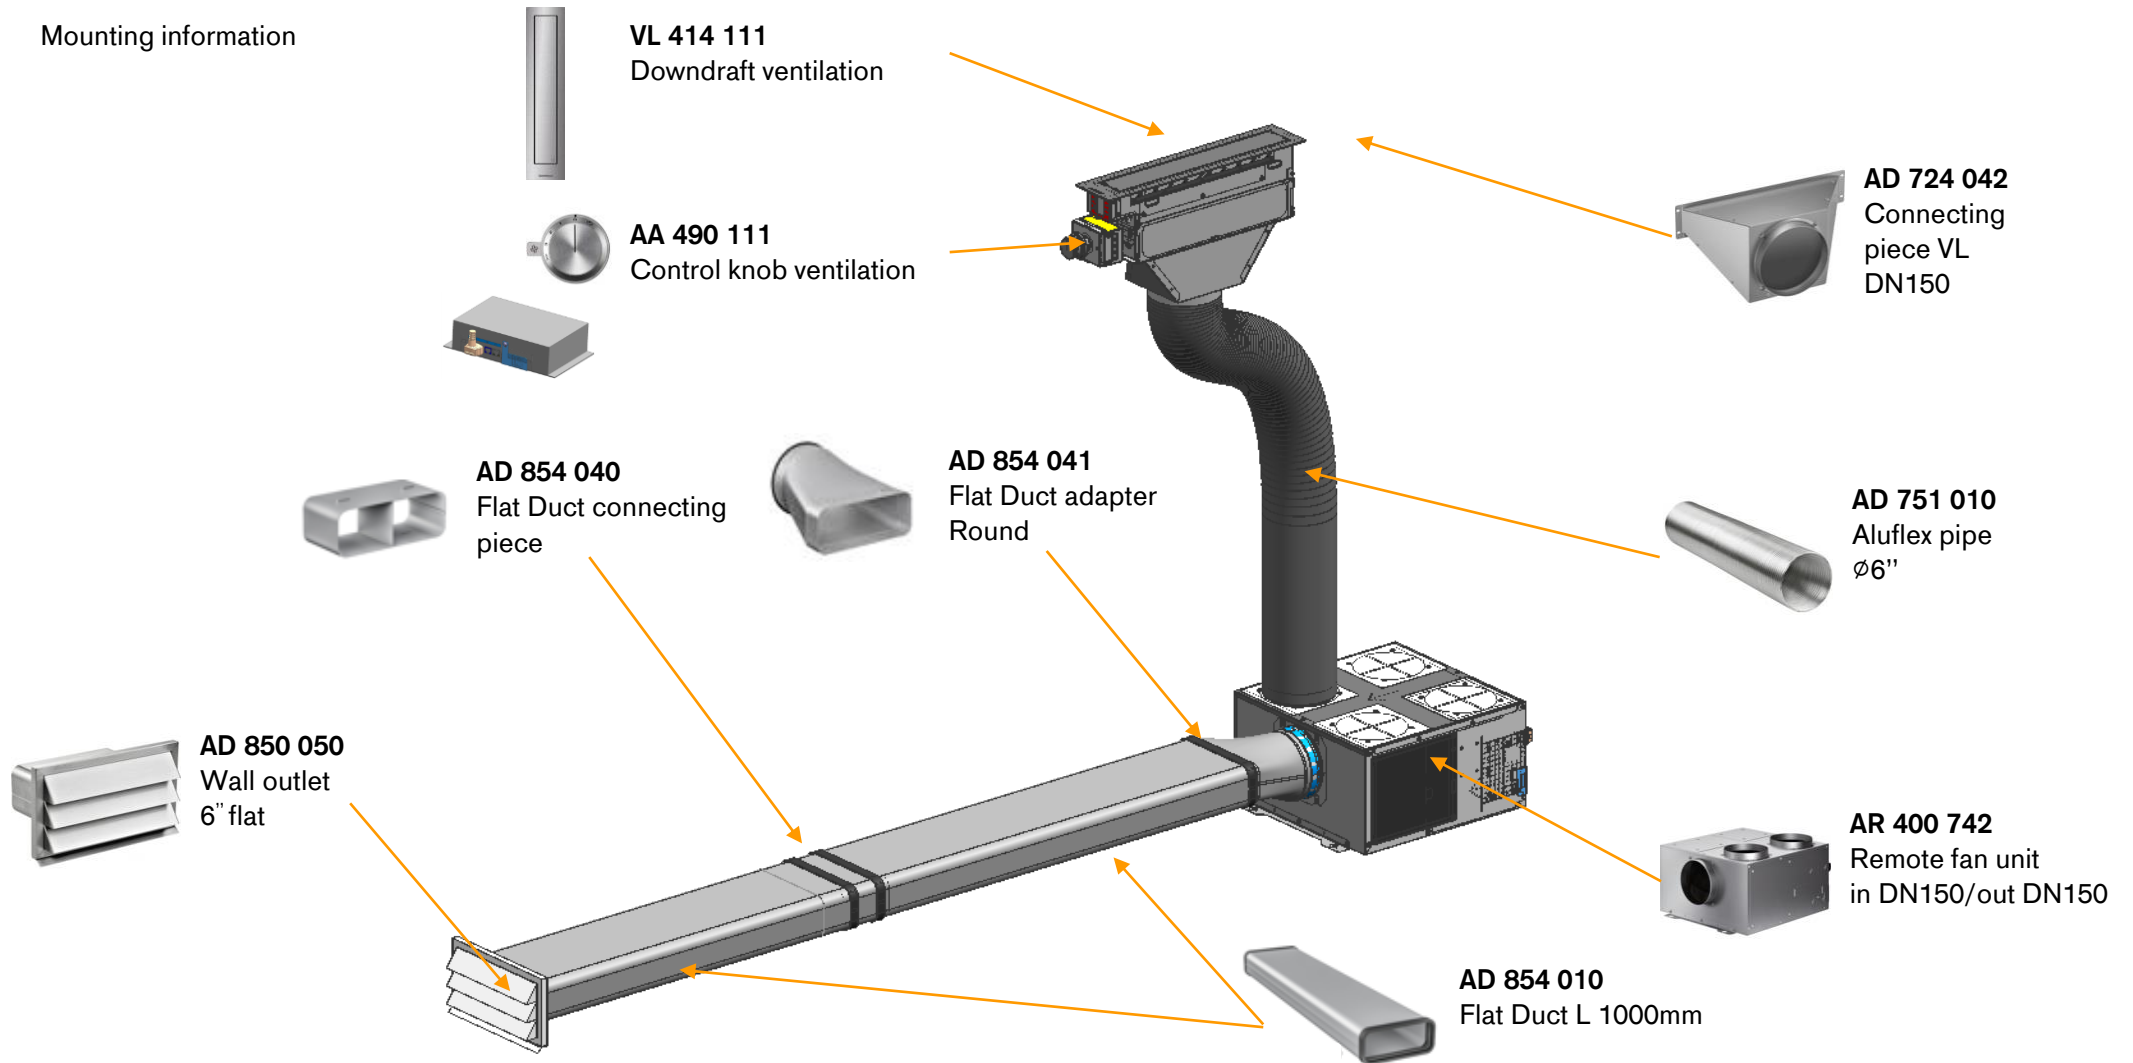


BSH Hausgeräte GmbH, Carl-Wery-Strasse 34, 81739 Munich, Germany
 Chairman of the Supervisory Board: Prof. Dr. Stefan Asenkerschbaumer
 Directors: Uwe Raschke (Chairman), Dr. Gerhard Dambach, Matthias Ginthum, Dr. Silke Maurer
 Registered Office: Munich; Registry Court: Amtsgericht München, HRB 75534, WEEE-Reg.-No. DE 57986696

The drawing is provided only as an example.
 Please pay attention to the technical installation drawings in the Gaggenau Models and Dimensions. The technical drawings are not based on customer data and are merely for installation recommendation. The exact installation must be verified by the kitchen studio on an individual customer basis.


21. April 2020

Configuration	2xVL414111-2xAR400742-3 varios	Min. Work depth	- mm	Ventilation mode	Extraction
Type reference cooktops	VR414- VG 425 – VP 414	Type reference ventilation appliance	VL 414 111	Type reference remote fan unit	AR 400 742

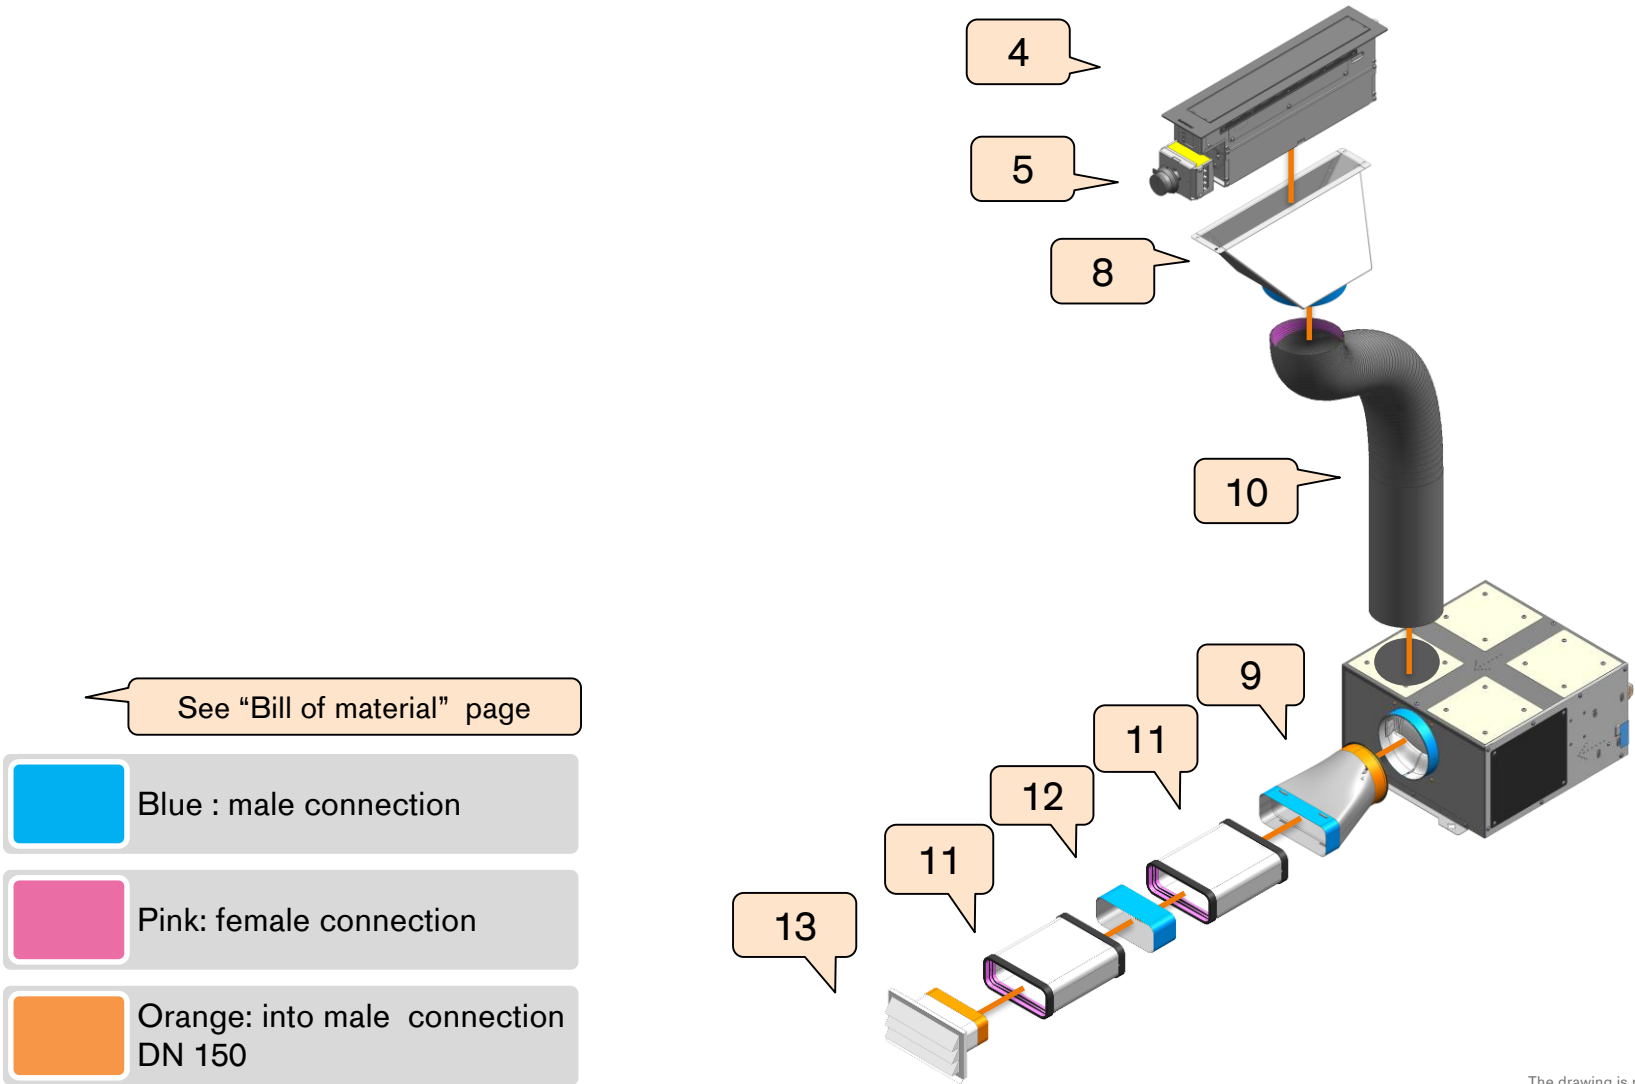

21. April 2020

Configuration	2xVL414111-2xAR400742-3 varios	Min. Work depth	- mm	Ventilation mode	Extraction
Type reference cooktops	VR414- VG 425 - VP 414	Type reference ventilation appliance	VL 414 111	Type reference remote fan unit	AR 400 742

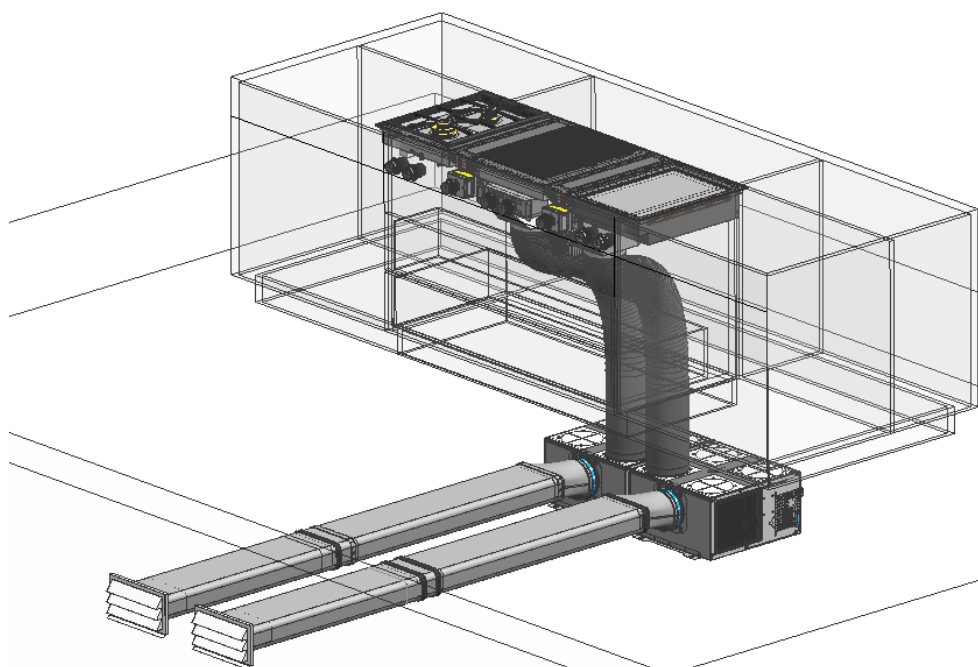

Position	Quantity	Part number	Appliance Design / Accessories Design
1	1	VG 425 211CA	Vario gas cooktop 400 Series
2	1	VR 414 610	Vario grill 400 Series
3	1	VP 414 611	Vario Teppan Yaki 400 Series
4	2	VL 414 111	Vario downdraft ventilation 400 series
5	2	AA 490 711	Control knob ventilation
6	2	AR 400 742	Remote fan unit in DN150/out DN150
7	2	VA 420 00 Or VA 420 010	Connection strip for flush mounting Connection strip for surface mounting
8	2	AD 724 042	Connecting piece for VL ND 150
9	2	AD 854 041	Flat Duct adapter Round
10	2	AD 751 010	Aluflex pipe DN150
11	4	AD 854 010	Flat Duct L 1000mm
12	2	AD 854 040	Flat Duct Connecting piece
13	2	AD 850 050	Wall outlet 6" flat
14	1	AA 414 010	Ventilation moulding for VL414 next to gas appliance
15	1	AD 990 091	Adhesive tape for duct components Aluminium