


## **AL400 Island Configuration.**

**AL400721 46" retractable downdraft + (2) AR400742 inline blower**

7 February 2020


|                         |                          |                                      |            |                                |                |
|-------------------------|--------------------------|--------------------------------------|------------|--------------------------------|----------------|
| Configuration           | AL400721+AR400742_front  | Min. Work depth                      |            | Ventilation mode               | Air extraction |
| Type reference cooktops | VG 425 – VI 414 – VP 414 | Type reference ventilation appliance | AL 400 721 | Type reference remote fan unit | AR 400 742     |

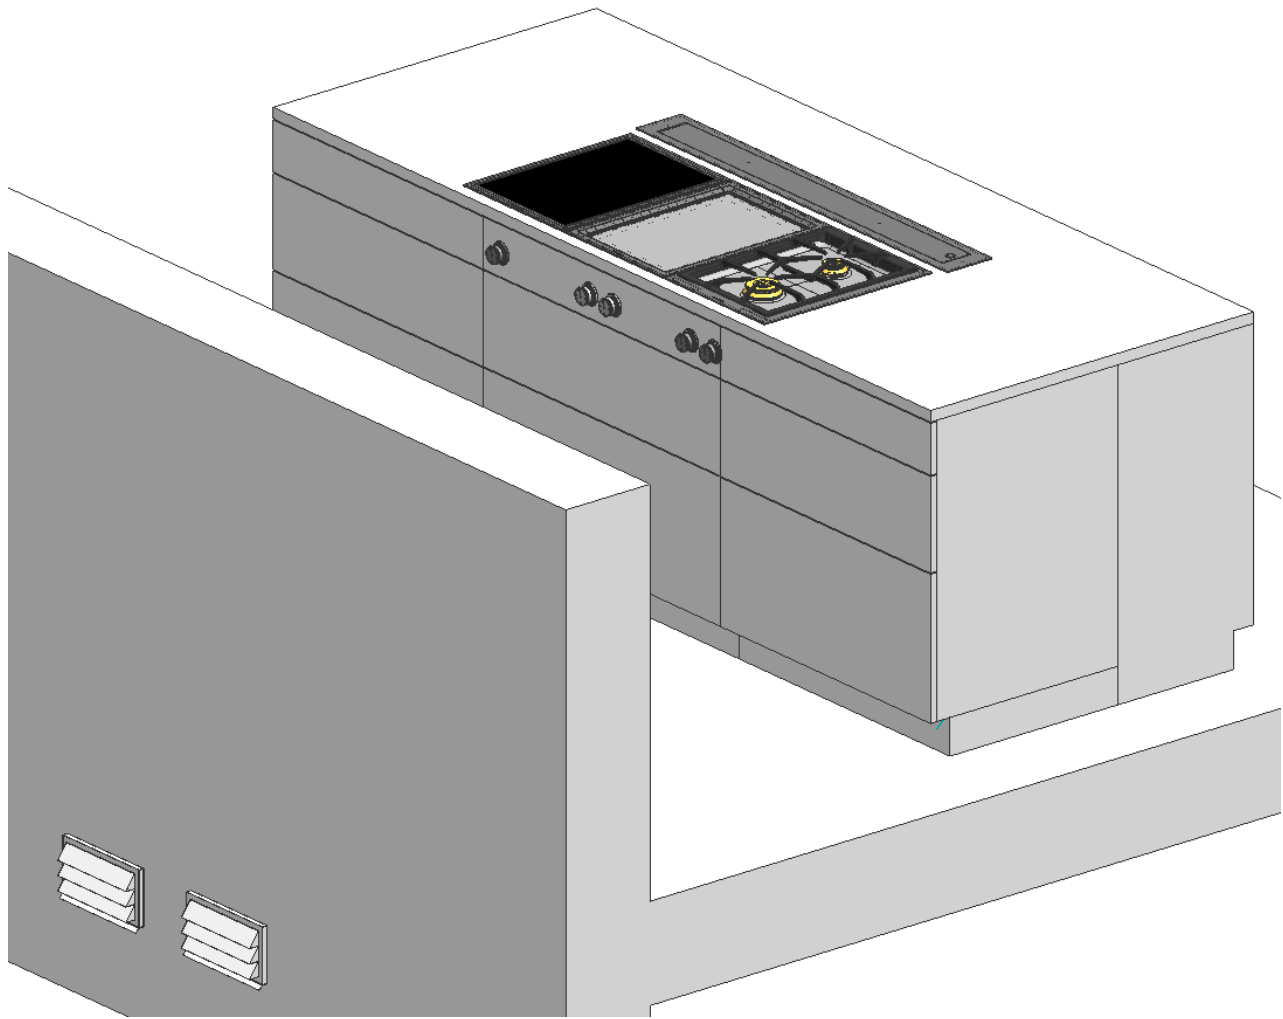

7 February 2020

|                         |                          |                                      |            |                                |                |
|-------------------------|--------------------------|--------------------------------------|------------|--------------------------------|----------------|
| Configuration           | AL400721+AR400742_front  | Min. Work depth                      |            | Ventilation mode               | Air extraction |
| Type reference cooktops | VG 425 – VI 414 – VP 414 | Type reference ventilation appliance | AL 400 721 | Type reference remote fan unit | AR 400 742     |

## Installation view

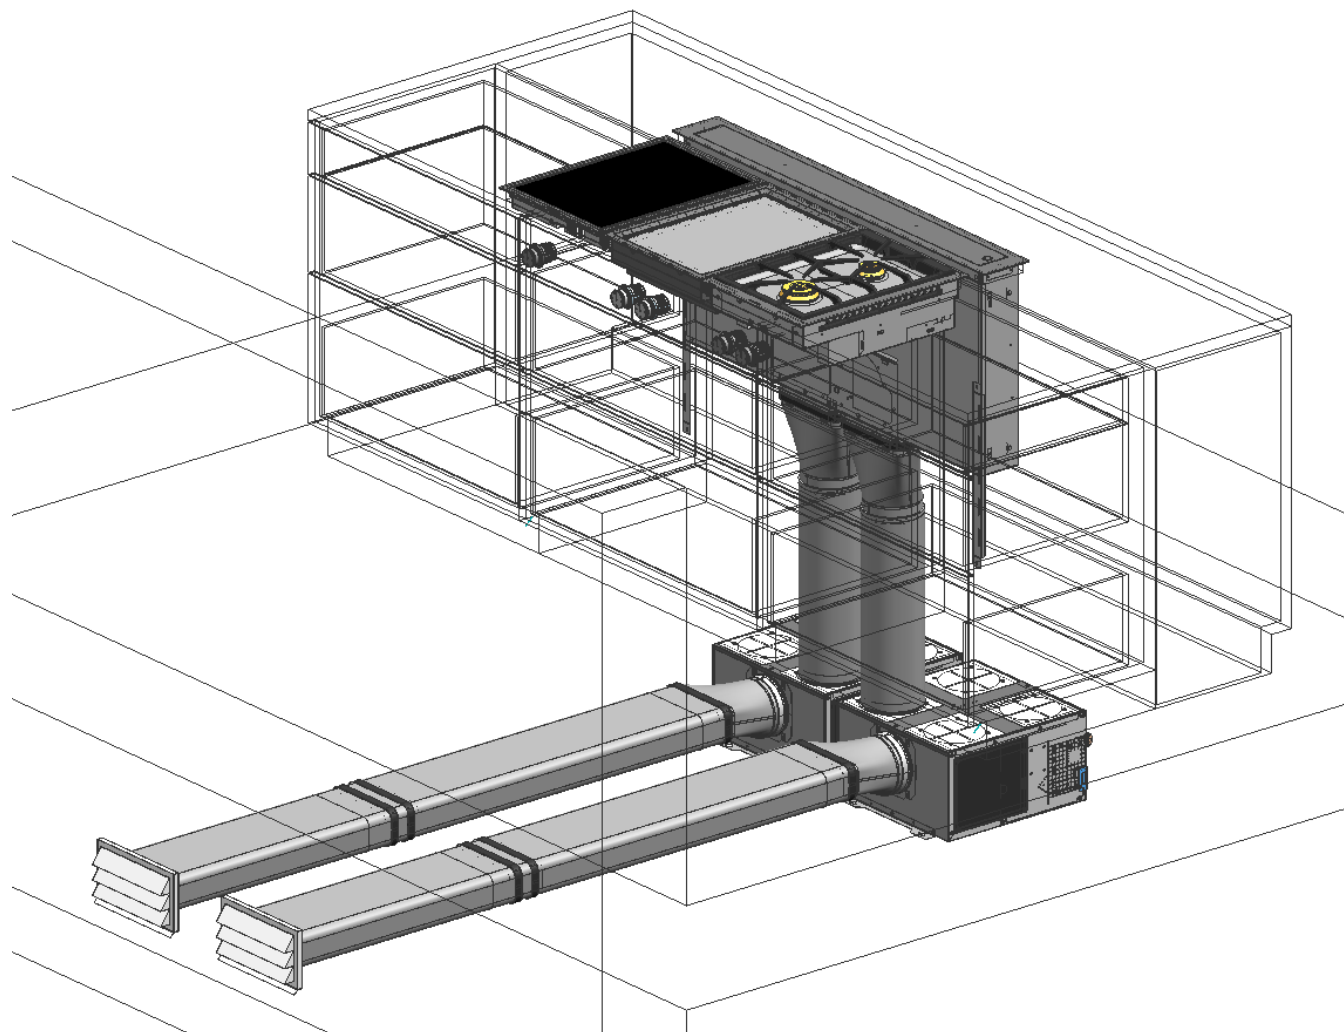


BSH Hausgeräte GmbH, Carl-Wery-Strasse 34, 81739 Munich, Germany  
Chairman of the Supervisory Board: Uwe Raschke  
Directors: Dr. Karsten Ottenberg (Chairman), Matthias Ginthum, Johannes Närgel, Dr. Michael Schöllhorn  
Registered Office: Munich; Registry Court: Amtsgericht München, HRB 75534, WEEE-Reg.-No. DE 57986696

The drawing is provided only as an example.  
Please pay attention to the technical installation drawings in the Gaggenau Models and Dimensions. The technical drawings are not based on customer data and are merely for installation recommendation. The exact installation must be verified by the kitchen studio on an individual customer basis.

7 February 2020

|                         |                          |                                      |            |                                |                |
|-------------------------|--------------------------|--------------------------------------|------------|--------------------------------|----------------|
| Configuration           | AL400721+AR400742_front  | Min. Work depth                      |            | Ventilation mode               | Air extraction |
| Type reference cooktops | VG 425 – VI 414 – VP 414 | Type reference ventilation appliance | AL 400 721 | Type reference remote fan unit | AR 400 742     |

Top view

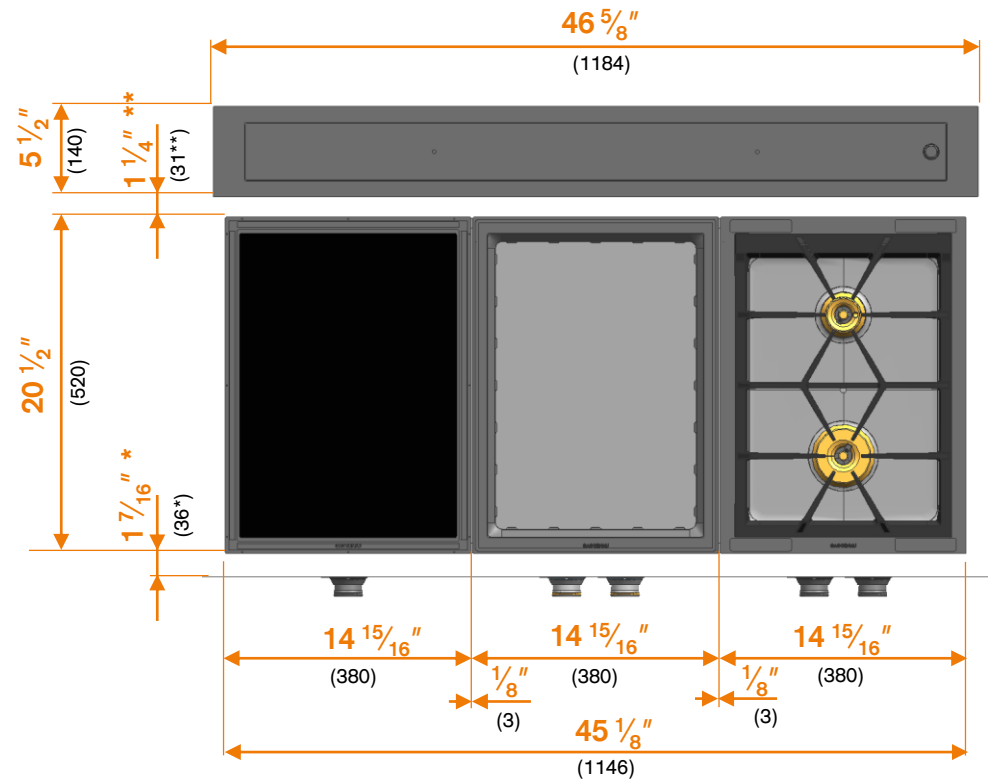

\*: Minimum distance. Distance can be adjusted


\*\*: Recommended distance.

(inside parenthesis) = mm

**GAGGENAU**

BSH Hausgeräte GmbH, Carl-Wery-Strasse 34, 81739 Munich, Germany  
Chairman of the Supervisory Board: Uwe Raschke  
Directors: Dr. Karsten Ottenberg (Chairman), Matthias Ginthum, Johannes Närger, Dr. Michael Schöllhorn  
Registered Office: Munich; Registry Court: Amtsgericht München, HRB 75534, WEEE-Reg.-No. DE 57986696


Cut out dimension. Flush mounting

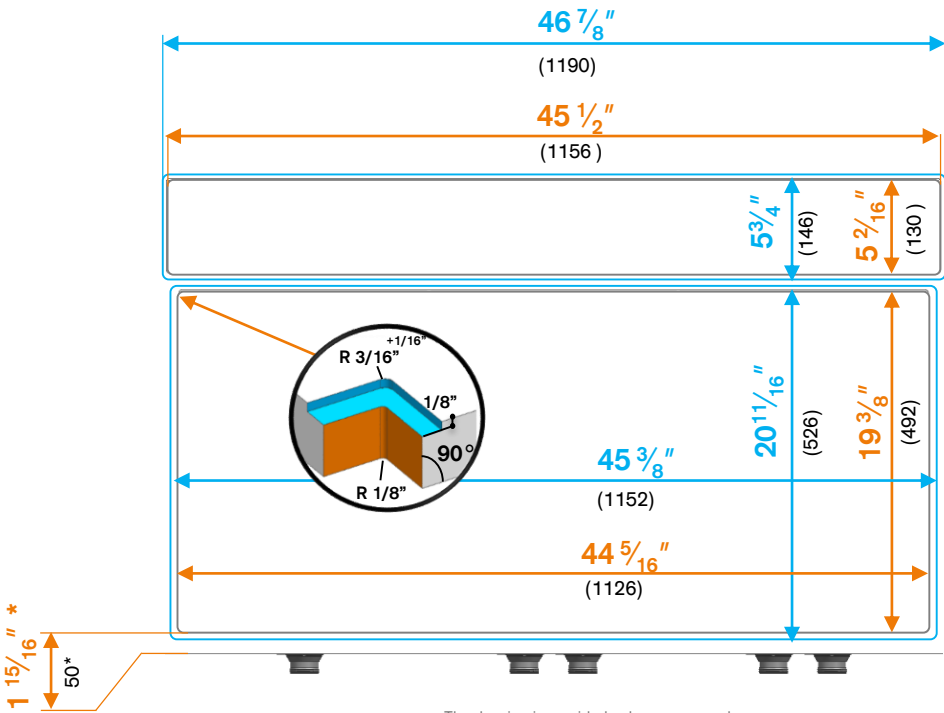

The drawing is provided only as an example.  
Please pay attention to the technical installation drawings in the Gaggenau Models and Dimensions. The technical drawings are not based on customer data and are merely for installation recommendation. The exact installation must be verified by the kitchen studio on an individual customer basis.

7 February 2020

|                         |                          |                                      |            |                                |                |
|-------------------------|--------------------------|--------------------------------------|------------|--------------------------------|----------------|
| Configuration           | AL400721+AR400742_front  | Min. Work depth                      |            | Ventilation mode               | Air extraction |
| Type reference cooktops | VG 425 – VI 414 – VP 414 | Type reference ventilation appliance | AL 400 721 | Type reference remote fan unit | AR 400 742     |

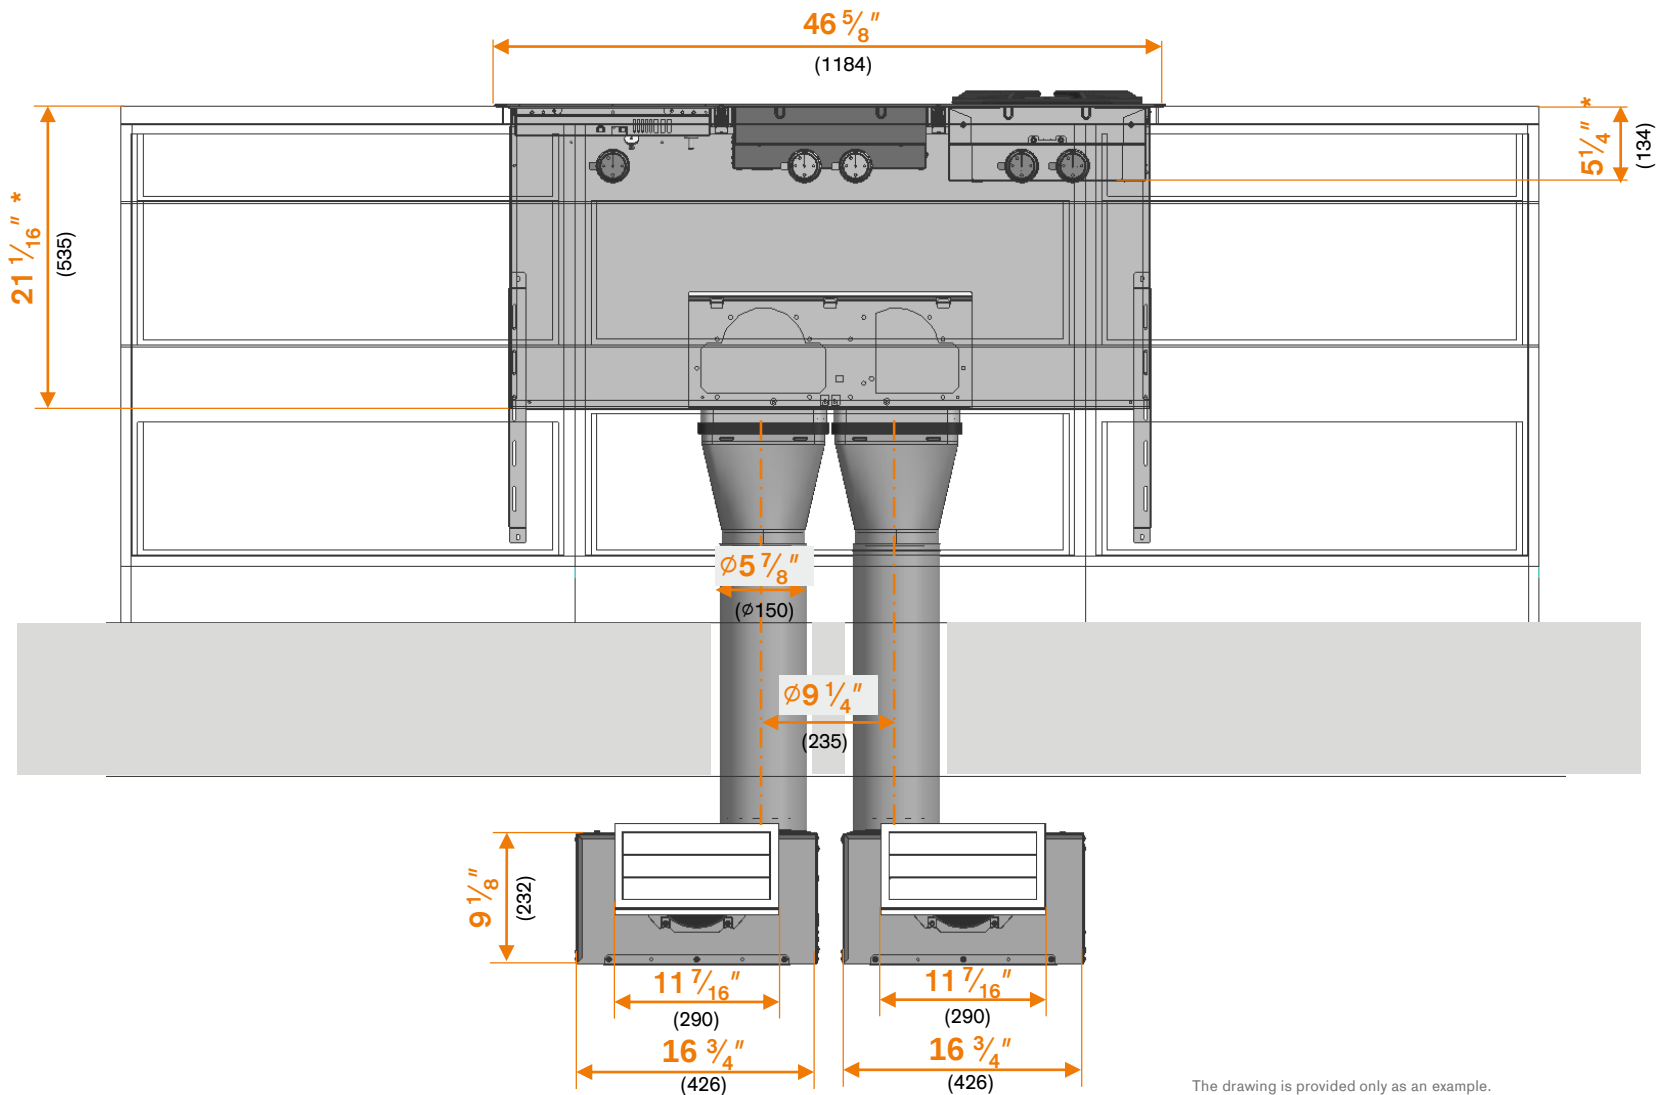

\* : For flush mounted


**GAGGENAU**

BSH Hausgeräte GmbH, Carl-Wery-Strasse 34, 81739 Munich, Germany  
Chairman of the Supervisory Board: Uwe Raschke  
Directors: Dr. Karsten Ottenberg (Chairman), Matthias Ginthum, Johannes Närgen, Dr. Michael Schöllhorn  
Registered Office: Munich; Registry Court: Amtsgericht München, HRB 75534, WEEE-Reg.-No. DE 57986696

The drawing is provided only as an example.  
Please pay attention to the technical installation drawings in the Gaggenau Models and Dimensions. The technical drawings are not based on customer data and are merely for installation recommendation. The exact installation must be verified by the kitchen studio on an individual customer basis.

7 February 2020

|                         |                          |                                      |            |                                |                |
|-------------------------|--------------------------|--------------------------------------|------------|--------------------------------|----------------|
| Configuration           | AL400721+AR400742_front  | Min. Work depth                      |            | Ventilation mode               | Air extraction |
| Type reference cooktops | VG 425 – VI 414 – VP 414 | Type reference ventilation appliance | AL 400 721 | Type reference remote fan unit | AR 400 742     |

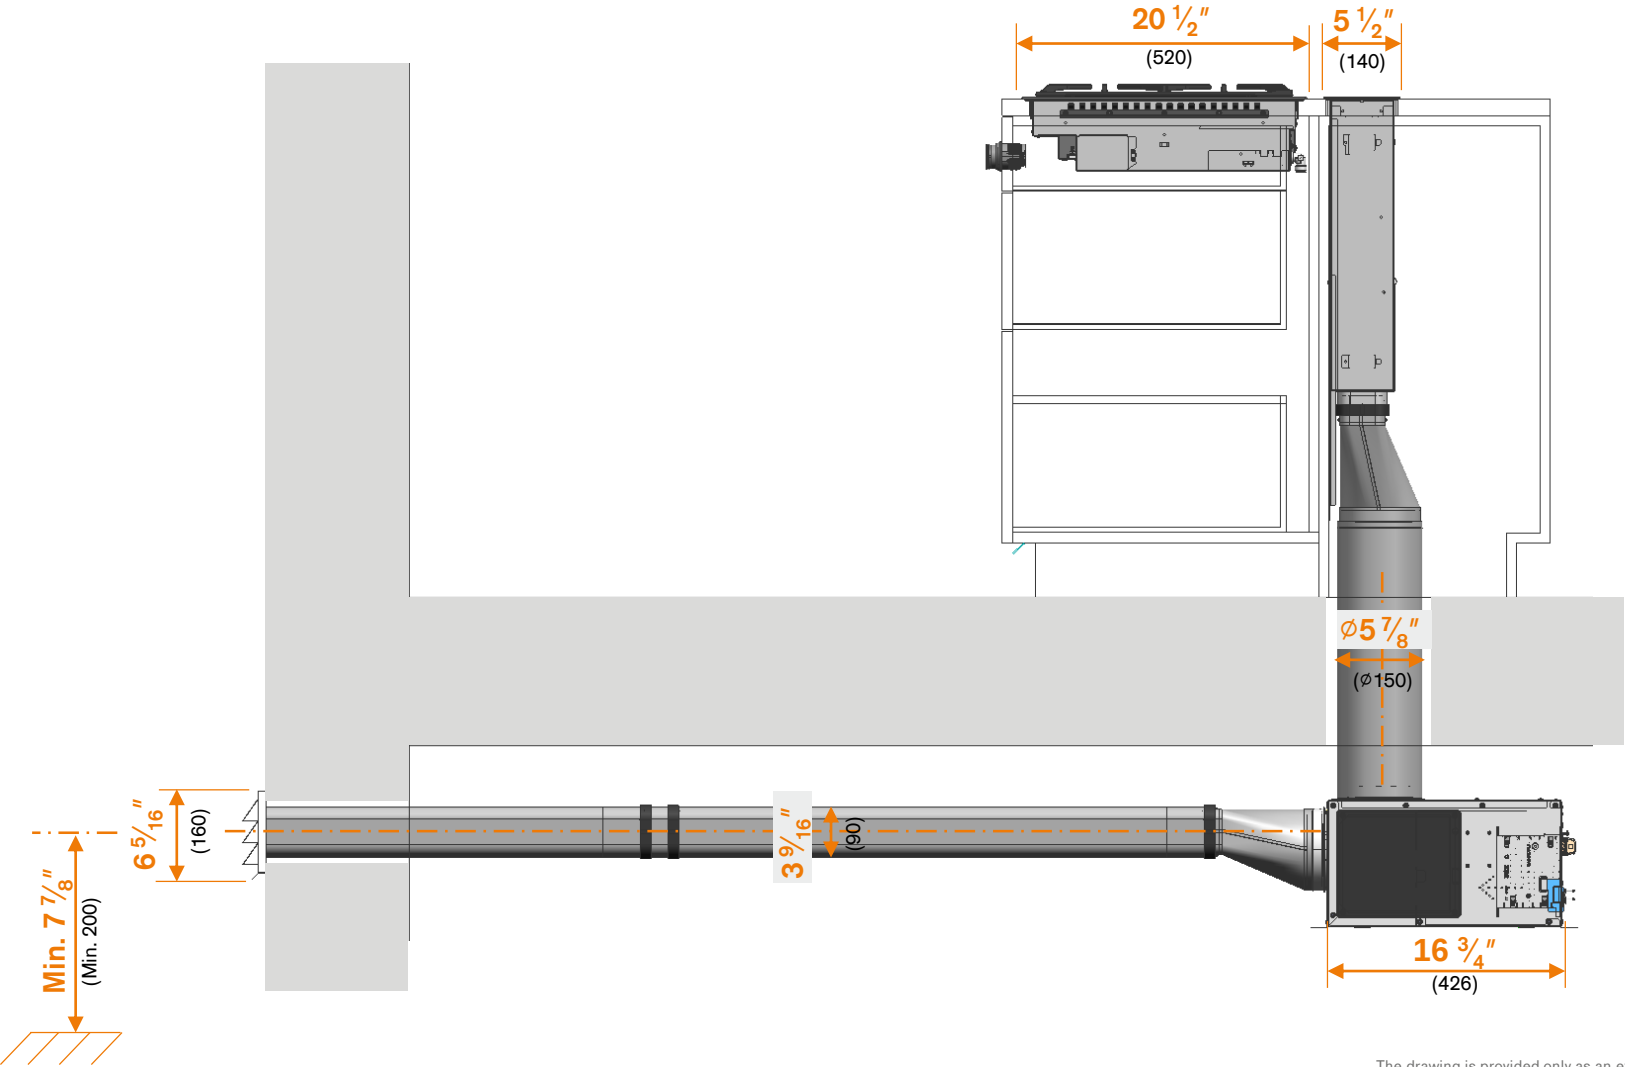


BSH Hausgeräte GmbH, Carl-Wery-Strasse 34, 81739 Munich, Germany  
Chairman of the Supervisory Board: Uwe Raschke  
Directors: Dr. Karsten Ottenberg (Chairman), Matthias Ginthum, Johannes Närgel, Dr. Michael Schöllhorn  
Registered Office: Munich; Registry Court: Amtsgericht München, HRB 75534, WEEE-Reg.-No. DE 57986696

The drawing is provided only as an example.  
Please pay attention to the technical installation drawings in the Gaggenau Models and Dimensions. The technical drawings are not based on customer data and are merely for installation recommendation. The exact installation must be verified by the kitchen studio on an individual customer basis.

7 February 2020

|                         |                          |                                      |            |                                |                |
|-------------------------|--------------------------|--------------------------------------|------------|--------------------------------|----------------|
| Configuration           | AL400721+AR400742_front  | Min. Work depth                      |            | Ventilation mode               | Air extraction |
| Type reference cooktops | VG 425 – VI 414 – VP 414 | Type reference ventilation appliance | AL 400 721 | Type reference remote fan unit | AR 400 742     |

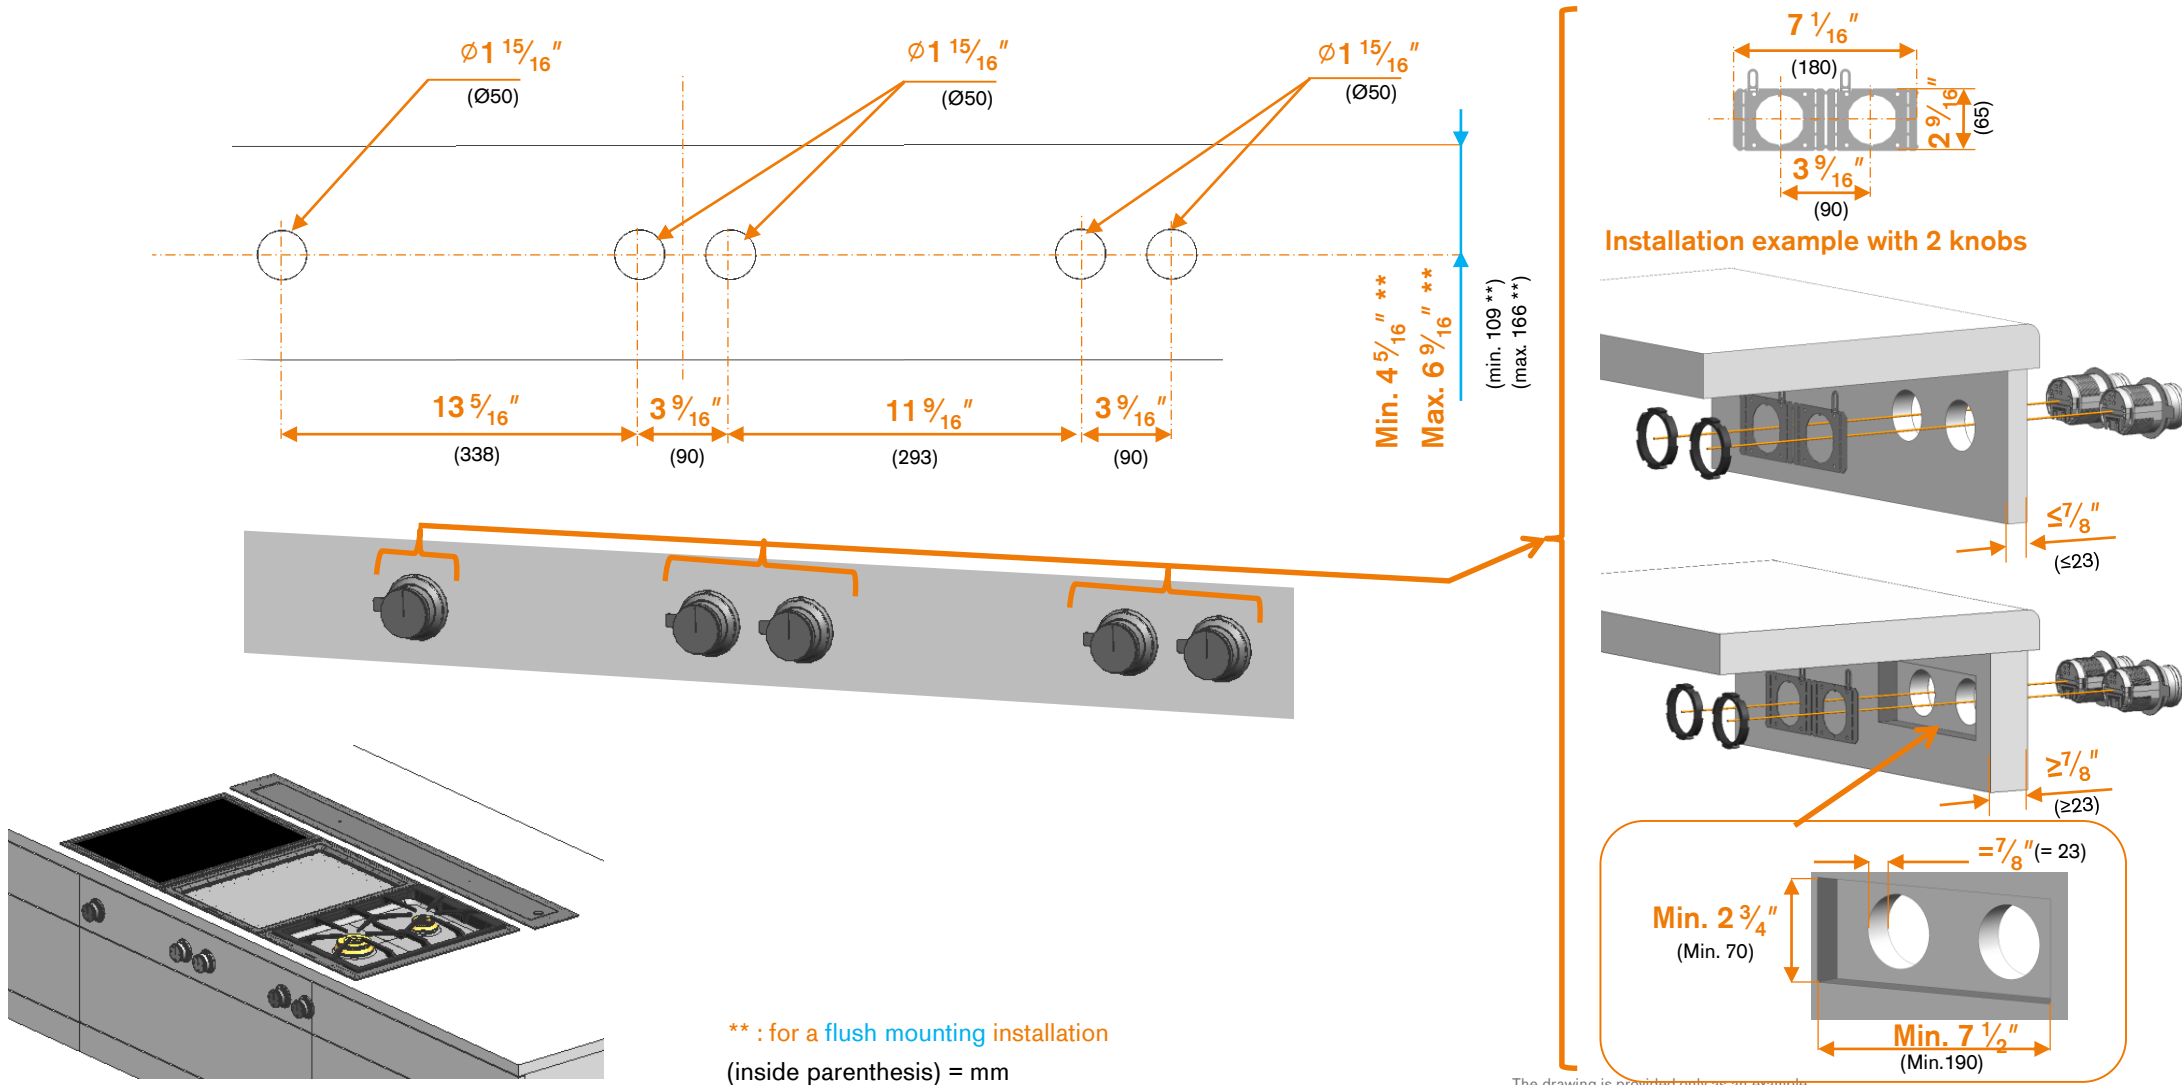


The drawing is provided only as an example.

Please pay attention to the technical installation drawings in the Gaggenau Models and Dimensions. The technical drawings are not based on customer data and are merely for installation recommendation. The exact installation must be verified by the kitchen studio on an individual customer basis.

7 February 2020

|                         |                          |                                      |            |                                |                |
|-------------------------|--------------------------|--------------------------------------|------------|--------------------------------|----------------|
| Configuration           | AL400721+AR400742_front  | Min. Work depth                      |            | Ventilation mode               | Air extraction |
| Type reference cooktops | VG 425 – VI 414 – VP 414 | Type reference ventilation appliance | AL 400 721 | Type reference remote fan unit | AR 400 742     |

Information about remote fan unit AR 400 742

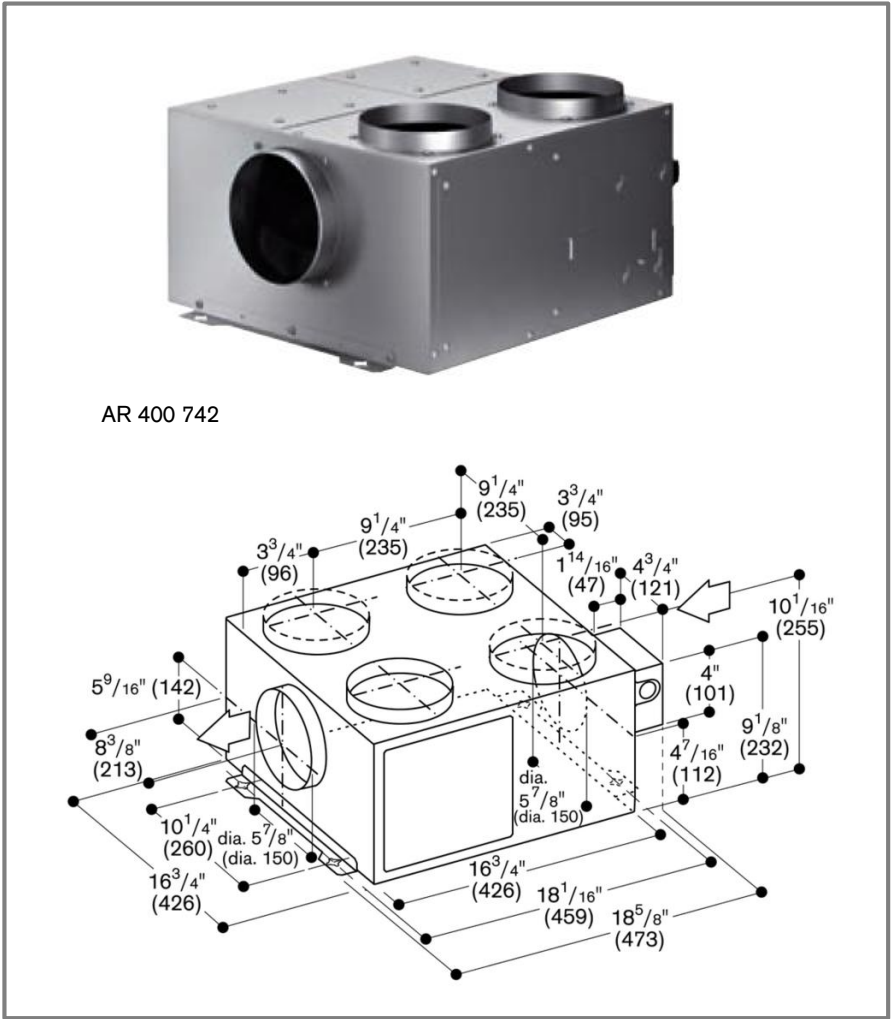


AR 400 742

7 February 2020

|                         |                          |                                      |            |                                |                |
|-------------------------|--------------------------|--------------------------------------|------------|--------------------------------|----------------|
| Configuration           | AL400721+AR400742_front  | Min. Work depth                      |            | Ventilation mode               | Air extraction |
| Type reference cooktops | VG 425 – VI 414 – VP 414 | Type reference ventilation appliance | AL 400 721 | Type reference remote fan unit | AR 400 742     |

## Mounting information

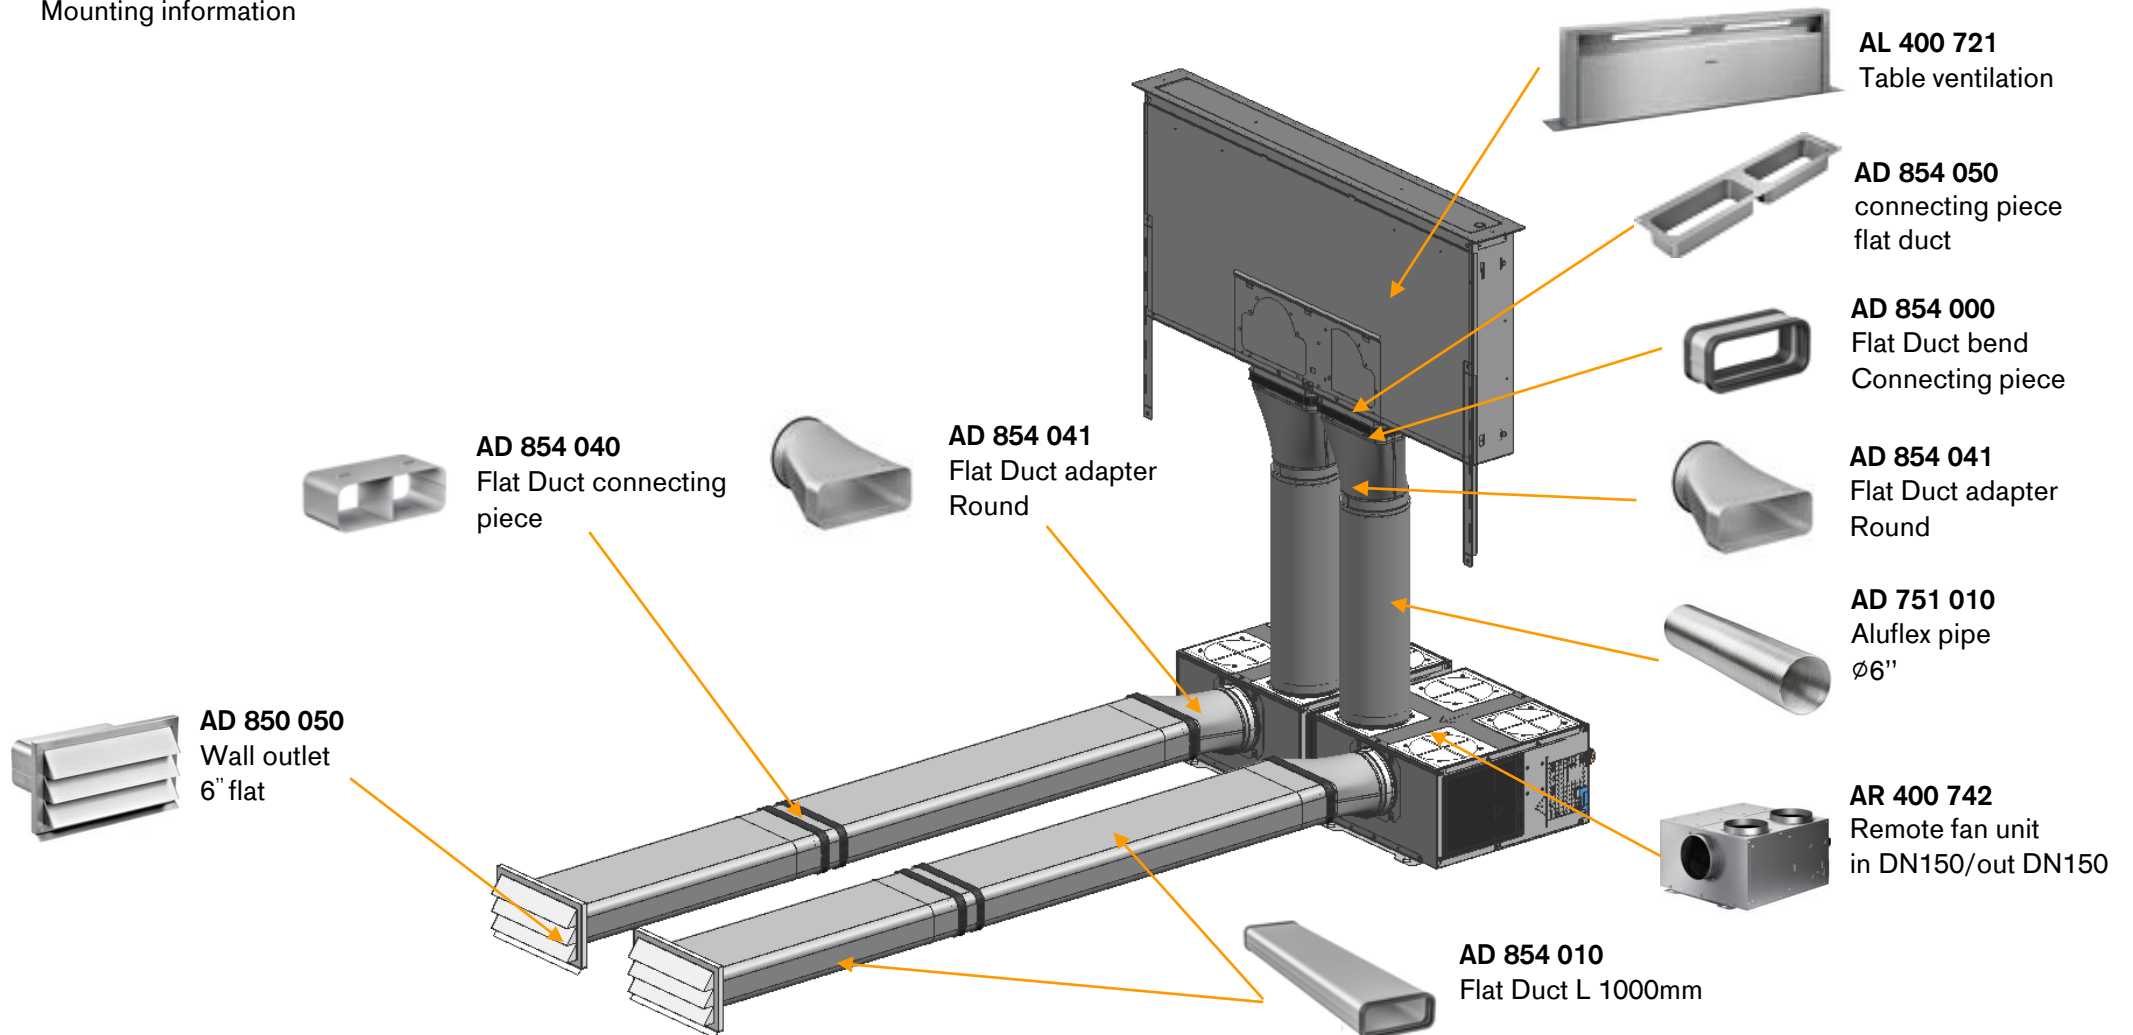


BSH Hausgeräte GmbH, Carl-Wery-Strasse 34, 81739 Munich, Germany  
Chairman of the Supervisory Board: Uwe Raschke  
Directors: Dr. Karsten Ottenberg (Chairman), Matthias Ginthum, Johannes Närgel, Dr. Michael Schöllhorn  
Registered Office: Munich; Registry Court: Amtsgericht München, HRB 75534, WEEE-Reg.-No. DE 57986696

ed only as an example.  
Please pay attention to the technical installation drawings in the Gaggenau Models and Dimensions. The technical drawings are not based on customer data and are merely for installation recommendation. The exact installation must be verified by the kitchen studio on an individual customer basis.

7 February 2020

|                         |                          |                                      |            |                                |                |
|-------------------------|--------------------------|--------------------------------------|------------|--------------------------------|----------------|
| Configuration           | AL400721+AR400742_front  | Min. Work depth                      |            | Ventilation mode               | Air extraction |
| Type reference cooktops | VG 425 – VI 414 – VP 414 | Type reference ventilation appliance | AL 400 721 | Type reference remote fan unit | AR 400 742     |

Mounting information

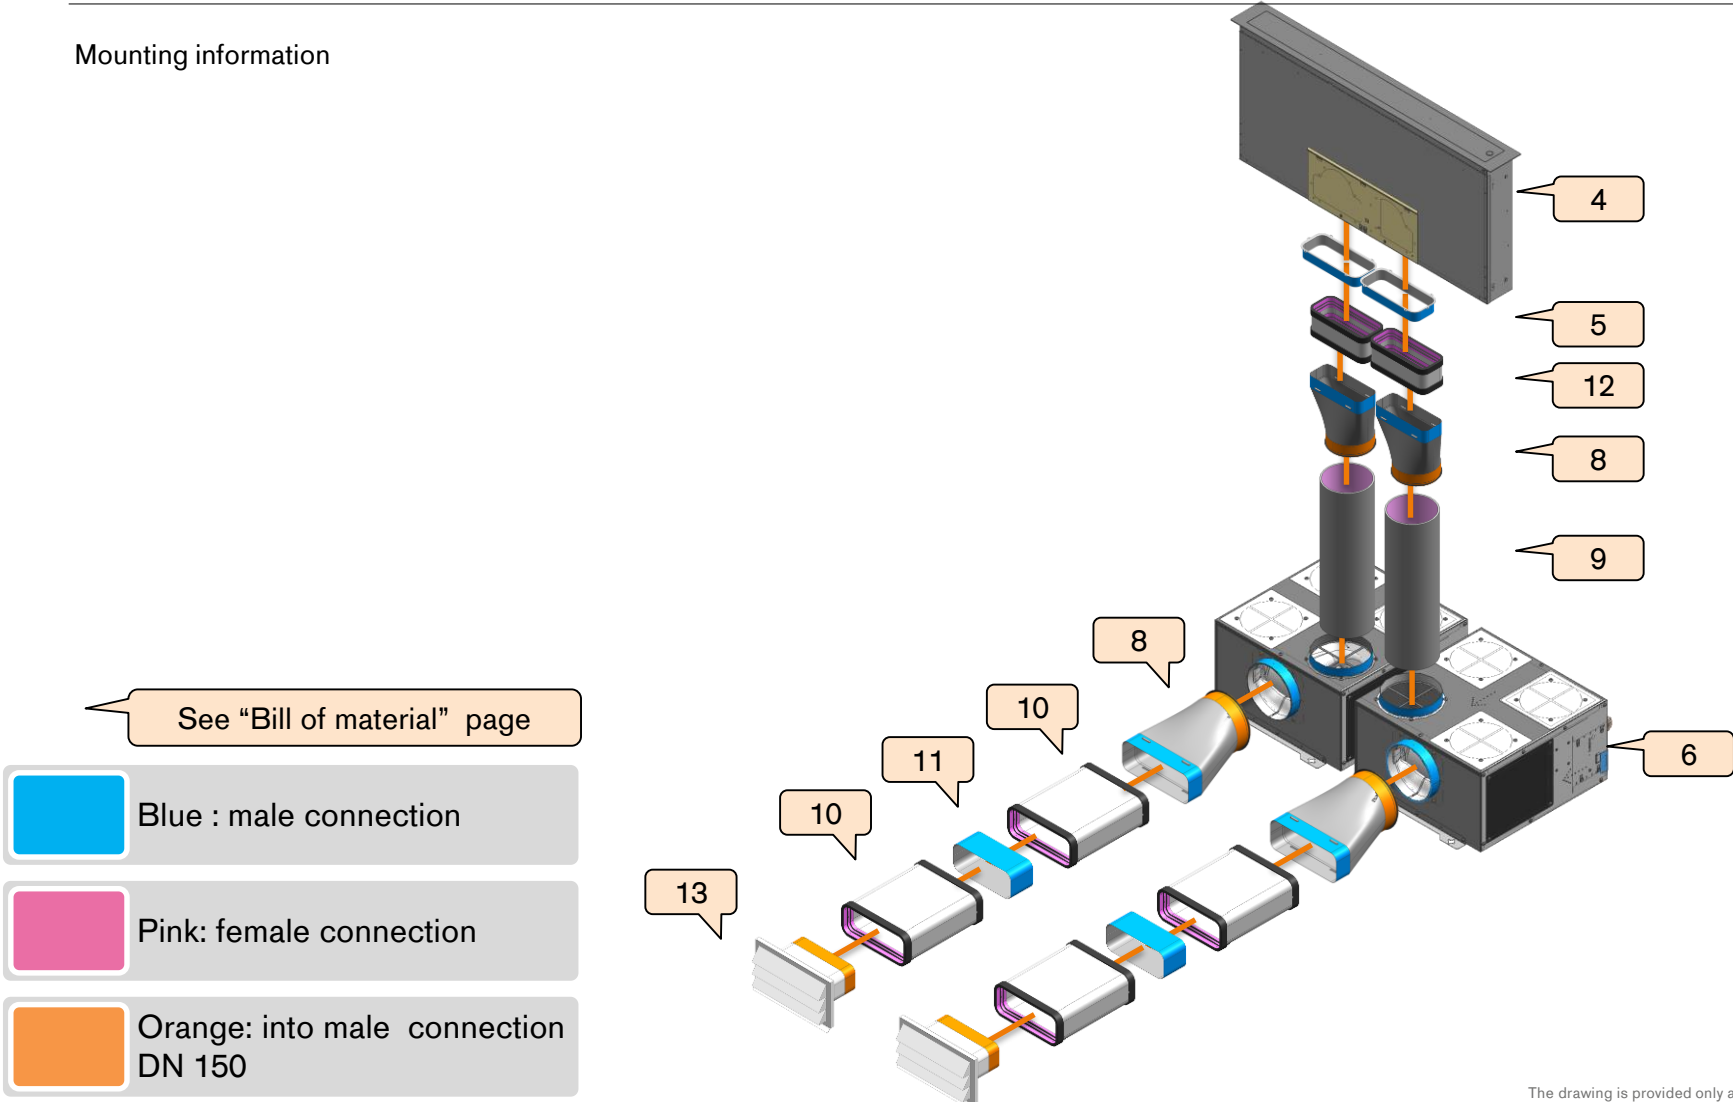


BSH Hausgeräte GmbH, Carl-Wery-Strasse 34, 81739 Munich, Germany  
Chairman of the Supervisory Board: Uwe Raschke  
Directors: Dr. Karsten Ottenberg (Chairman), Matthias Ginthum, Johannes Närgen, Dr. Michael Schöllhorn  
Registered Office: Munich; Registry Court: Amtsgericht München, HRB 75534, WEEE-Reg.-No. DE 57986696

The drawing is provided only as an example.  
Please pay attention to the technical installation drawings in the Gaggenau Models and Dimensions. The technical drawings are not based on customer data and are merely for installation recommendation. The exact installation must be verified by the kitchen studio on an individual customer basis.

7 February 2020

|                         |                          |                                      |            |                                |                |
|-------------------------|--------------------------|--------------------------------------|------------|--------------------------------|----------------|
| Configuration           | AL400721+AR400742_front  | Min. Work depth                      |            | Ventilation mode               | Air extraction |
| Type reference cooktops | VG 425 – VI 414 – VP 414 | Type reference ventilation appliance | AL 400 721 | Type reference remote fan unit | AR 400 742     |

## Bill of material

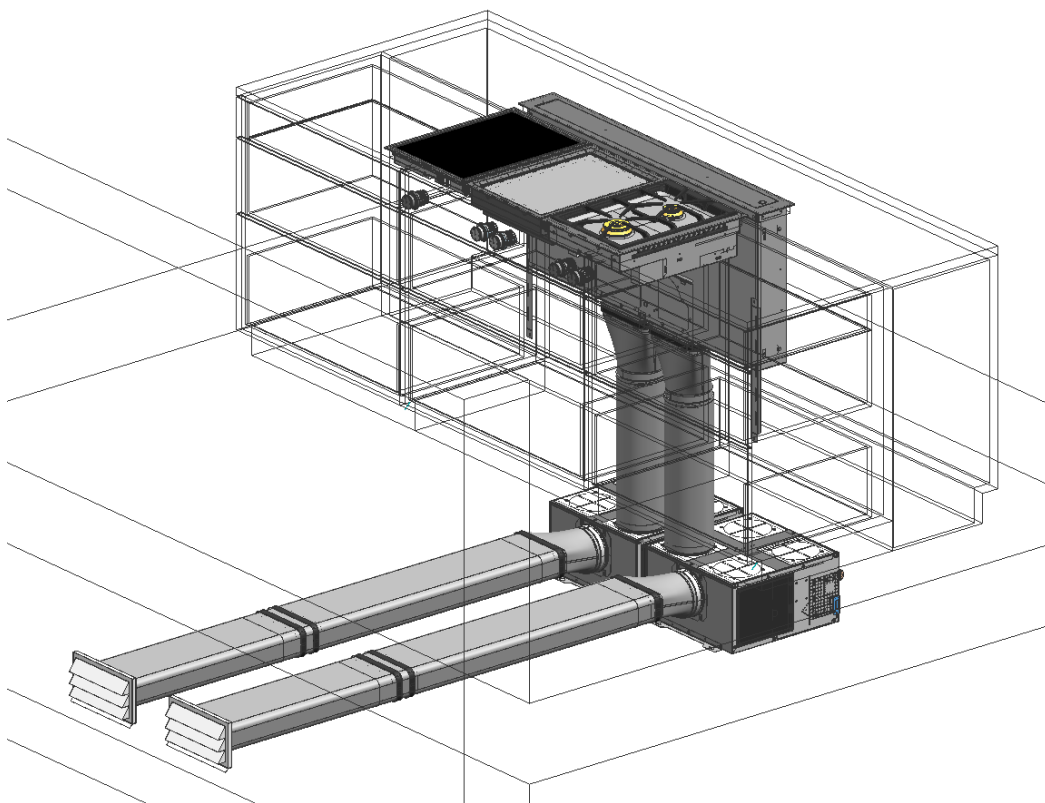

| Position | Quantity | Part number                   | Appliance Design / Accessories Design                                        |
|----------|----------|-------------------------------|------------------------------------------------------------------------------|
| 1        | 1        | VG 425 211CA                  | Vario gas cooktop 400 Series                                                 |
| 2        | 1        | VI 414 611                    | Vario induction Wok 400 Series                                               |
| 3        | 1        | VP 414 611                    | Vario Teppan Yaki 400 Series                                                 |
| 4        | 2        | AL 400 721                    | Table ventilation                                                            |
| 5        | 1        | AD 854 050                    | Connecting piece flat duct                                                   |
| 6        | 2        | AR 400 742                    | Remote fan unit in DN150/out DN150                                           |
| 7        | 2        | VA 420 00<br>Or<br>VA 420 010 | Connection strip for flush mounting<br>Connection strip for surface mounting |
| 8        | 2        | AD 854 041                    | Flat Duct adapter Round                                                      |
| 9        | 2        | AD 751 010                    | Aluflex pipe DN150                                                           |
| 10       | 4        | AD 854 010                    | Flat Duct L 1000mm                                                           |
| 11       | 2        | AD 854 040                    | Flat Duct Connecting piece                                                   |
| 12       | 2        | AD 854 000                    | Flat Duct bend Connecting piece                                              |
| 13       | 2        | AD 850 050                    | Wall outlet 6" flat                                                          |
| 14       | 1        | AD 990 091                    | Adhesive tape for duct components Aluminium                                  |
| 15       | 1        | AA 409 431                    | Furniture support 47 7/16" for 46 5/8" AL 400 downdraft.                     |

Please check the availability of the products in your country.