


1 March 2022


Configuration	AL 400 722 + AR 410 710	Min. Work depth	35 ⁷ / ₁₆ "	Ventilation mode	Air recirculation
Type reference cooktops	CX 482 611 –VP 414 711	Type reference ventilation appliance	AL 400 722	Type reference remote fan unit	AR 410 710

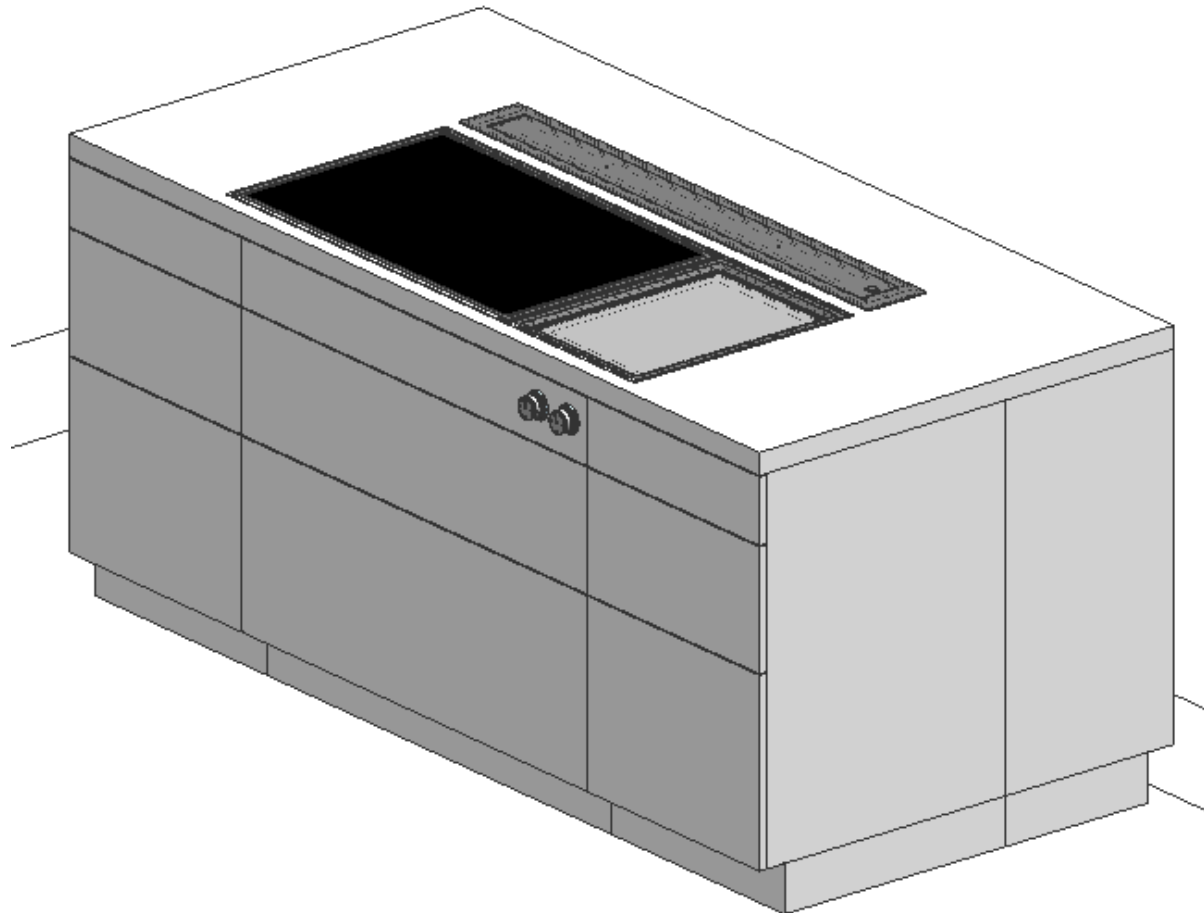

1 March 2022

Configuration	AL 400 722 + AR 410 710	Min. Work depth	35 7⁄16"	Ventilation mode	Air recirculation
Type reference cooktops	CX 482 611 –VP 414 711	Type reference ventilation appliance	AL 400 722	Type reference remote fan unit	AR 410 710



Installation view

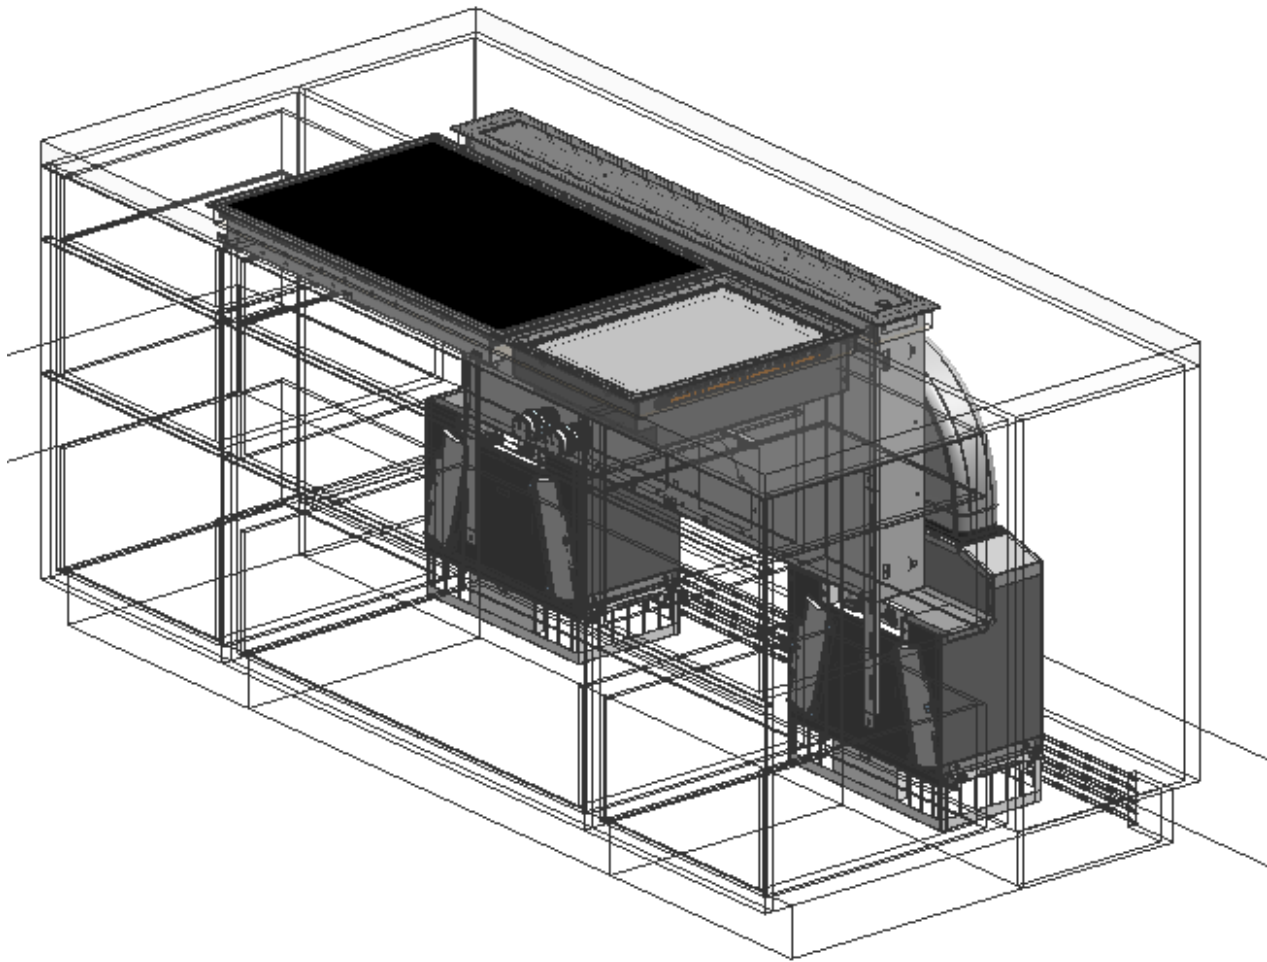

1 March 2022

Configuration	AL 400 722 + AR 410 710	Min. Work depth	35 7/16"	Ventilation mode	Air recirculation
Type reference cooktops	CX 482 611 –VP 414 711	Type reference ventilation appliance	AL 400 722	Type reference remote fan unit	AR 410 710

Top view

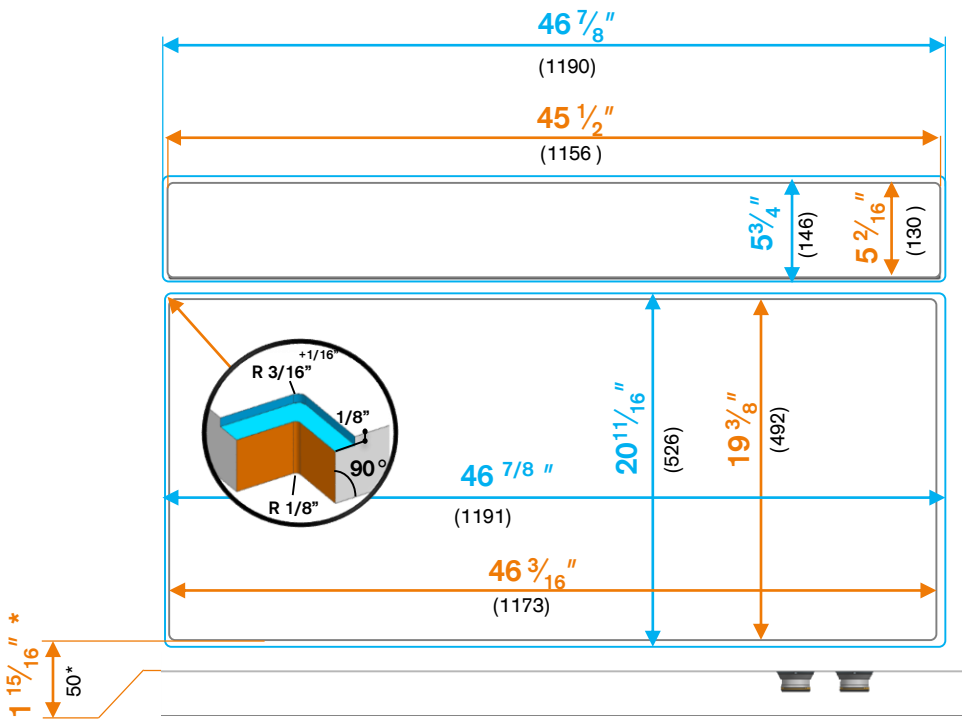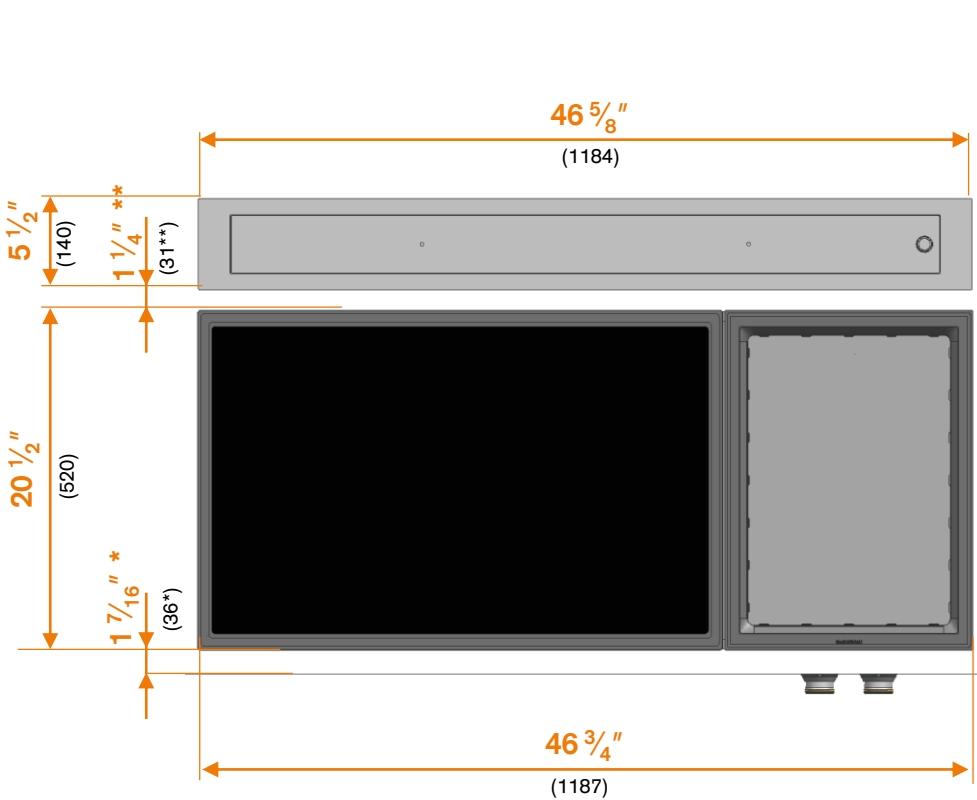

Cut out dimension. Flush mounting

*: Minimum distance. Distance can be adjusted

**: Recommended distance.

(inside parenthesis) = mm

GAGGENAU



BSH Hausgeräte GmbH, Carl-Wery-Strasse 34, 81739 Munich, Germany
Chairman of the Supervisory Board: Prof. Dr. Stefan Asenkerschbaumer
Directors: Uwe Raschke (Chairman), Dr. Gerhard Dambach, Matthias Ginthum, Dr. Silke Maurer
Registered Office: Munich; Registry Court: Amtsgericht München, HRB 75534 , WEEE-Reg.-No. DE 57986696

The drawing is provided only as an example.
Please pay attention to the technical installation drawings in the Gaggenau Models and Dimensions. The technical drawings are not based on customer data and are merely for installation recommendation. The exact installation must be verified by the kitchen studio on an individual customer basis.

1 March 2022

Configuration	AL 400 722 + AR 410 710	Min. Work depth	35 7/16"	Ventilation mode	Air recirculation
Type reference cooktops	CX 482 611 –VP 414 711	Type reference ventilation appliance	AL 400 722	Type reference remote fan unit	AR 410 710

Top view

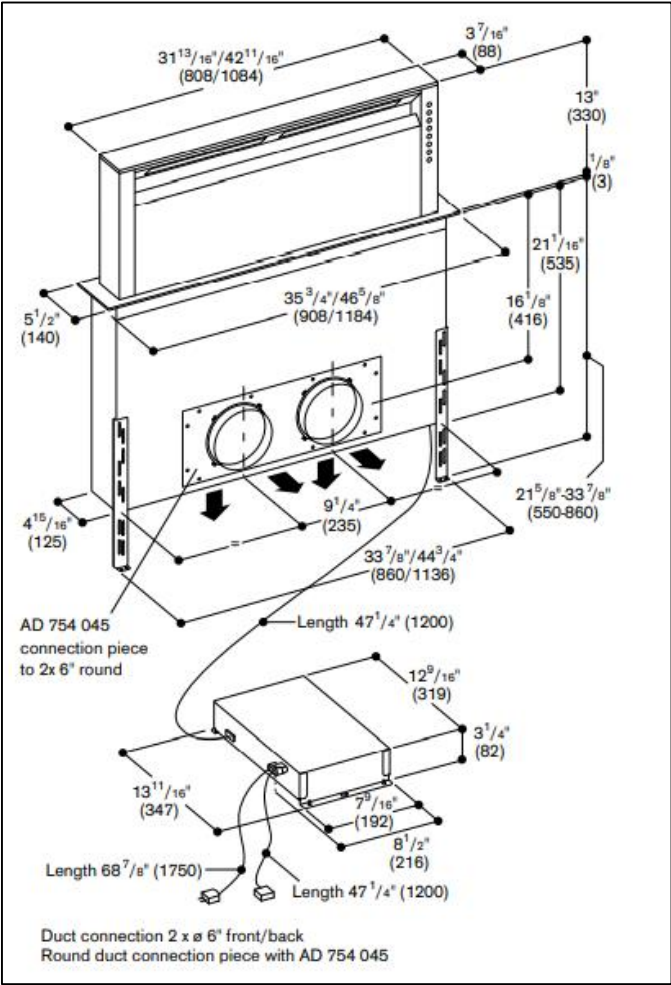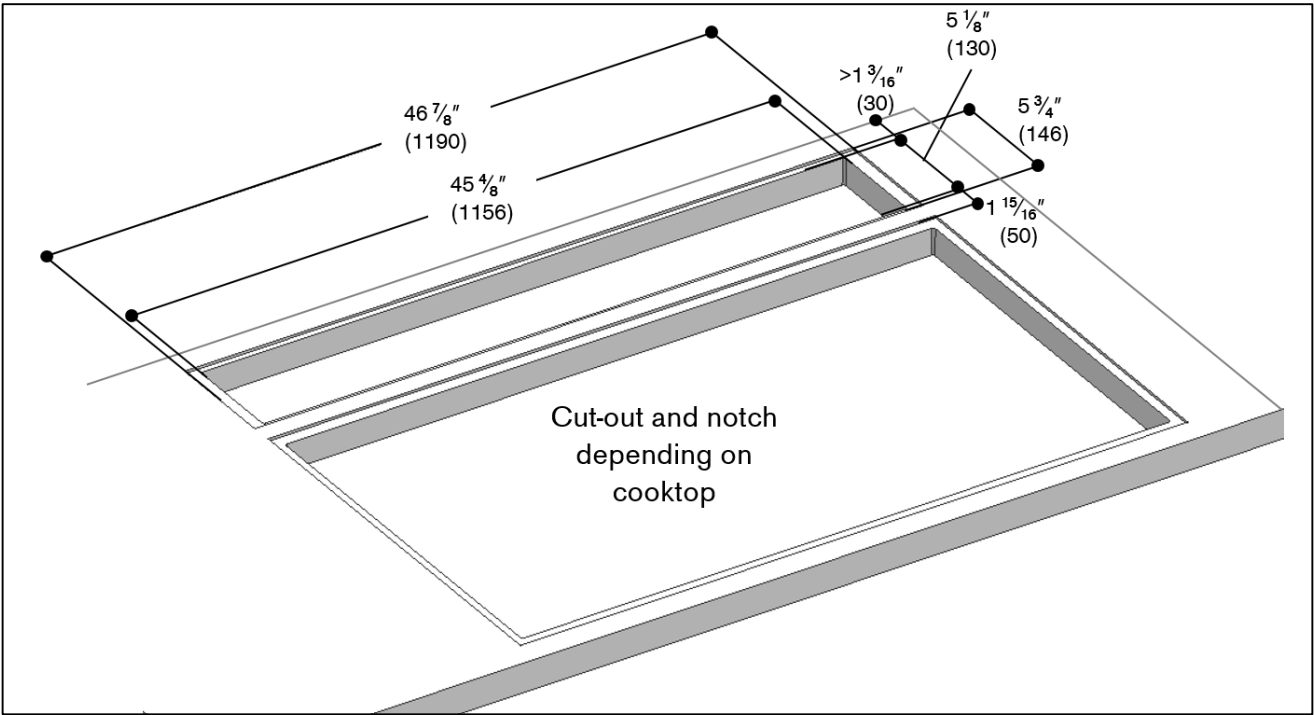

(inside parenthesis) = mm


GAGGENAU

BSH Hausgeräte GmbH, Carl-Wery-Straße 34, 81739 Munich, Germany
Chairman of the Supervisory: Prof. Dr. Stefan Asenkerschbaumer
Directors: Dr. Carla Kriwet (Chairman), Dr. Gerhard Dambach, Matthias Ginthum, Dr. Silke Maurer
Registered Office: Munich; Registry Court: Amtsgericht München, HRB 75534 WEEE-Reg.-Nr. DE 57986696

The drawing is provided only as an example.
Please pay attention to the technical installation drawings in the Gaggenau Models and Dimensions. The technical drawings are not based on customer data and are merely for installation recommendation. The exact installation must be verified by the kitchen studio on an individual customer basis.

Configuration	AL 400 722 + AR 410 710	Min. Work depth	35 7⁄16"	Ventilation mode	Air recirculation
Type reference cooktops	CX 482 611 –VP 414 711	Type reference ventilation appliance	AL 400 722	Type reference remote fan unit	AR 410 710

Front View

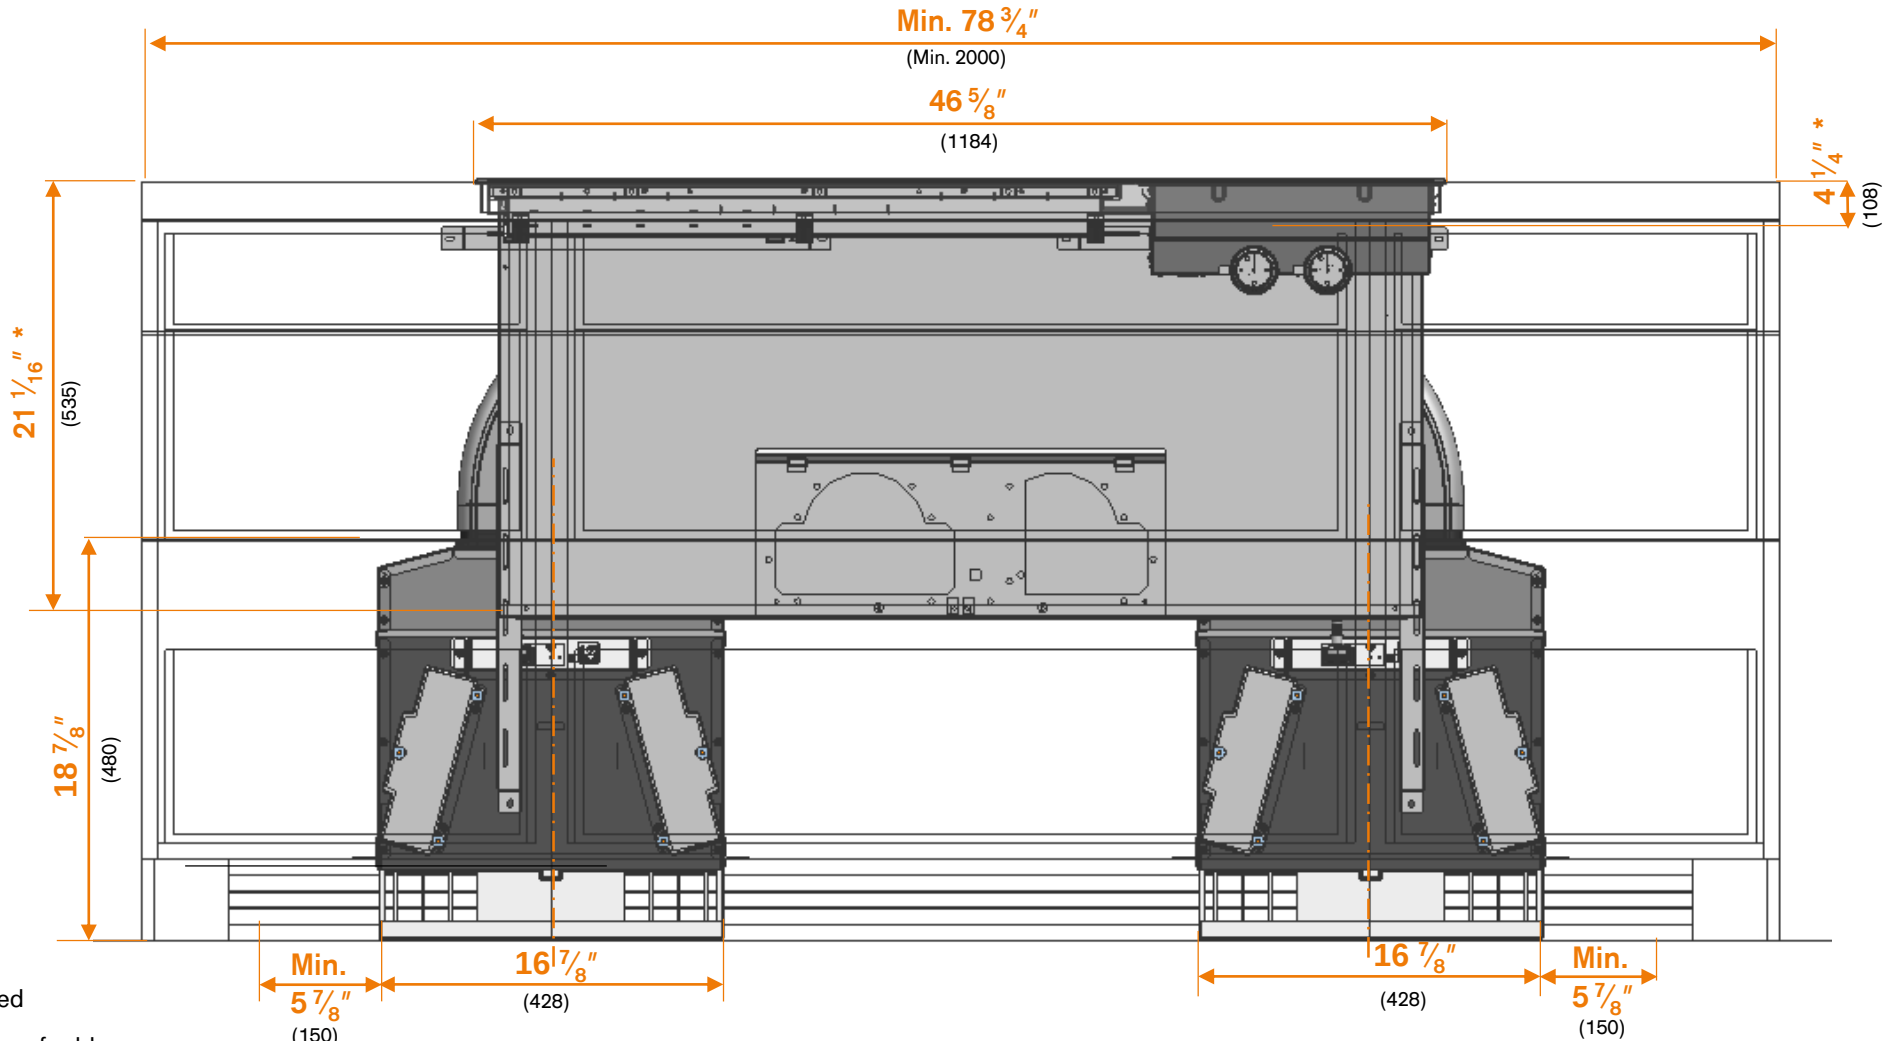

* : For flush mounted

** : Cutout dimensions for blowers


BSH Hausgeräte GmbH, Carl-Wery-Strasse 34, 81739 Munich, Germany
Chairman of the Supervisory Board: Prof. Dr. Stefan Asenkerschbaumer
Directors: Uwe Raschke (Chairman), Dr. Gerhard Dambach, Matthias Ginthum, Dr. Silke Maurer
Registered Office: Munich; Registry Court: Amtsgericht München, HRB 75534 , WEEE-Reg.-No. DE 57986696

The drawing is provided only as an example.
Please pay attention to the technical installation drawings in the Gaggenau Models and Dimensions. The technical drawings are not based on customer data and are merely for installation recommendation. The exact installation must be verified by the kitchen studio on an individual customer basis.

1 March 2022

Configuration	AL 400 722 + AR 410 710	Min. Work depth	35 7⁄16"	Ventilation mode	Air recirculation
Type reference cooktops	CX 482 611 –VP 414 711	Type reference ventilation appliance	AL 400 722	Type reference remote fan unit	AR 410 710

Left view

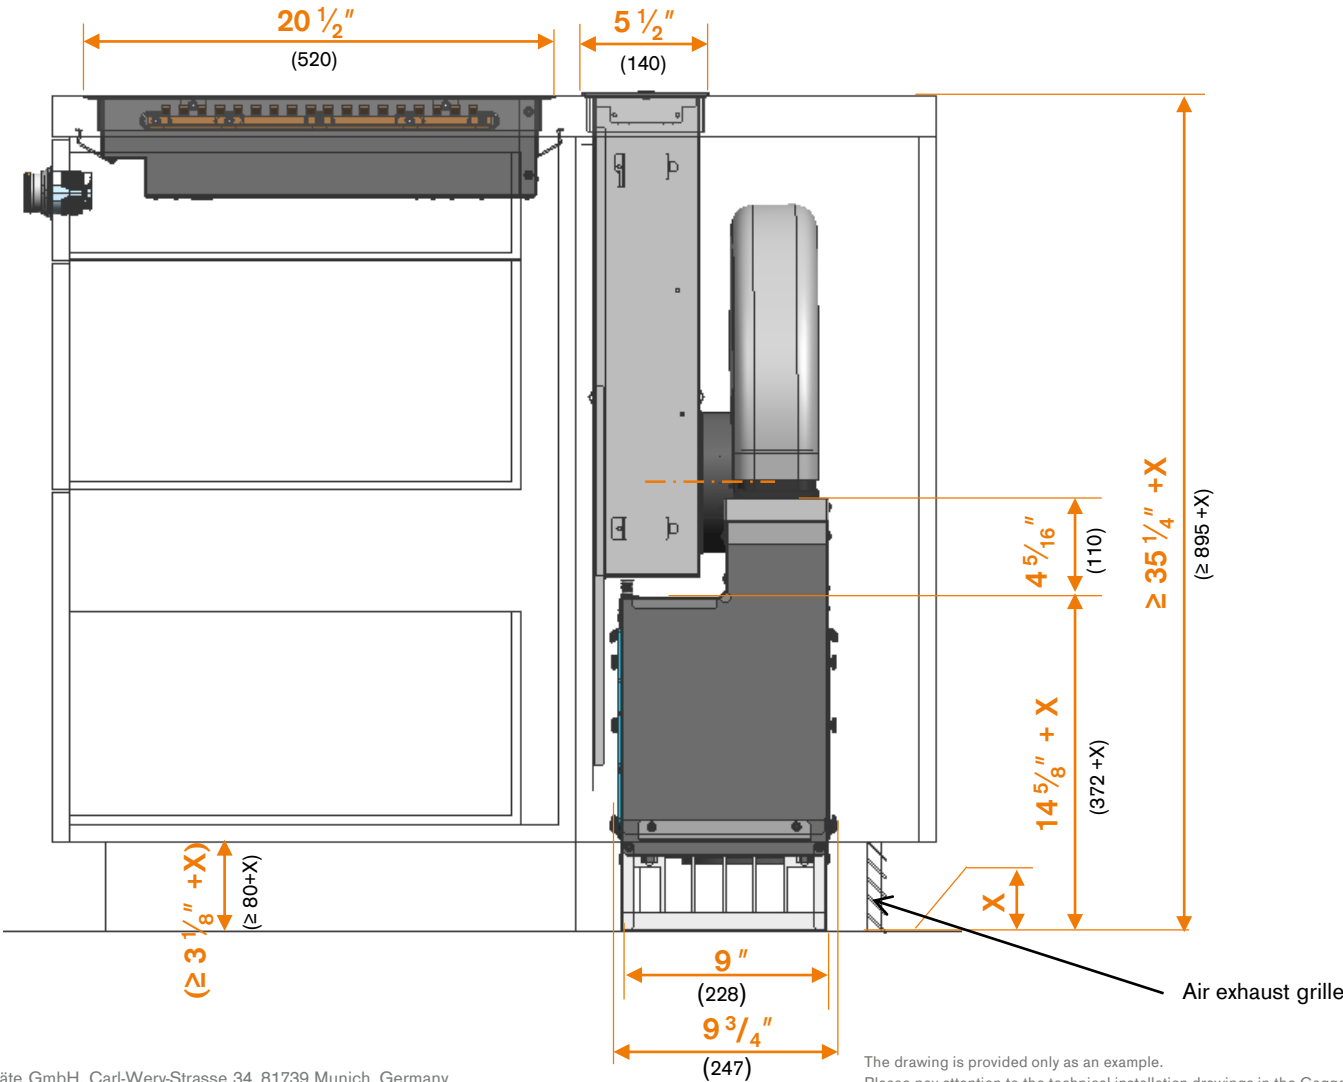


BSH Hausgeräte GmbH, Carl-Wery-Strasse 34, 81739 Munich, Germany
Chairman of the Supervisory Board: Prof. Dr. Stefan Asenkerschbaumer
Directors: Uwe Raschke (Chairman), Dr. Gerhard Dambach, Matthias Ginthum, Dr. Silke Maurer
Registered Office: Munich; Registry Court: Amtsgericht München, HRB 75534 , WEEE-Reg.-No. DE 57986696

The drawing is provided only as an example.
Please pay attention to the technical installation drawings in the Gaggenau Models and Dimensions. The technical drawings are not based on customer data and are merely for installation recommendation. The exact installation must be verified by the kitchen studio on an individual customer basis.

Configuration	AL 400 722 + AR 410 710	Min. Work depth	35 7⁄16"	Ventilation mode	Air recirculation
Type reference cooktops	CX 482 611 –VP 414 711	Type reference ventilation appliance	AL 400 722	Type reference remote fan unit	AR 410 710

Back View

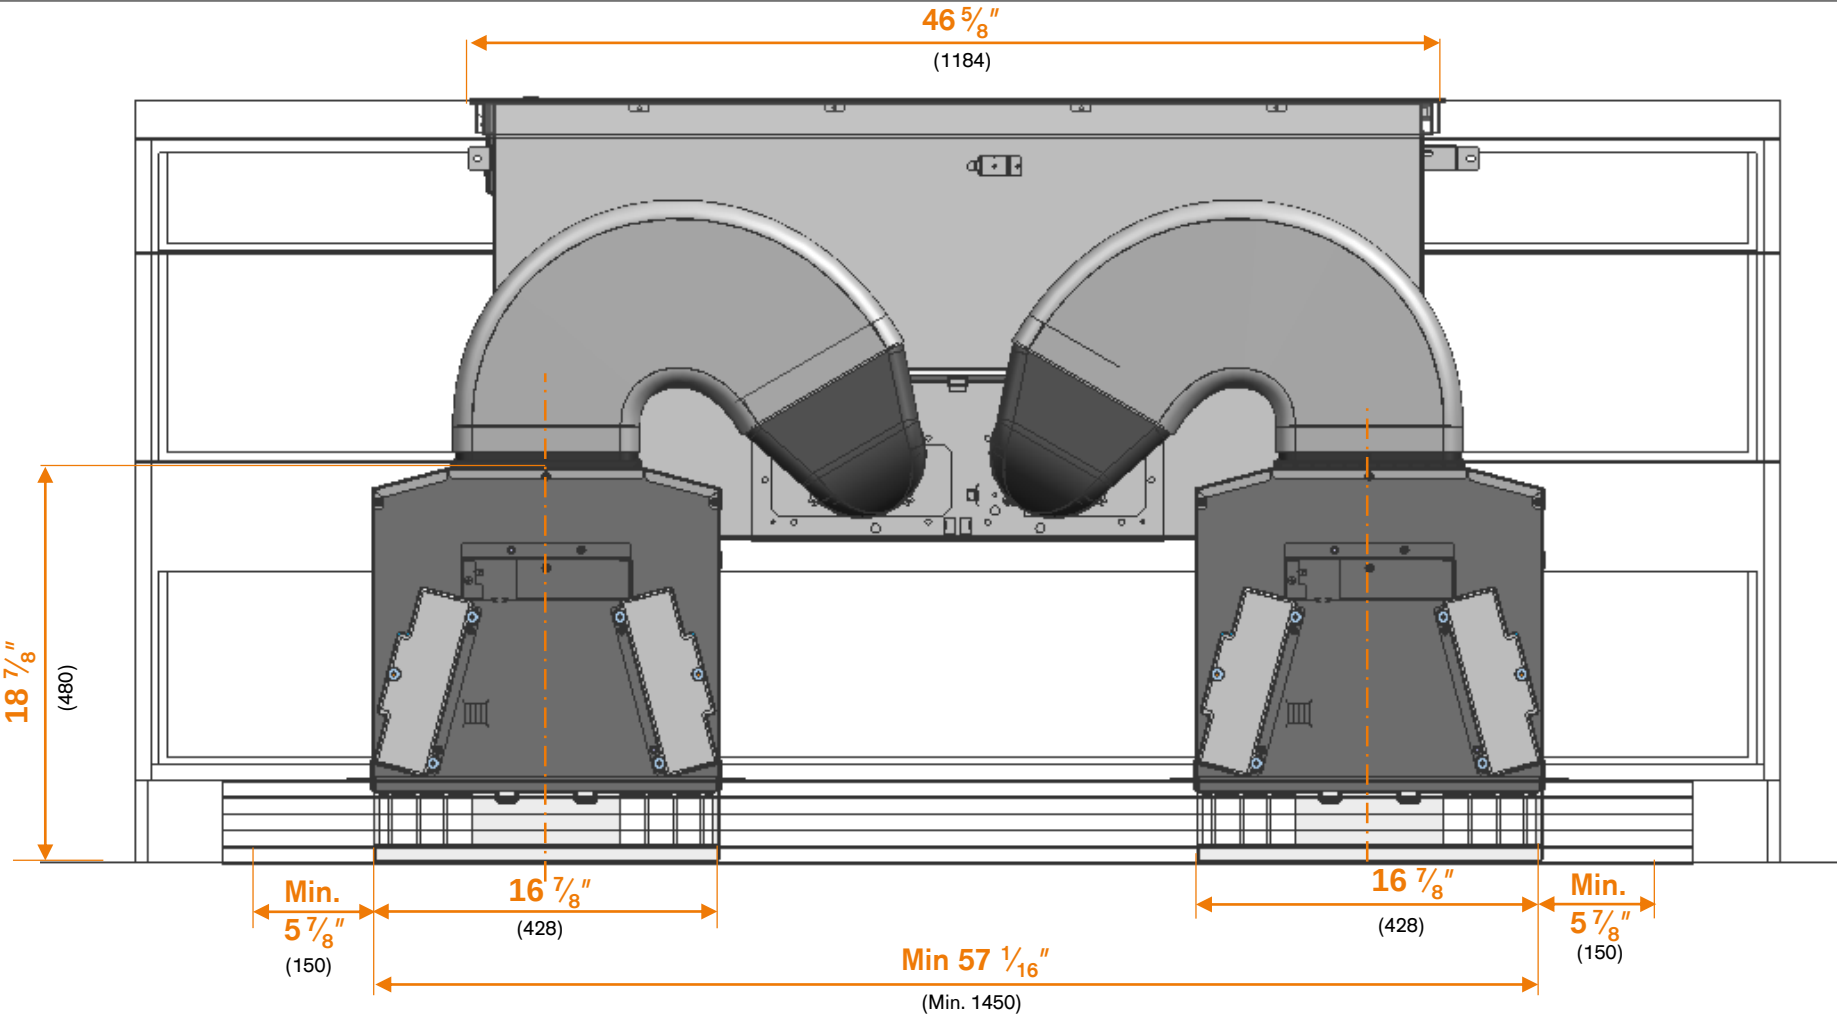

* : For flush mounted

** : Cutout dimensions for blowers




BSH Hausgeräte GmbH, Carl-Wery-Strasse 34, 81739 Munich, Germany
Chairman of the Supervisory Board: Prof. Dr. Stefan Asenkerschbaumer
Directors: Uwe Raschke (Chairman), Dr. Gerhard Dambach, Matthias Ginthum, Dr. Silke Maurer
Registered Office: Munich; Registry Court: Amtsgericht München, HRB 75534 , WEEE-Reg.-No. DE 57986696

The drawing is provided only as an example.
Please pay attention to the technical installation drawings in the Gaggenau Models and Dimensions. The technical drawings are not based on customer data and are merely for installation recommendation. The exact installation must be verified by the kitchen studio on an individual customer basis.

1 March 2022

Configuration	AL 400 722 + AR 410 710	Min. Work depth	35 7/16"	Ventilation mode	Air recirculation
Type reference cooktops	CX 482 611 –VP 414 711	Type reference ventilation appliance	AL 400 722	Type reference remote fan unit	AR 410 710

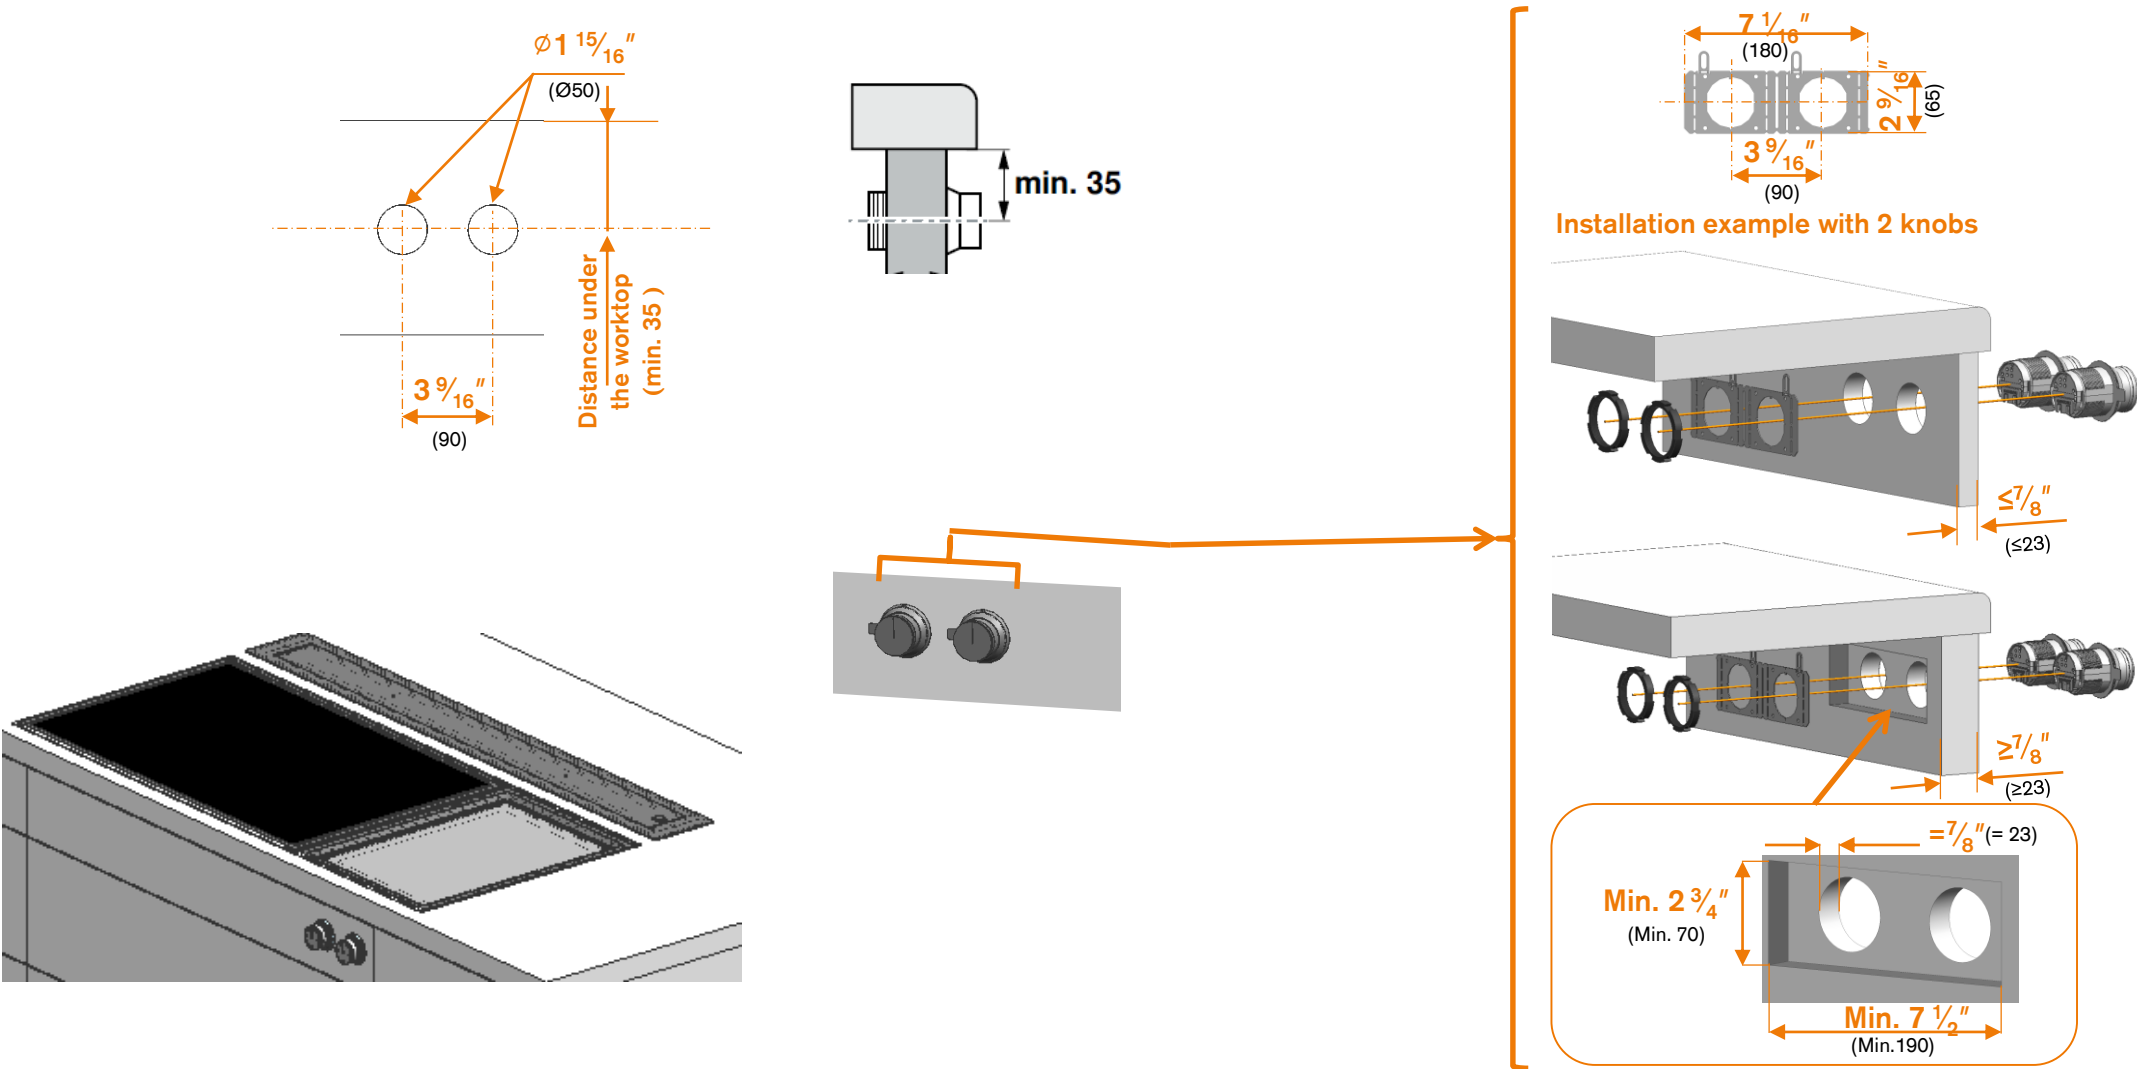


BSH Hausgeräte GmbH, Carl-Wery-Strasse 34, 81739 Munich, Germany
Chairman of the Supervisory Board: Uwe Raschke
Directors: Dr. Karsten Ottenberg (Chairman), Matthias Ginthum, Johannes Närger, Dr. Michael Schöllhorn
Registered Office: Munich; Registry Court: Amtsgericht München, HRB 75534, WEEE-Reg.-No. DE 57986696

The drawing is provided only as an example.
Please pay attention to the technical installation drawings in the Gaggenau Models and Dimensions. The technical drawings are not based on customer data and are merely for installation recommendation. The exact installation must be verified by the kitchen studio on an individual customer basis.

1 March 2022

Configuration	AL 400 722 + AR 410 710	Min. Work depth	35 7⁄16"	Ventilation mode	Air recirculation
Type reference cooktops	CX 482 611 –VP 414 711	Type reference ventilation appliance	AL 400 722	Type reference remote fan unit	AR 410 710

Information about remote fan unit AR 400 710

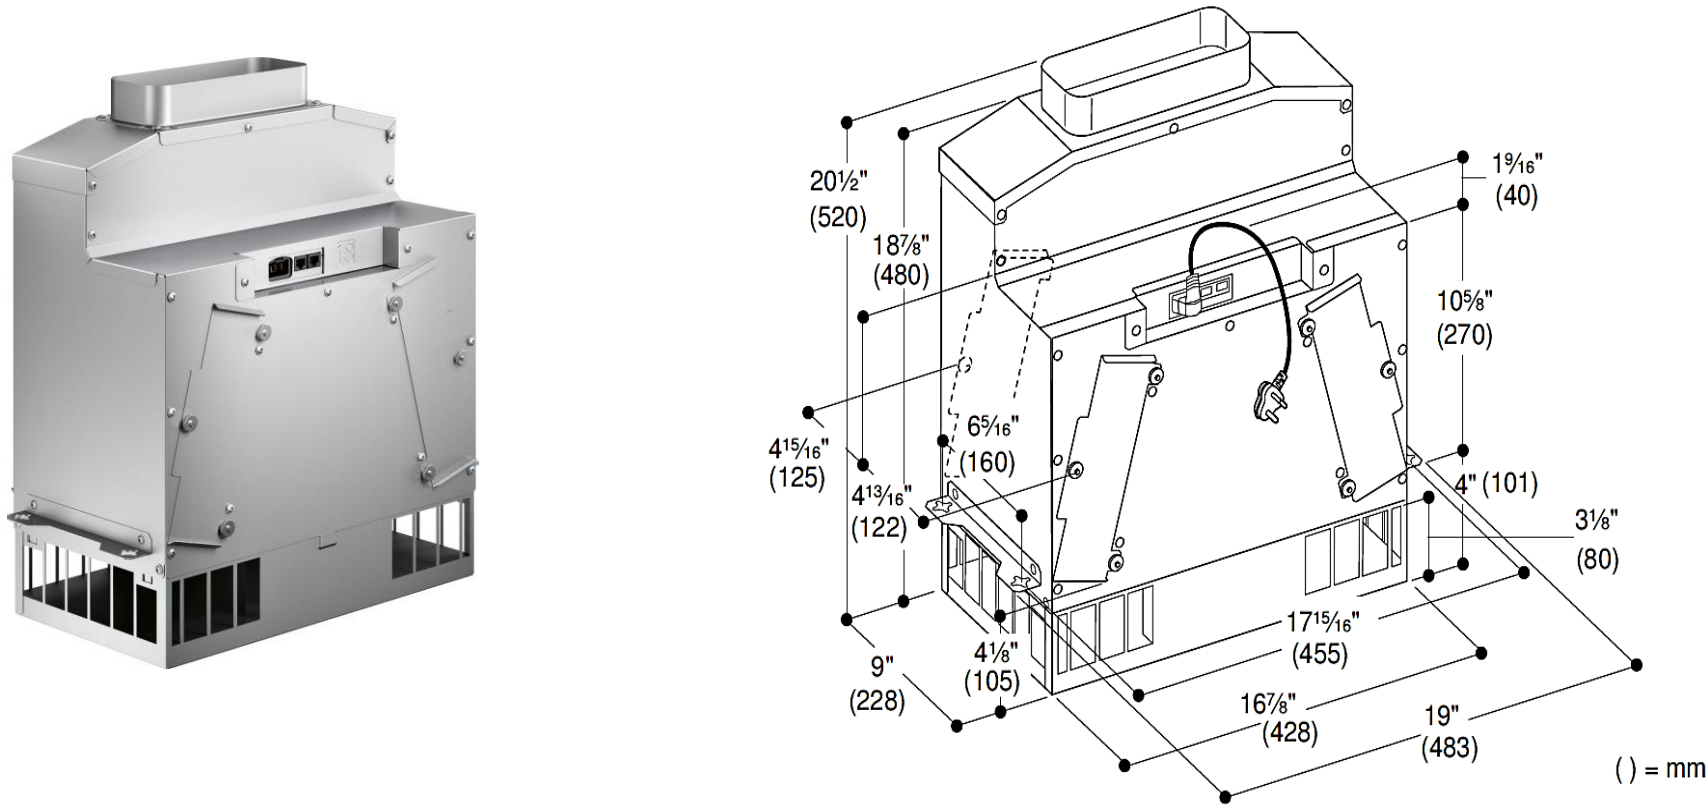

BSH Hausgeräte GmbH, Carl-Wery-Strasse 34, 81739 Munich, Germany
Chairman of the Supervisory Board: Prof. Dr. Stefan Asenkerschbaumer
Directors: Uwe Raschke (Chairman), Dr. Gerhard Dambach, Matthias Ginthum, Dr. Silke Maurer
Registered Office: Munich; Registry Court: Amtsgericht München, HRB 75534 , WEEE-Reg.-No. DE 57986696

The drawing is provided only as an example.
Please pay attention to the technical installation drawings in the Gaggenau Models and Dimensions. The technical drawings are not based on customer data and are merely for installation recommendation. The exact installation must be verified by the kitchen studio on an individual customer basis.




1 March 2022

Configuration	AL 400 722 + AR 410 710	Min. Work depth	35 ⁷ / ₁₆ "	Ventilation mode	Air recirculation
Type reference cooktops	CX 482 611 –VP 414 711	Type reference ventilation appliance	AL 400 722	Type reference remote fan unit	AR 410 710

Information about installation

The filters come preinstalled in the appliance and can only be taken out from one side. If required by the installation situation, you can fit the filters on the opposite side so that they are still accessible following installation.


- 1- Loosen the screws on the filter covers on both sides (A). Remove the filter covers (B).
- 2- Carefully remove the filters with both hands (C).
- 3- Insert the filter on the opposite side. Secure each one using three straight-knurled nuts.
- 4- Use three straight-knurled nuts to secure each filter cover to the filter openings that are not in use.

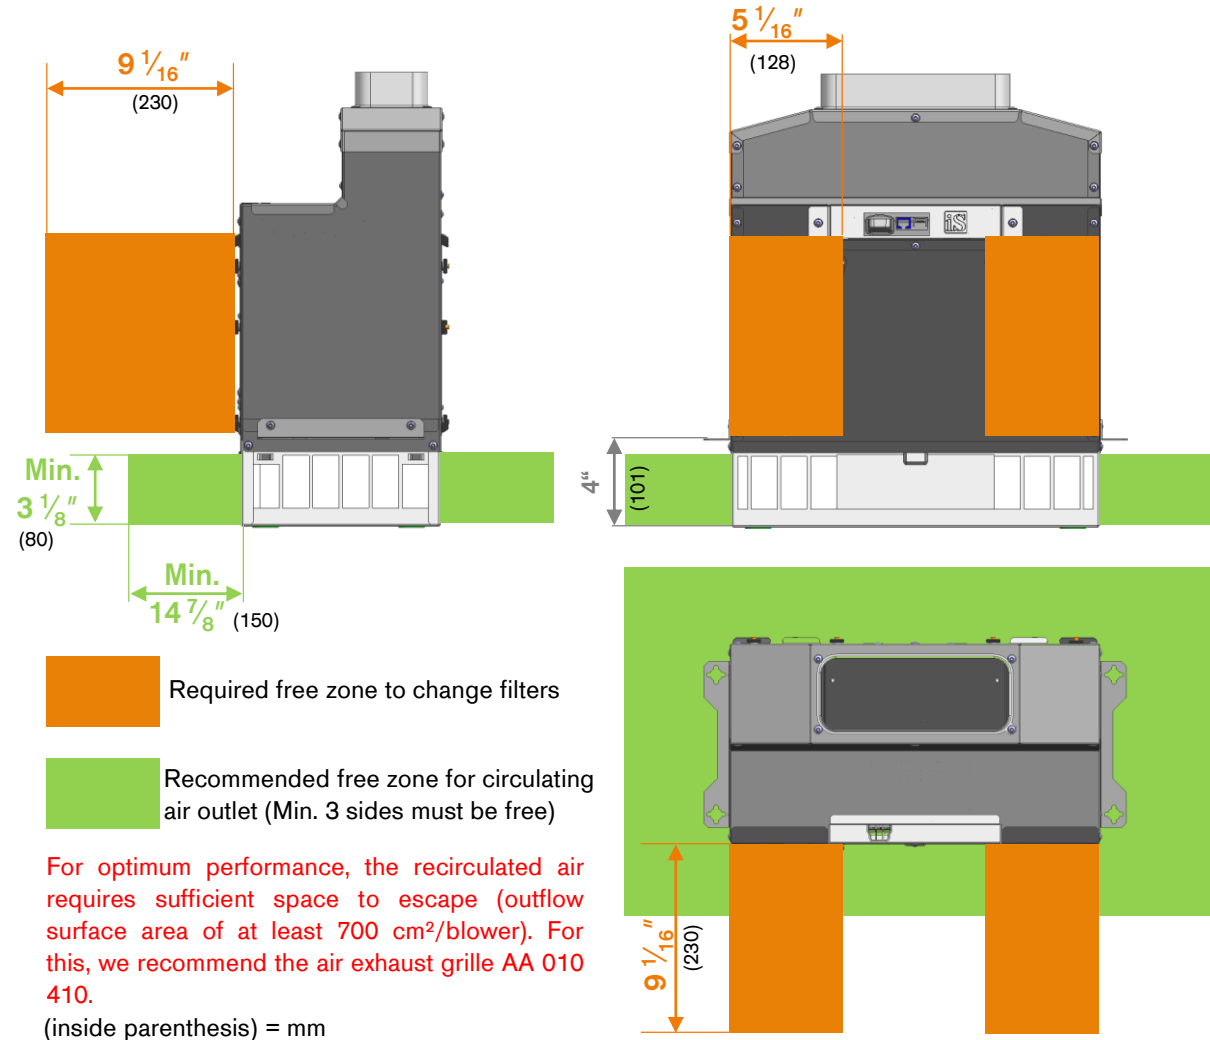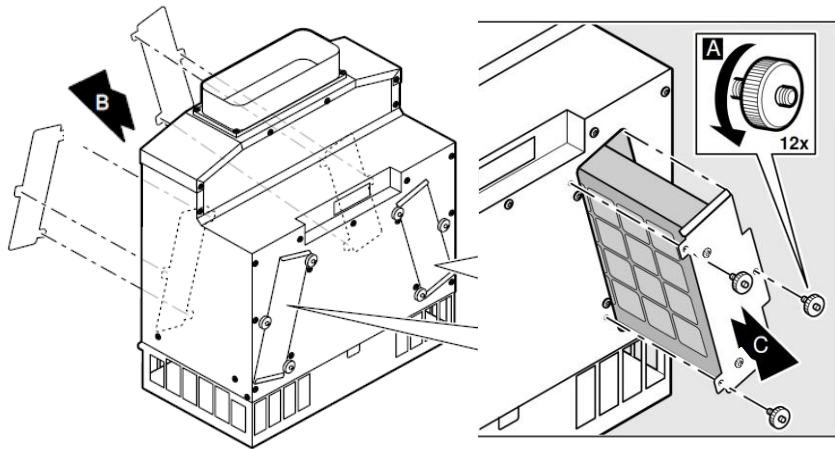




1 March 2022

Configuration	AL 400 722 + AR 410 710	Min. Work depth	35 $\frac{7}{16}$ "	Ventilation mode	Air recirculation
Type reference cooktops	CX 482 611 –VP 414 711	Type reference ventilation appliance	AL 400 722	Type reference remote fan unit	AR 410 710

Information about installation

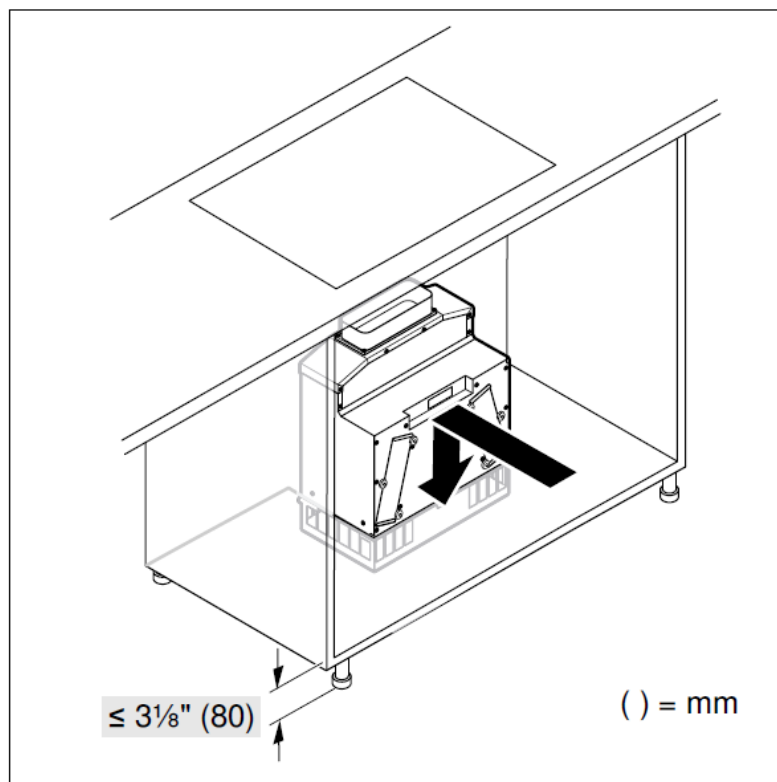

(inside parenthesis) = mm

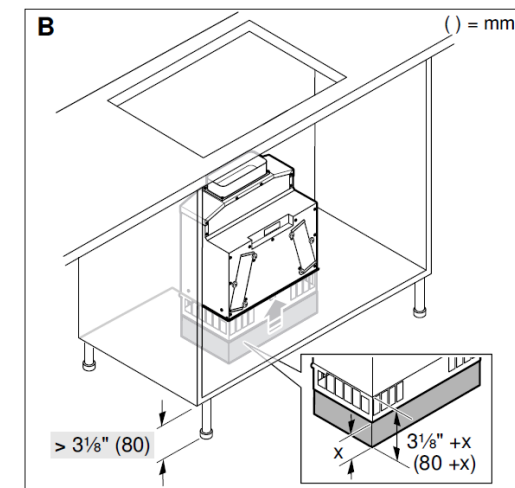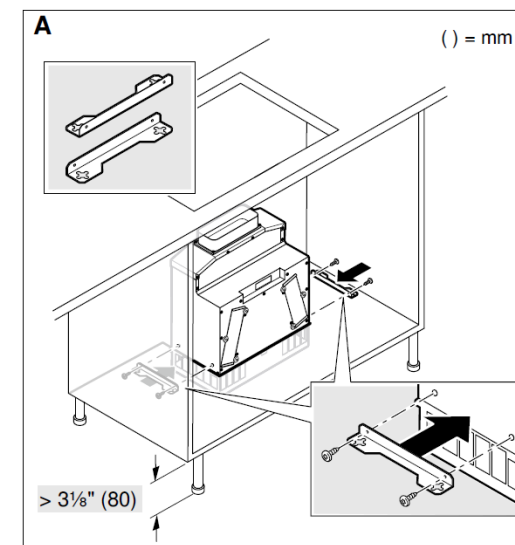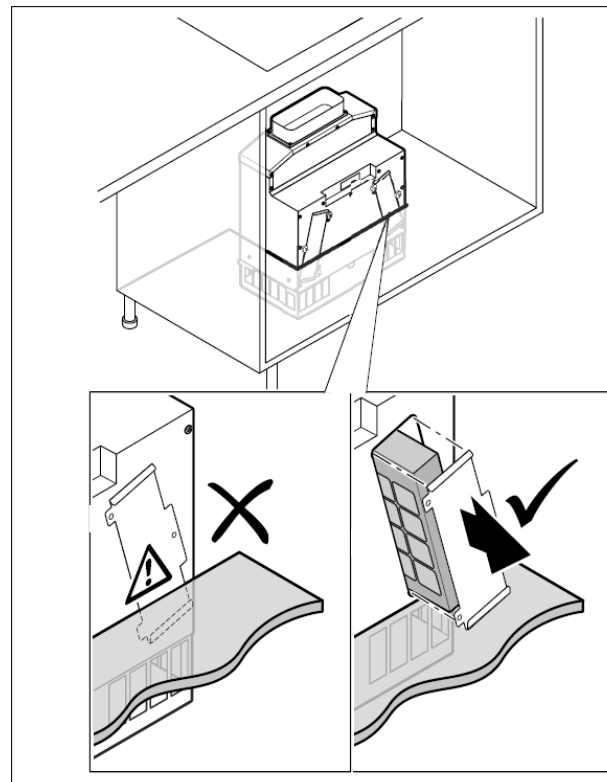


The drawing is provided only as an example. Please pay attention to the technical installation drawings in the Gaggenau Models and Dimensions. The technical drawings are not based on customer data and are merely for installation recommendation. The exact installation must be verified by the kitchen studio on an individual customer basis.

1 March 2022

Configuration	AL 400 722 + AR 410 710	Min. Work depth	35 7/16"	Ventilation mode	Air recirculation
Type reference cooktops	CX 482 611 –VP 414 711	Type reference ventilation appliance	AL 400 722	Type reference remote fan unit	AR 410 710

Mounting information

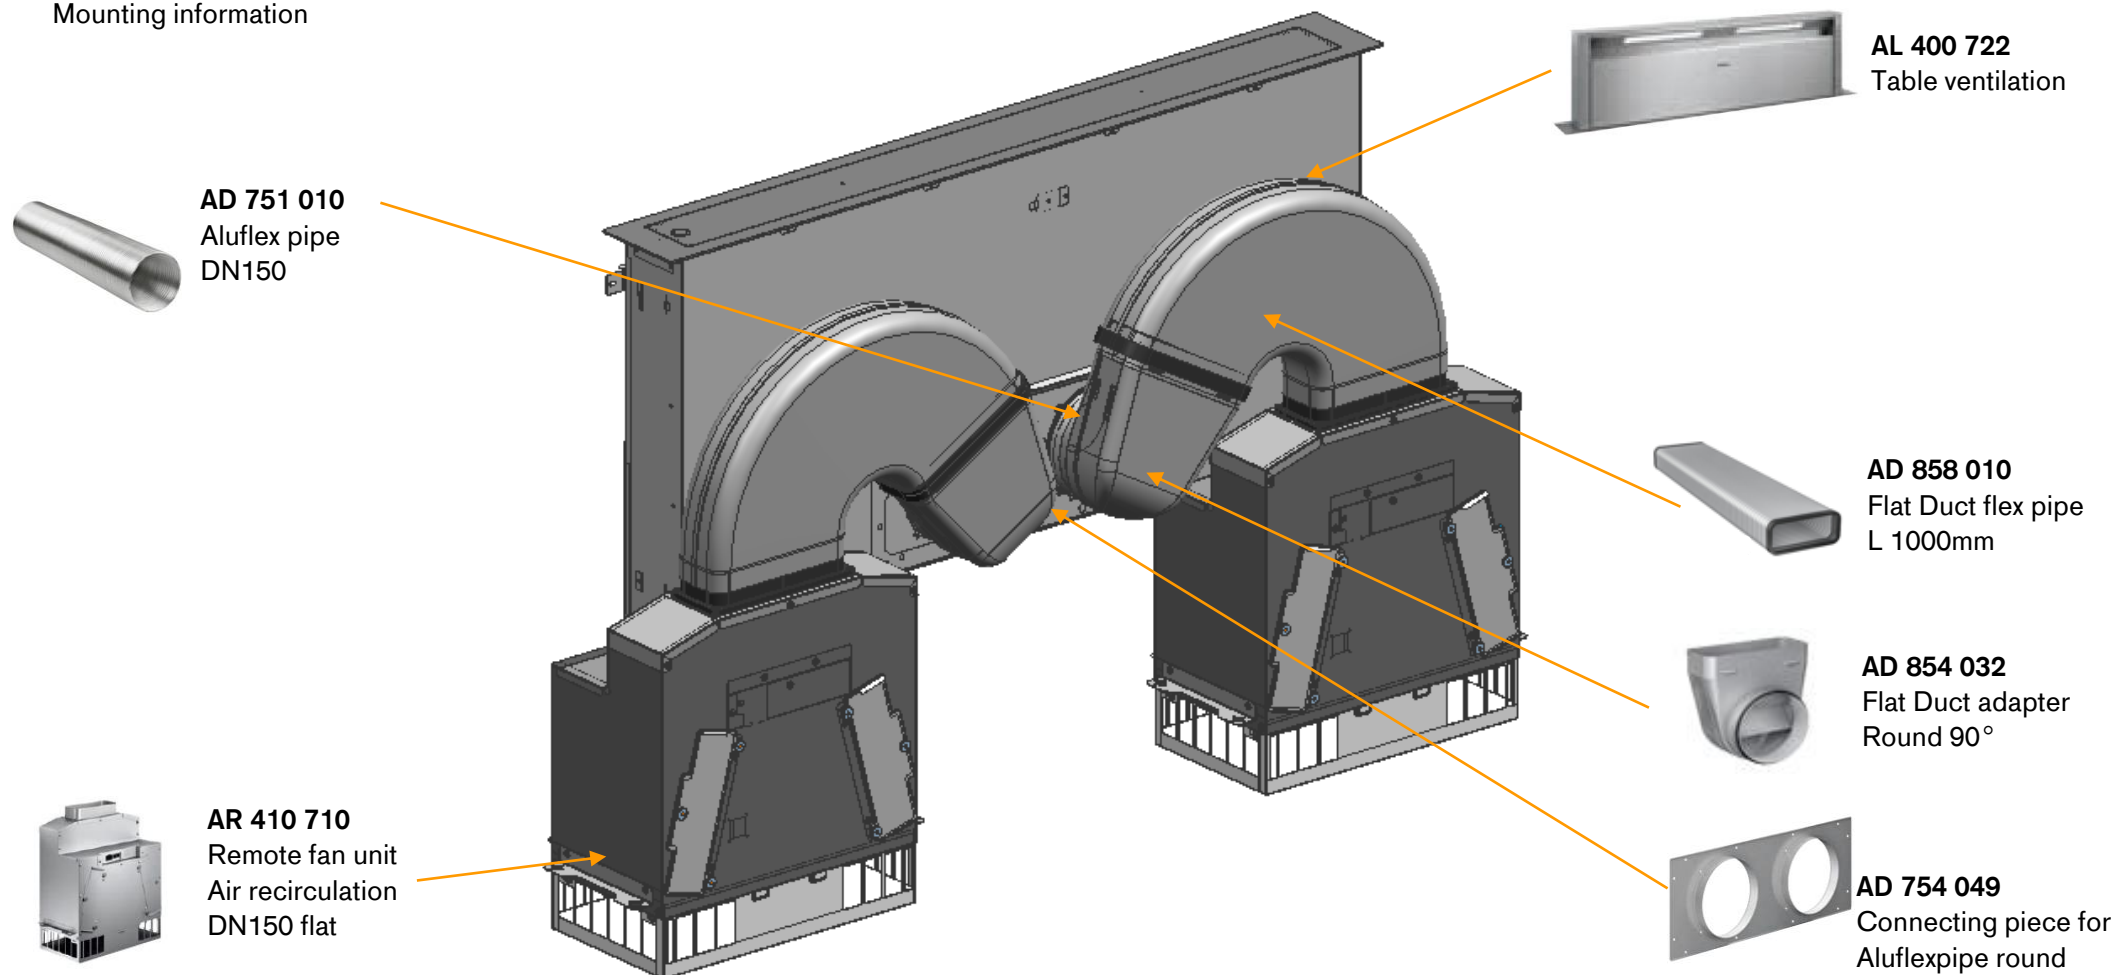


BSH Hausgeräte GmbH, Carl-Wery-Strasse 34, 81739 Munich, Germany
Chairman of the Supervisory Board: Prof. Dr. Stefan Asenkerschbaumer
Directors: Uwe Raschke (Chairman), Dr. Gerhard Dambach, Matthias Ginthum, Dr. Silke Maurer
Registered Office: Munich; Registry Court: Amtsgericht München, HRB 75534 , WEEE-Reg.-No. DE 57986696

The drawing is provided only as an example.
Please pay attention to the technical installation drawings in the Gaggenau Models and Dimensions. The technical drawings are not based on customer data and are merely for installation recommendation. The exact installation must be verified by the kitchen studio on an individual customer basis.

1 March 2022

Configuration	AL 400 722 + AR 410 710	Min. Work depth	35 7⁄16"	Ventilation mode	Air recirculation
Type reference cooktops	CX 482 611 –VP 414 711	Type reference ventilation appliance	AL 400 722	Type reference remote fan unit	AR 410 710


Mounting information

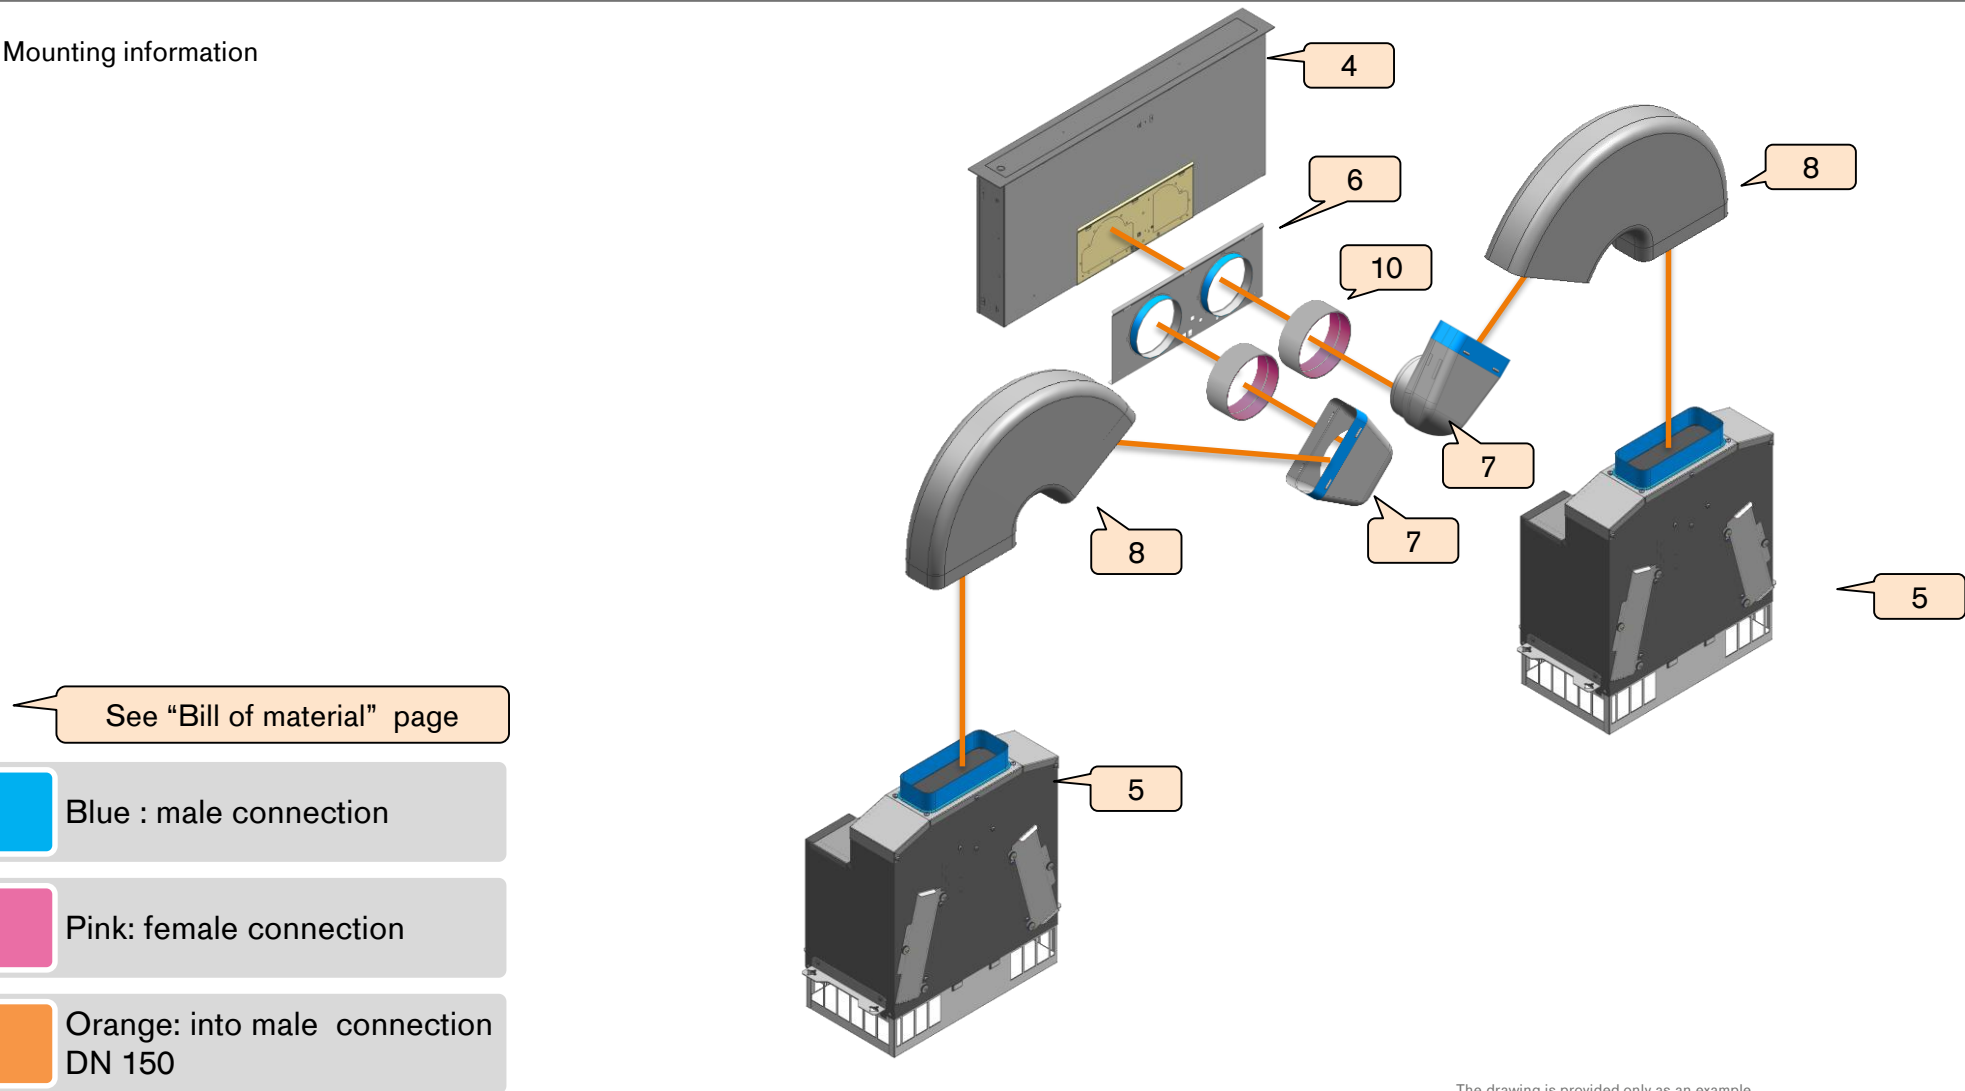

1 March 2022

Configuration	AL 400 722 + AR 410 710	Min. Work depth	35 $\frac{7}{16}$ "	Ventilation mode	Air recirculation
Type reference cooktops	CX 482 611 –VP 414 711	Type reference ventilation appliance	AL 400 722	Type reference remote fan unit	AR 410 710

Bill of material

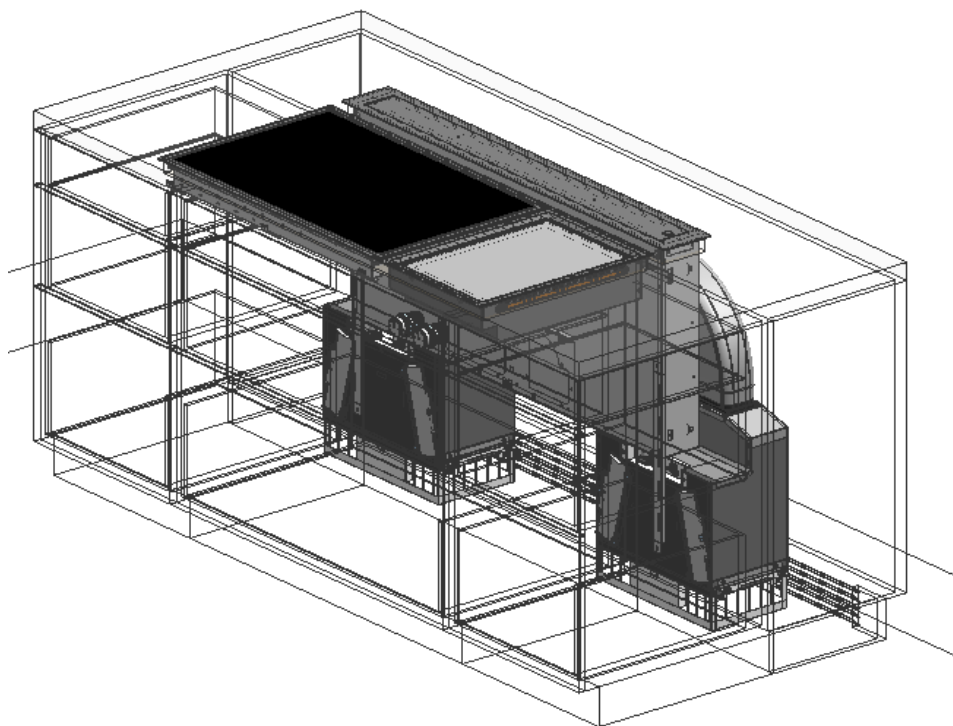

Position	Quantity	Part number	Appliance Design / Accessories Design
1	1	CX 482 611	Vario 400 series full surface induction cooktop
2	1	VP 414 711	Vario Teppan Yaki 400 series
3	1	AA 409 431	Furniture support 47 $\frac{7}{16}$ " for 46 $\frac{5}{8}$ " AL 400 downdraft.
4	1	AL 400 722	Table ventilation
5	2	AR 410 710	Remote fan unit Air recirculation DN150 flat
6	1	AD 754 049	Connecting piece for Aluflexpipe round
7	2	AD 854 032	Flat Duct adapter Round 90°
8	2	AD 858 010	Flat Duct flex pipe L 1000mm
9	1	VA 420 200	Connection strip flush mounting
	1	VA 420 210	Connection strip surface mounting
10	2	AD 751 010	Aluflex pipe DN150
11	2	AA 010 410	Air exhaust grille
12	1	AD 990 091	Adhesive tape for duct components Aluminium

Please check the availability of the products in your country.