


9 March 2023

Configuration	AL400792+AR413722	Min. Work depth	37 5/8" (956mm)	Ventilation mode	Air recirculation
Type reference cooktops	CX 492 611	Type reference ventilation appliance	AL 400 792	Type reference remote fan unit	AR 413 722


Installation view

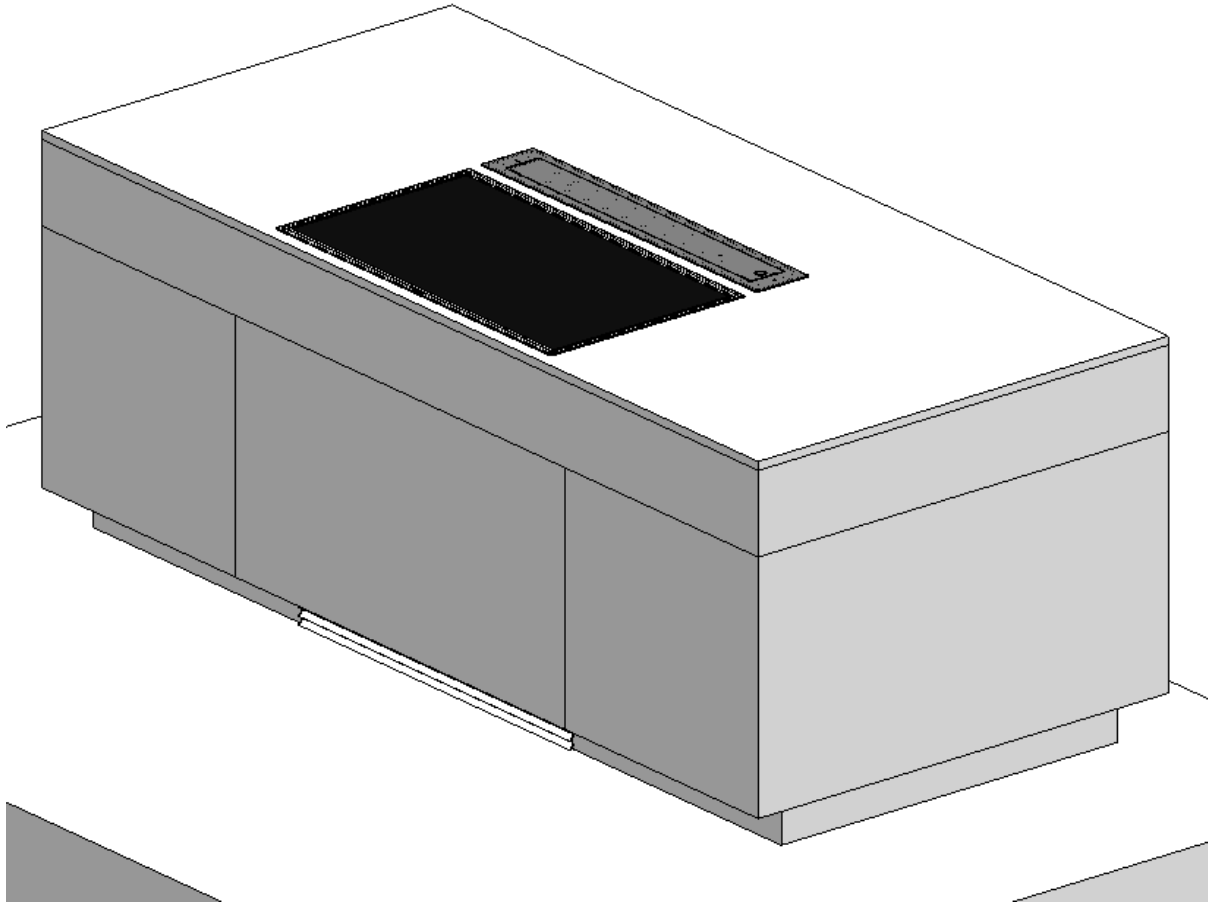

9 March 2023


Configuration	AL400792+AR413722	Min. Work depth	37 5/8" (956mm)	Ventilation mode	Air recirculation
Type reference cooktops	CX 492 611	Type reference ventilation appliance	AL 400 792	Type reference remote fan unit	AR 413 722

Installation view

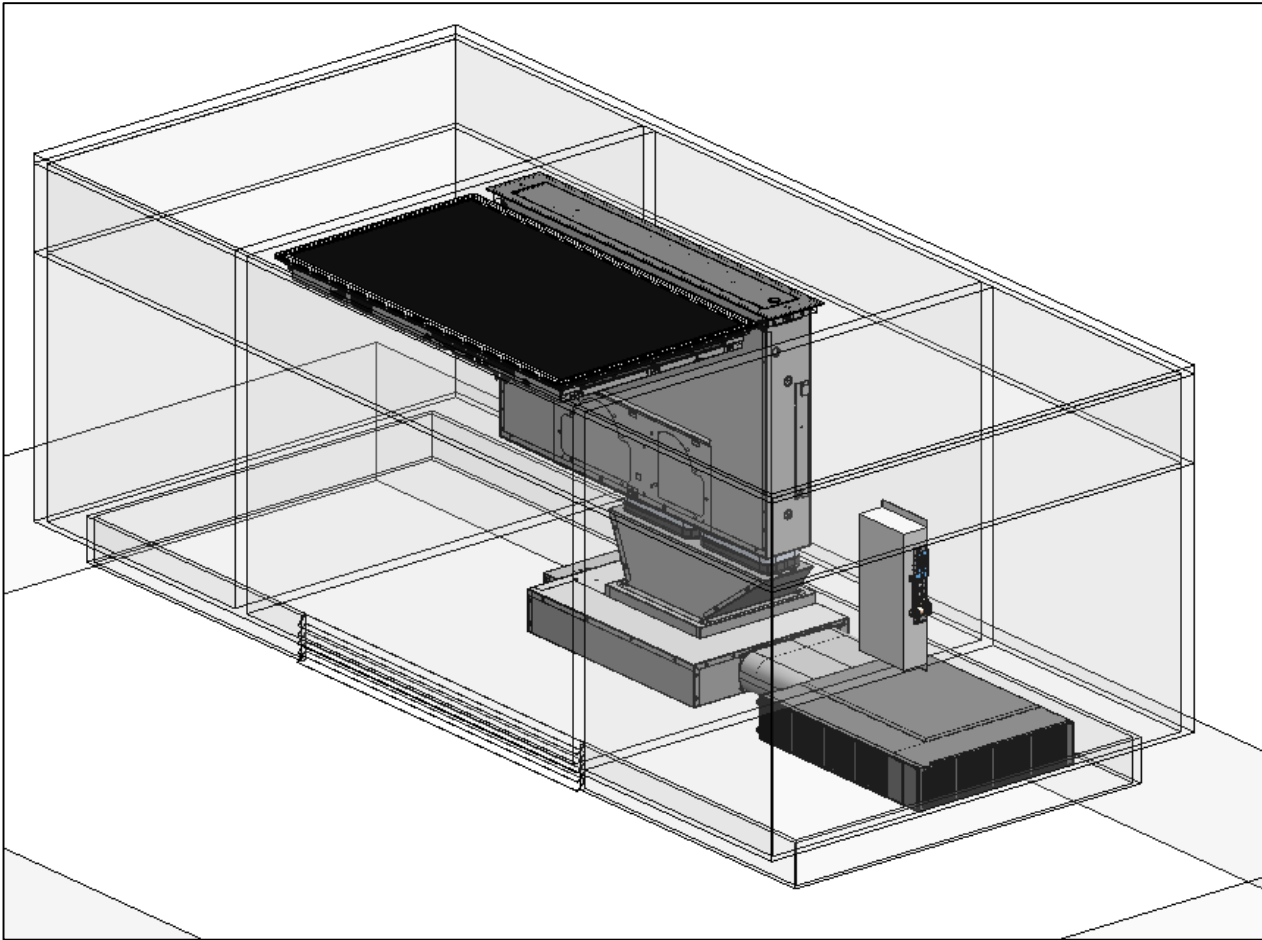


Configuration	AL400792+AR413722	Min. Work depth	37 5⁄8" (956mm)	Ventilation mode	Air recirculation
Type reference cooktops	CX 492 611	Type reference ventilation appliance	AL 400 792	Type reference remote fan unit	AR 413 722

Top view

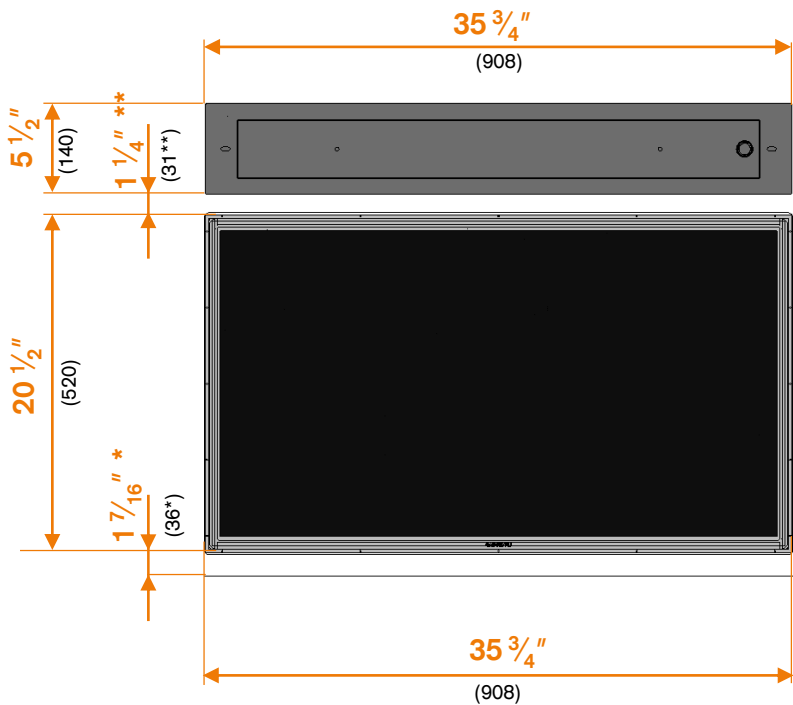

Cut out dimension. Flush mounting

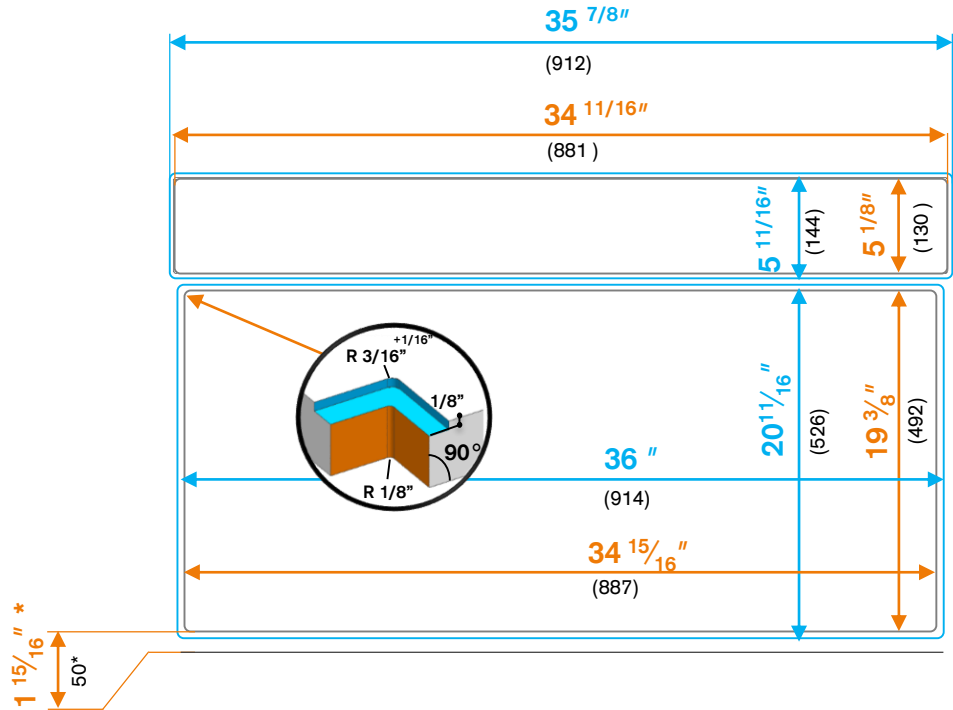

*: Minimum distance. Distance can be adjusted

**: Recommended distance.

(inside parenthesis) = mm



GAGGENAU

BSH Hausgeräte GmbH, Carl-Wery-Straße 34, 81739 Munich, Germany
Chairman of the Supervisory : Prof. Dr. Stefan Asenkerschbaumer
Directors : Dr. Gerhard Dambach (Chairman), Matthias Ginthum, Lars Schubert
Registered Office : Munich; Registry Court : Amtsgericht München, HRB 75534 WEEE-Reg.-Nr. DE 57986696

The drawing is provided only as an example.
Please pay attention to the technical installation drawings in the Gaggenau Models and Dimensions. The technical drawings are not based on customer data and are merely for installation recommendation. The exact installation must be verified by the kitchen studio on an individual customer basis.

Configuration	AL400792+AR413722	Min. Work depth	37 5/8" (956mm)	Ventilation mode	Air recirculation
Type reference cooktops	CX 492 611	Type reference ventilation appliance	AL 400 792	Type reference remote fan unit	AR 413 722

Top view

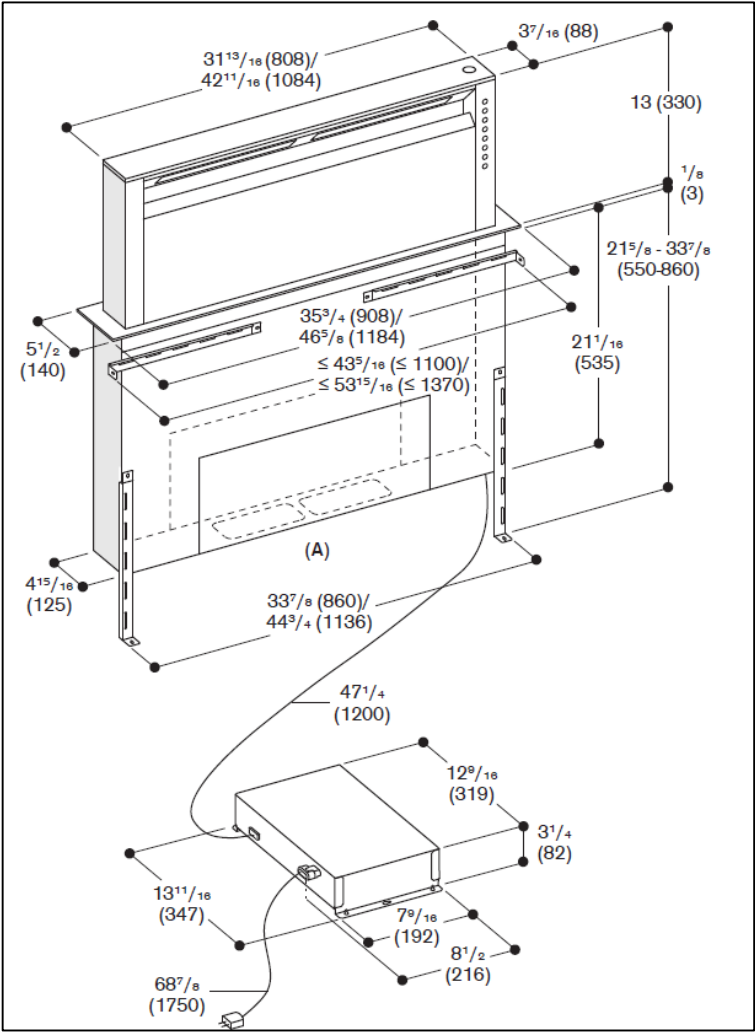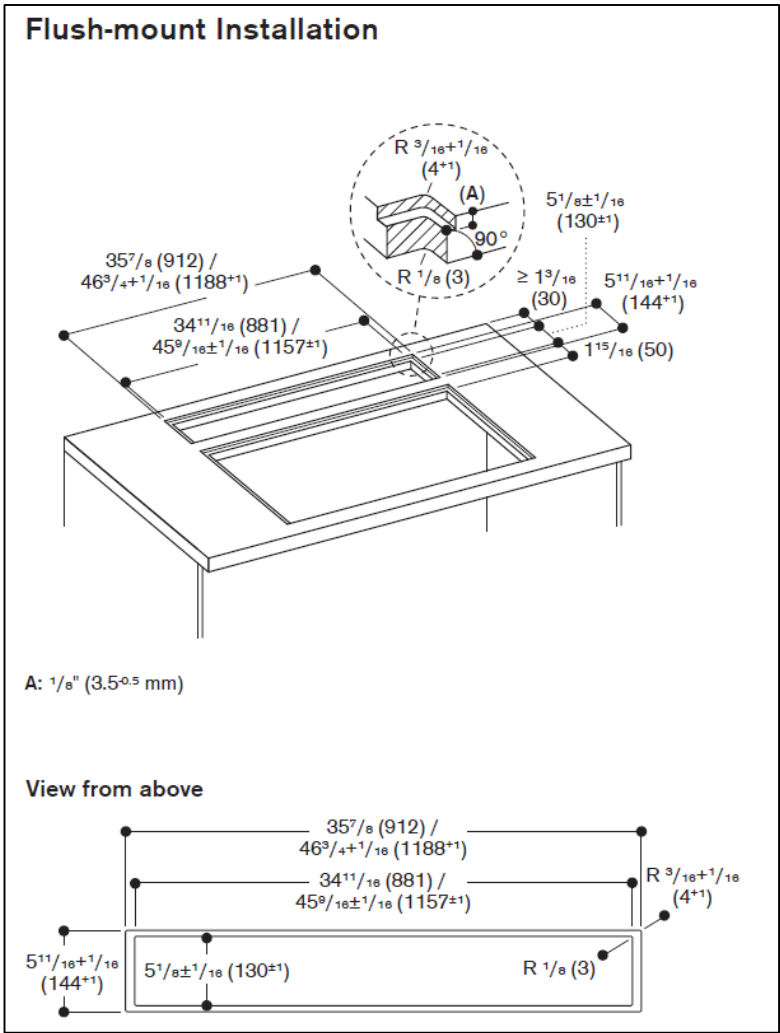

(inside parenthesis) = mm


GAGGENAU

BSH Hausgeräte GmbH, Carl-Wery-Straße 34, 81739 Munich, Germany
Chairman of the Supervisory: Prof. Dr. Stefan Asenkerschbaumer
Directors: Dr. Gerhard Dambach (Chairman), Matthias Ginthum, Lars Schubert
Registered Office: Munich; Registry Court: Amtsgericht München, HRB 75534 WEEE-Reg.-Nr. DE 57986696

The drawing is provided only as an example.
Please pay attention to the technical installation drawings in the Gaggenau Models and Dimensions. The technical drawings are not based on customer data and are merely for installation recommendation. The exact installation must be verified by the kitchen studio on an individual customer basis.

Configuration	AL400792+AR413722	Min. Work depth	37 5/8" (956mm)	Ventilation mode	Air recirculation
Type reference cooktops	CX 492 611	Type reference ventilation appliance	AL 400 792	Type reference remote fan unit	AR 413 722

Information about cooktop CX 492 611

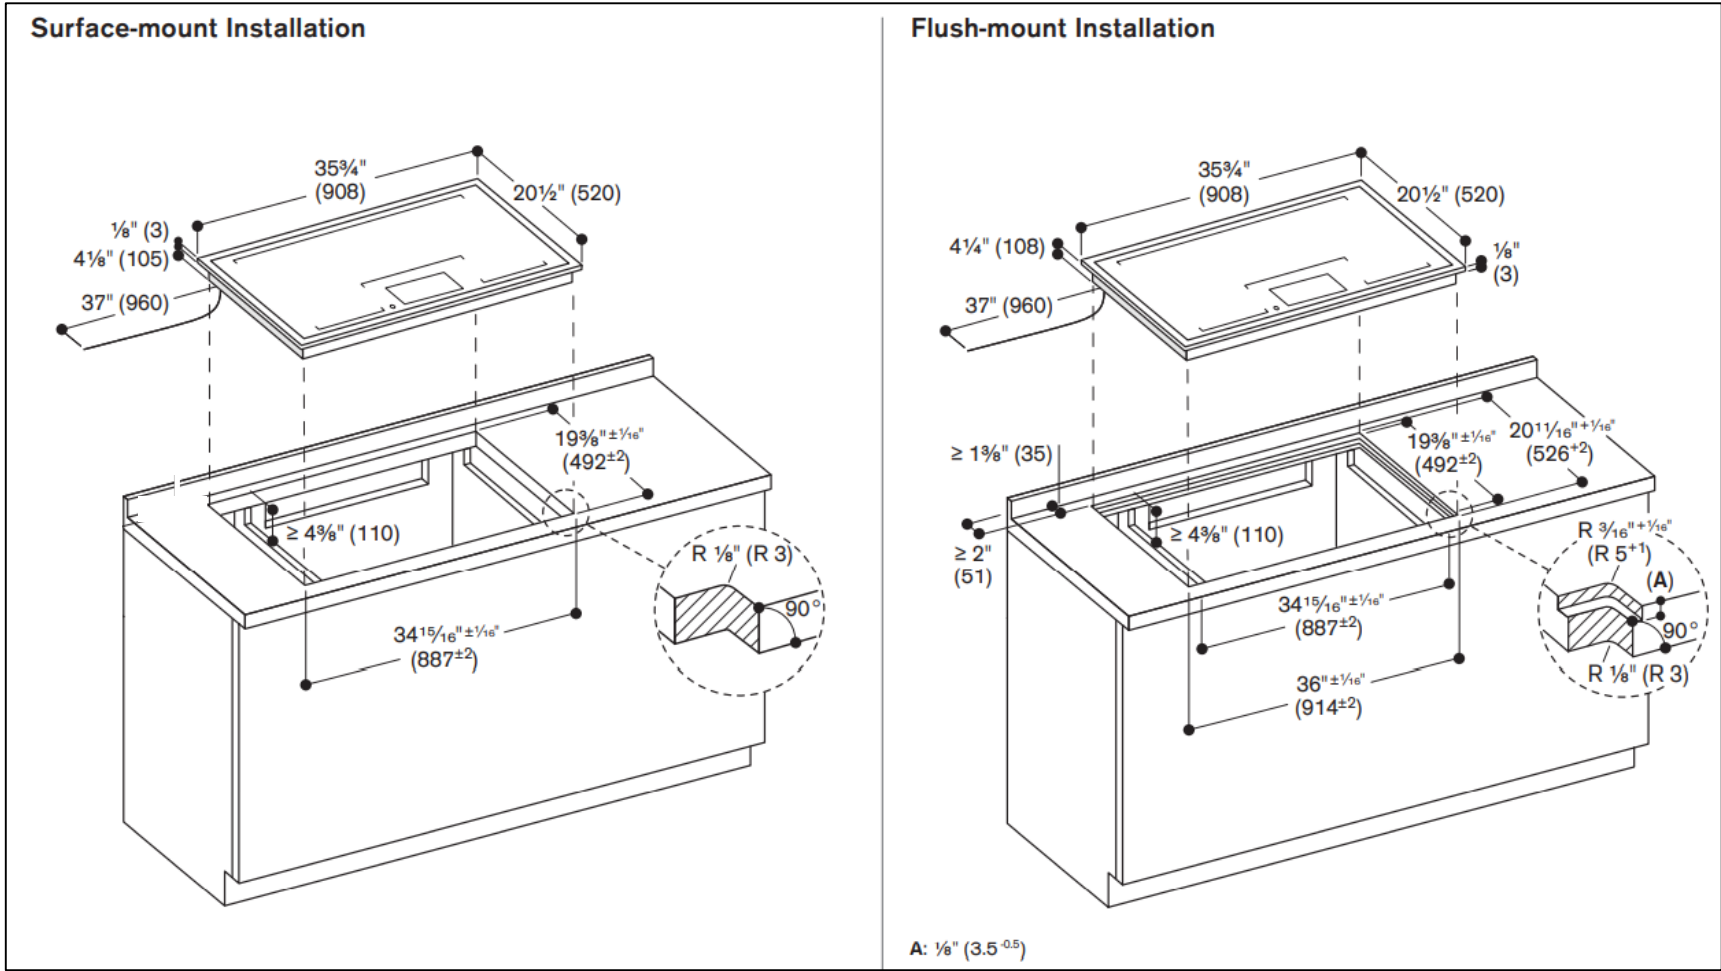

(inside parenthesis) = mm




BSH Hausgeräte GmbH, Carl-Wery-Straße 34, 81739 Munich, Germany
Chairman of the Supervisory: Prof. Dr. Stefan Asenkerschbaumer
Directors: Dr. Gerhard Dambach (Chairman), Matthias Ginthum, Lars Schubert
Registered Office: Munich; Registry Court: Amtsgericht München, HRB 75534 WEEE-Reg.-Nr. DE 57986696

The drawing is provided only as an example.
Please pay attention to the technical installation drawings in the Gaggenau Models and Dimensions. The technical drawings are not based on customer data and are merely for installation recommendation. The exact installation must be verified by the kitchen studio on an individual customer basis.

9 March 2023

Configuration	AL400792+AR413722	Min. Work depth	37 5/8" (956mm)	Ventilation mode	Air recirculation
Type reference cooktops	CX 492 611	Type reference ventilation appliance	AL 400 792	Type reference remote fan unit	AR 413 722

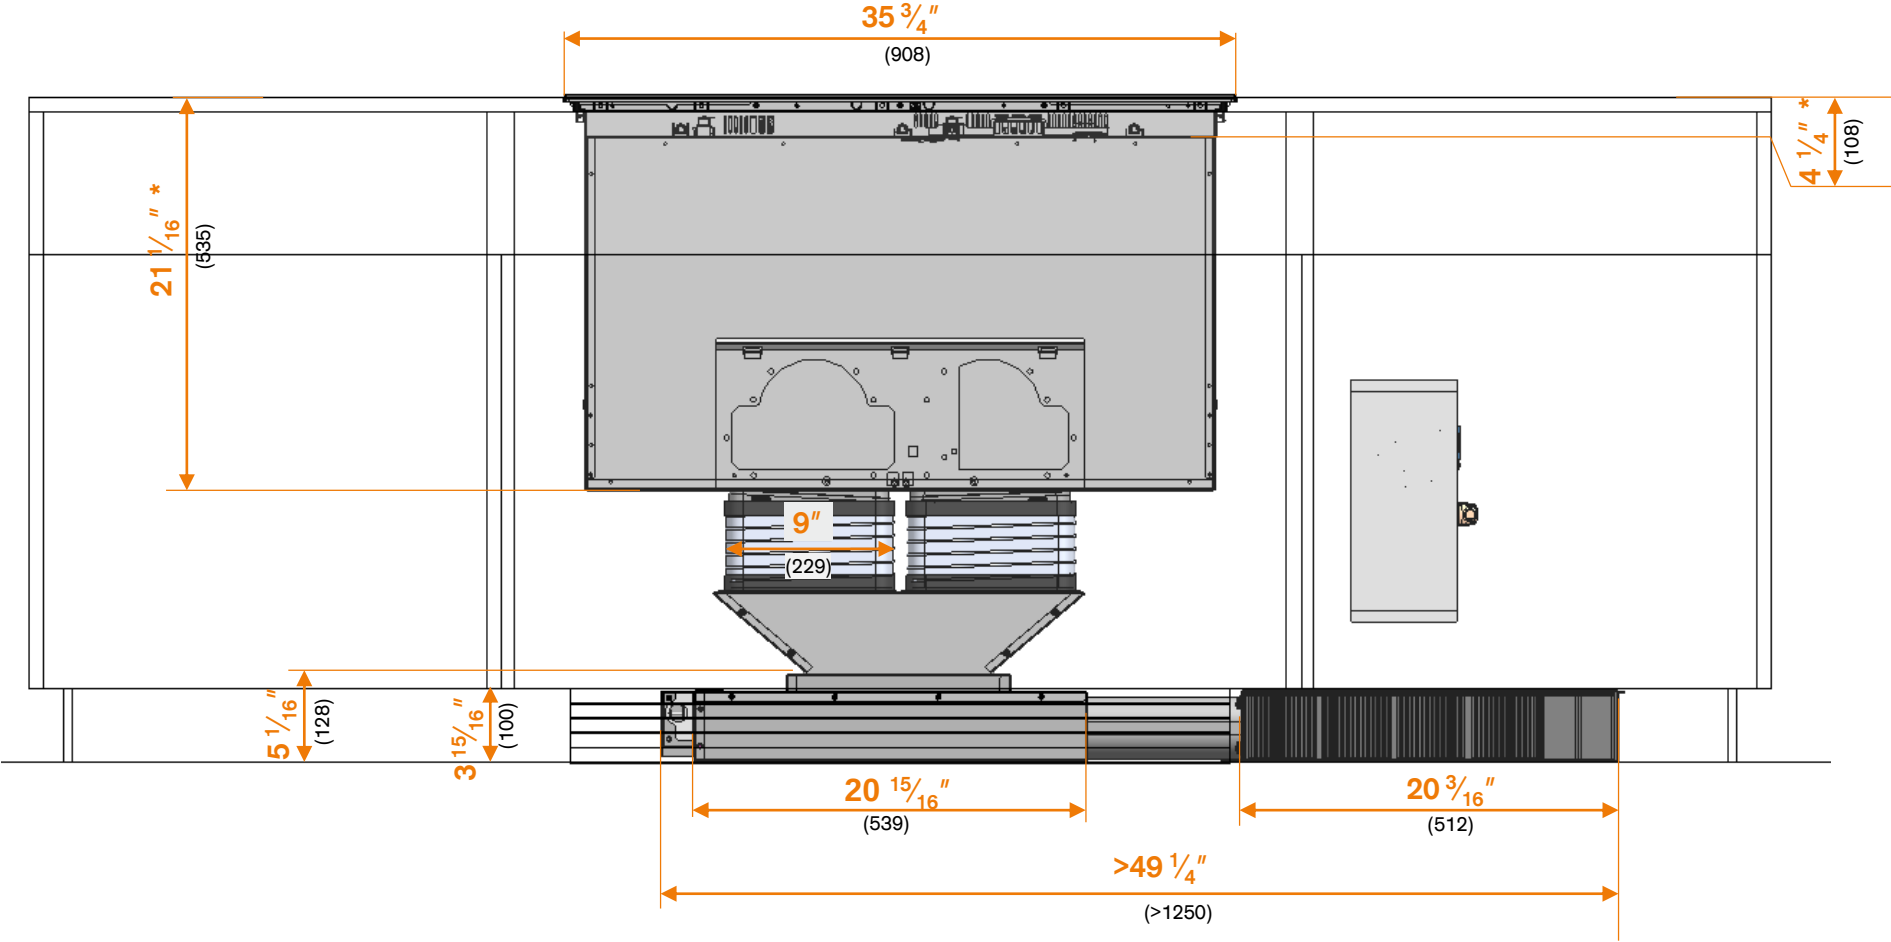

* : For flush mounted
(inside parenthesis) = mm


GAGGENAU

BSH Hausgeräte GmbH, Carl-Wery-Straße 34, 81739 Munich, Germany
Chairman of the Supervisory : Prof. Dr. Stefan Asenkerschbaumer
Directors : Dr. Gerhard Dambach (Chairman), Matthias Ginthum, Lars Schubert
Registered Office : Munich; Registry Court : Amtsgericht München, HRB 75534 WEEE-Reg.-Nr. DE 57986696

The drawing is provided only as an example.
Please pay attention to the technical installation drawings in the Gaggenau Models and Dimensions. The technical drawings are not based on customer data and are merely for installation recommendation. The exact installation must be verified by the kitchen studio on an individual customer basis.

9 March 2023

Configuration	AL400792+AR413722	Min. Work depth	37 5/8" (956mm)	Ventilation mode	Air recirculation
Type reference cooktops	CX 492 611	Type reference ventilation appliance	AL 400 792	Type reference remote fan unit	AR 413 722

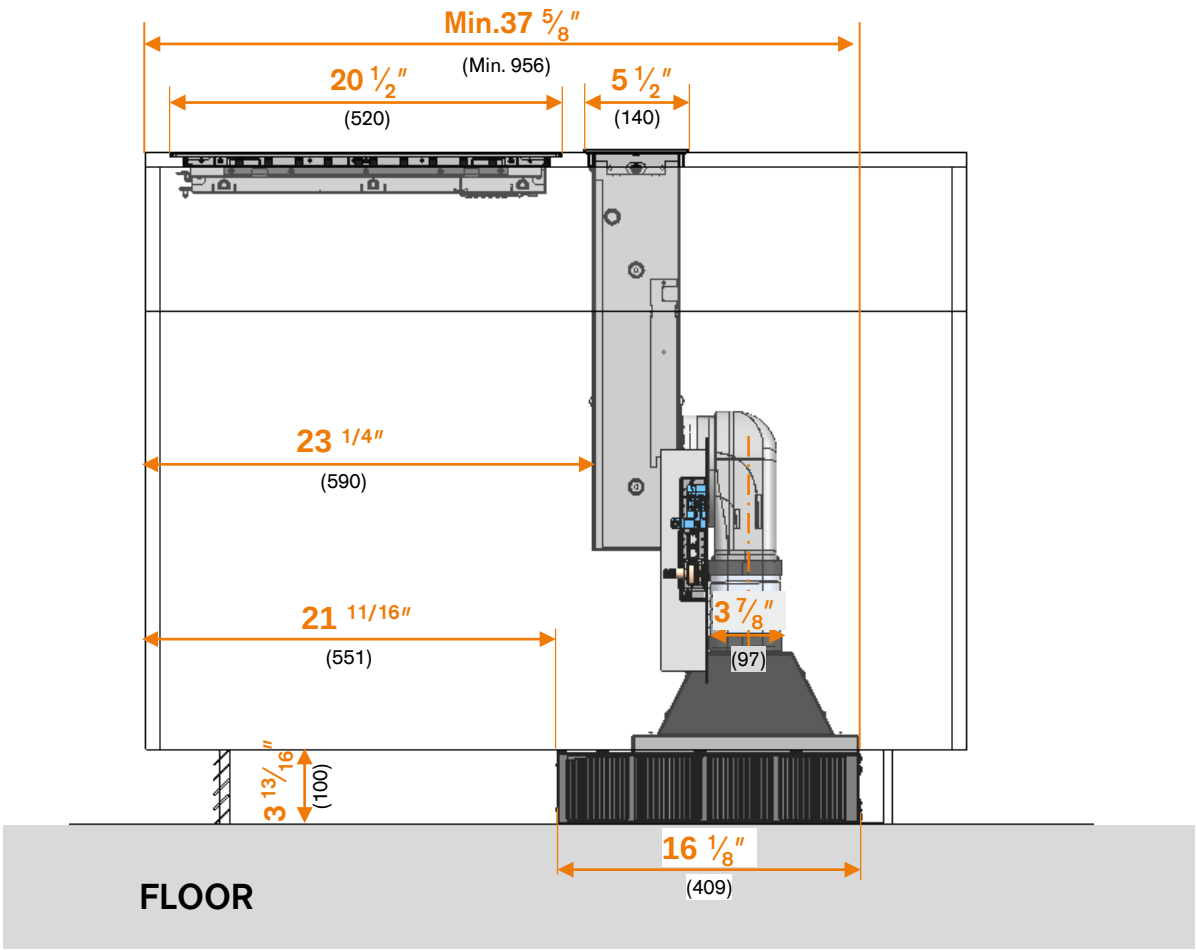

(inside parenthesis) = mm

GAGGENAU


BSH Hausgeräte GmbH, Carl-Wery-Straße 34, 81739 Munich, Germany
Chairman of the Supervisory : Prof. Dr. Stefan Asenkerschbaumer
Directors : Dr. Gerhard Dambach (Chairman), Matthias Ginthum, Lars Schubert
Registered Office : Munich; Registry Court : Amtsgericht München, HRB 75534 WEEE-Reg.-Nr. DE 57986696

The drawing is provided only as an example.
Please pay attention to the technical installation drawings in the Gaggenau Models and Dimensions. The technical drawings are not based on customer data and are merely for installation recommendation. The exact installation must be verified by the kitchen studio on an individual customer basis.

9 March 2023

Configuration	AL400792+AR413722	Min. Work depth	37 5/8" (956mm)	Ventilation mode	Air recirculation
Type reference cooktops	CX 492 611	Type reference ventilation appliance	AL 400 792	Type reference remote fan unit	AR 413 722


Information about remote fan unit AR 413 722

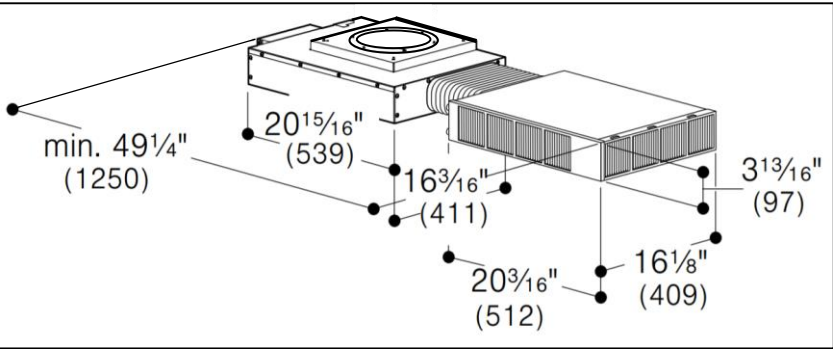

(inside parenthesis) = mm

GAGGENAU


BSH Hausgeräte GmbH, Carl-Wery-Straße 34, 81739 Munich, Germany
Chairman of the Supervisory: Prof. Dr. Stefan Asenkerschbaumer
Directors: Dr. Gerhard Dambach (Chairman), Matthias Ginthum, Lars Schubert
Registered Office: Munich; Registry Court: Amtsgericht München, HRB 75534 WEEE-Reg.-Nr. DE 57986696

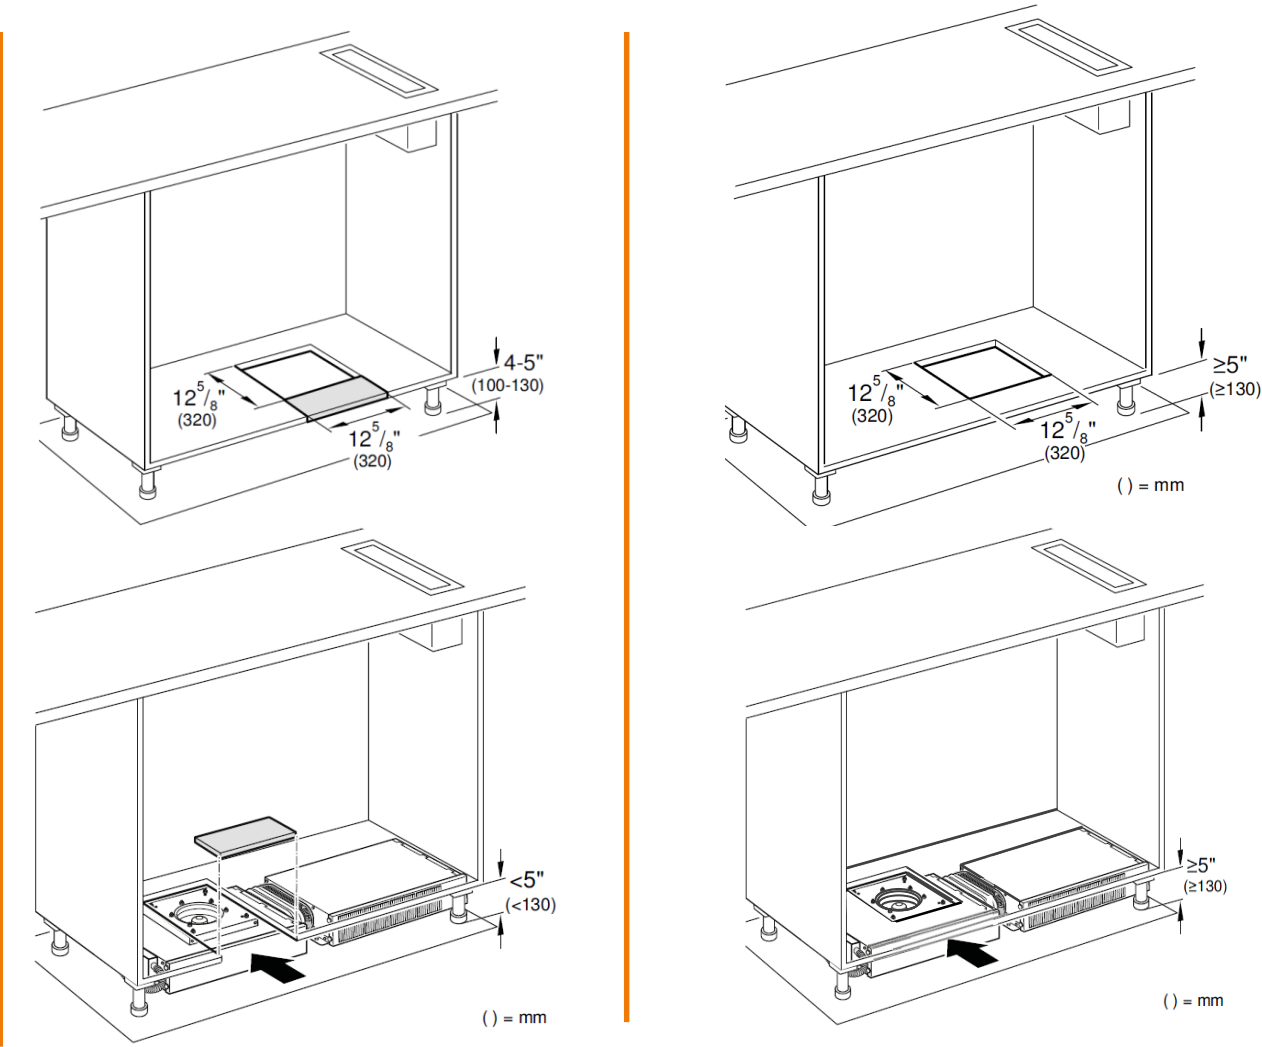


The drawing is provided only as an example.
Please pay attention to the technical installation drawings in the Gaggenau Models and Dimensions. The technical drawings are not based on customer data and are merely for installation recommendation. The exact installation must be verified by the kitchen studio on an individual customer basis.

Configuration	AL400792+AR413722	Min. Work depth	37 5/8" (956mm)	Ventilation mode	Air recirculation
Type reference cooktops	CX 492 611	Type reference ventilation appliance	AL 400 792	Type reference remote fan unit	AR 413 722

Information about remote fan unit AA 413 722

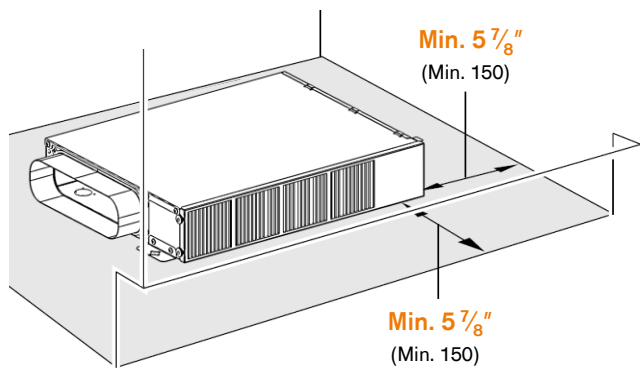


Min. distance for air outlet

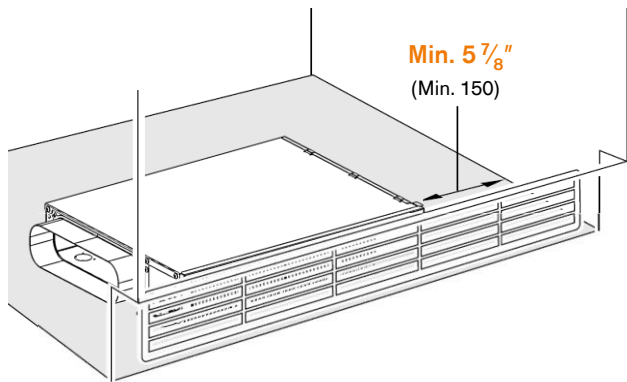

(inside parenthesis) = mm



BSH Hausgeräte GmbH, Carl-Wery-Straße 34, 81739 Munich, Germany
Chairman of the Supervisory : Prof. Dr. Stefan Asenkerschbaumer
Directors : Dr. Gerhard Dambach (Chairman), Matthias Ginthum, Lars Schubert
Registered Office : Munich; Registry Court : Amtsgericht München, HRB 75534 WEEE-Reg.-Nr. DE 57986696

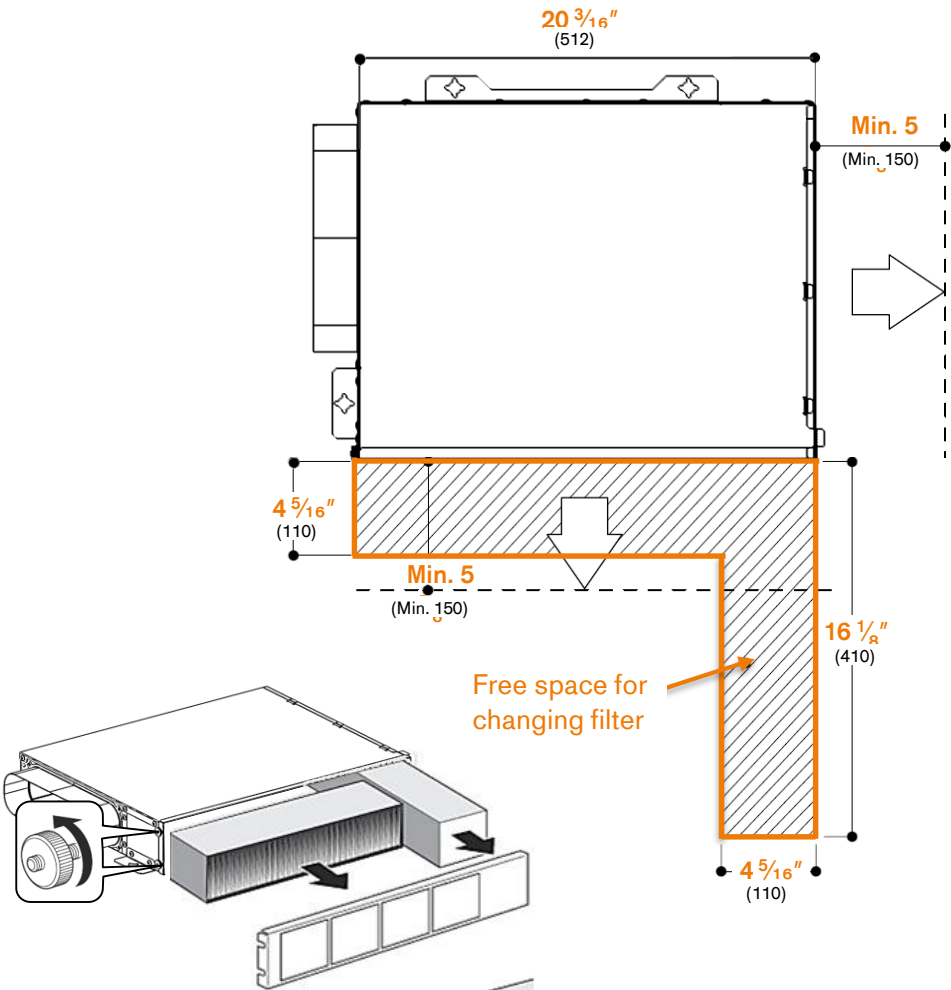


The drawing is provided only as an example.
Please pay attention to the technical installation drawings in the Gaggenau Models and Dimensions. The technical drawings are not based on customer data and are merely for installation recommendation. The exact installation must be verified by the kitchen studio on an individual customer basis.

9 March 2023

Configuration	AL400792+AR413722	Min. Work depth	37 5/8" (956mm)	Ventilation mode	Air recirculation
Type reference cooktops	CX 492 611	Type reference ventilation appliance	AL 400 792	Type reference remote fan unit	AR 413 722

Mounting information (view from rear)

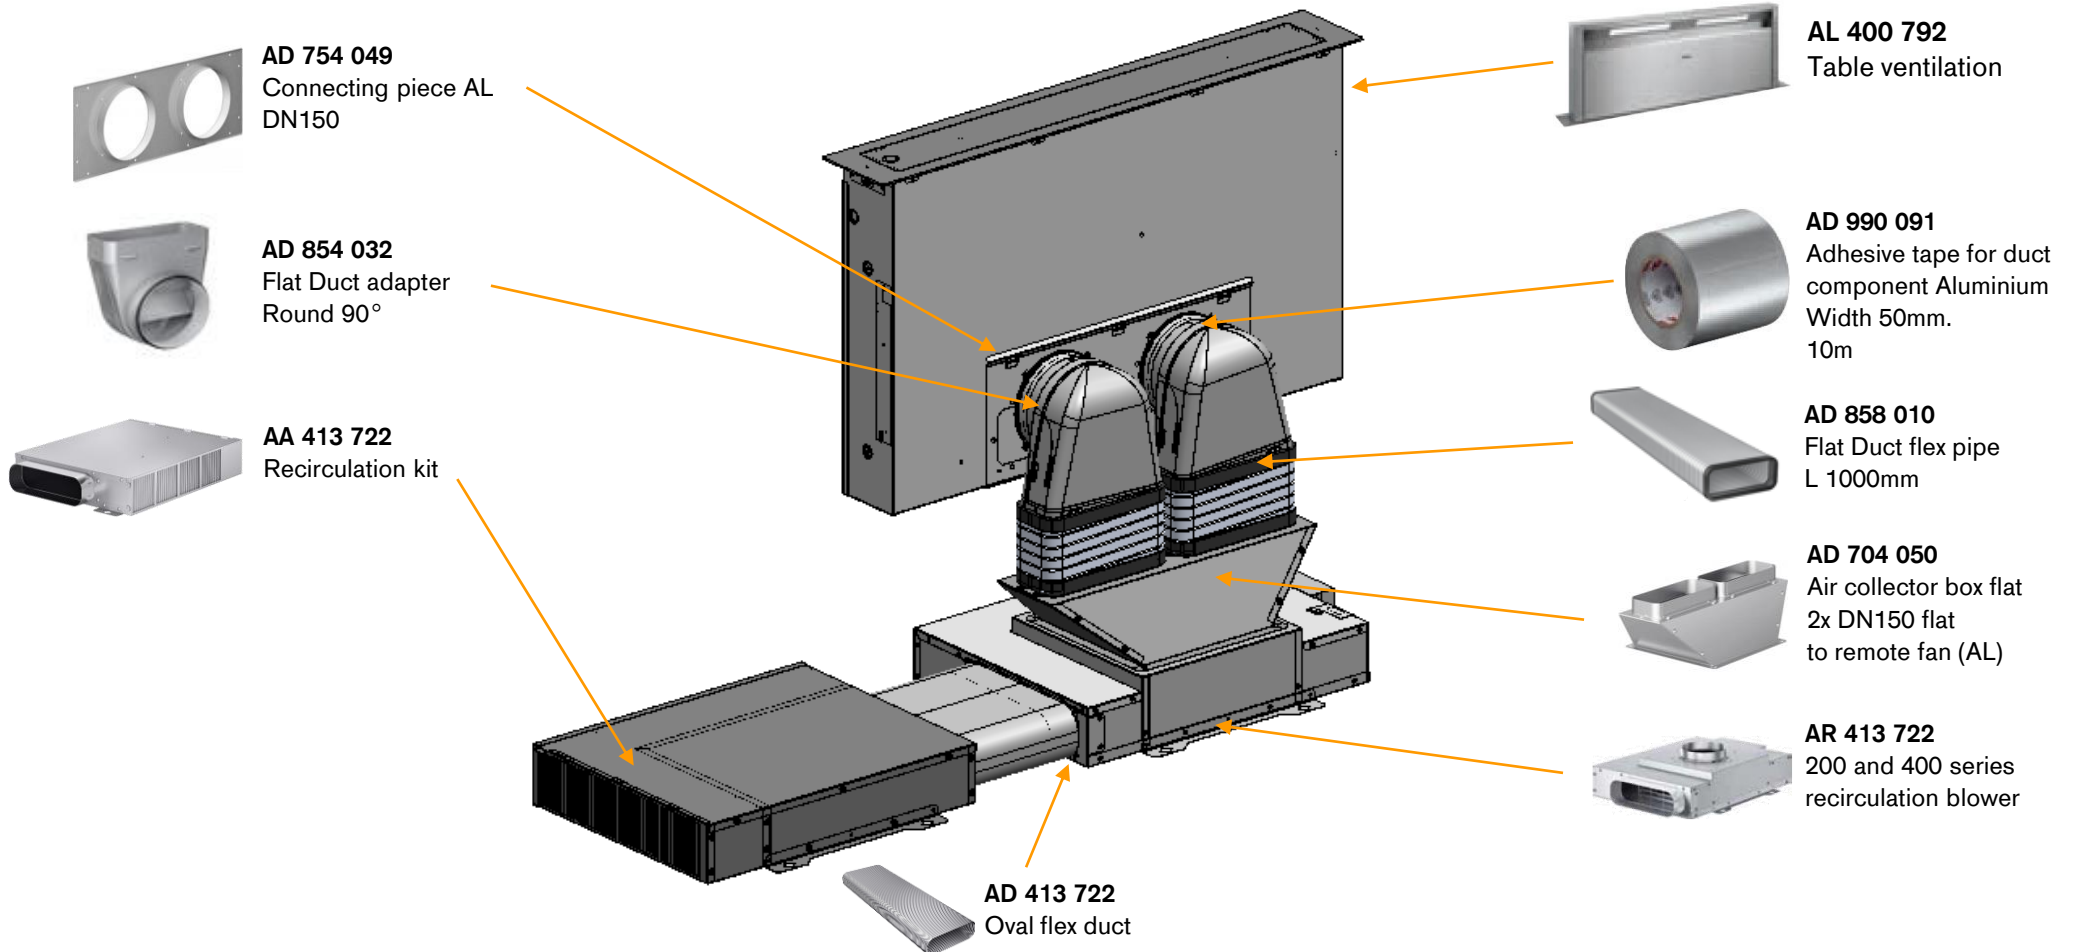


BSH Hausgeräte GmbH, Carl-Wery-Straße 34, 81739 Munich, Germany
Chairman of the Supervisory: Prof. Dr. Stefan Asenkerschbaumer
Directors: Dr. Gerhard Dambach (Chairman), Matthias Ginthum, Lars Schubert
Registered Office: Munich; Registry Court: Amtsgericht München, HRB 75534 WEEE-Reg.-Nr. DE 57986696

The drawing is provided only as an example.
Please pay attention to the technical installation drawings in the Gaggenau Models and Dimensions. The technical drawings are not based on customer data and are merely for installation recommendation. The exact installation must be verified by the kitchen studio on an individual customer basis.

9 March 2023


Configuration	AL400792+AR413722	Min. Work depth	37 5/8" (956mm)	Ventilation mode	Air recirculation
Type reference cooktops	CX 492 611	Type reference ventilation appliance	AL 400 792	Type reference remote fan unit	AR 413 722

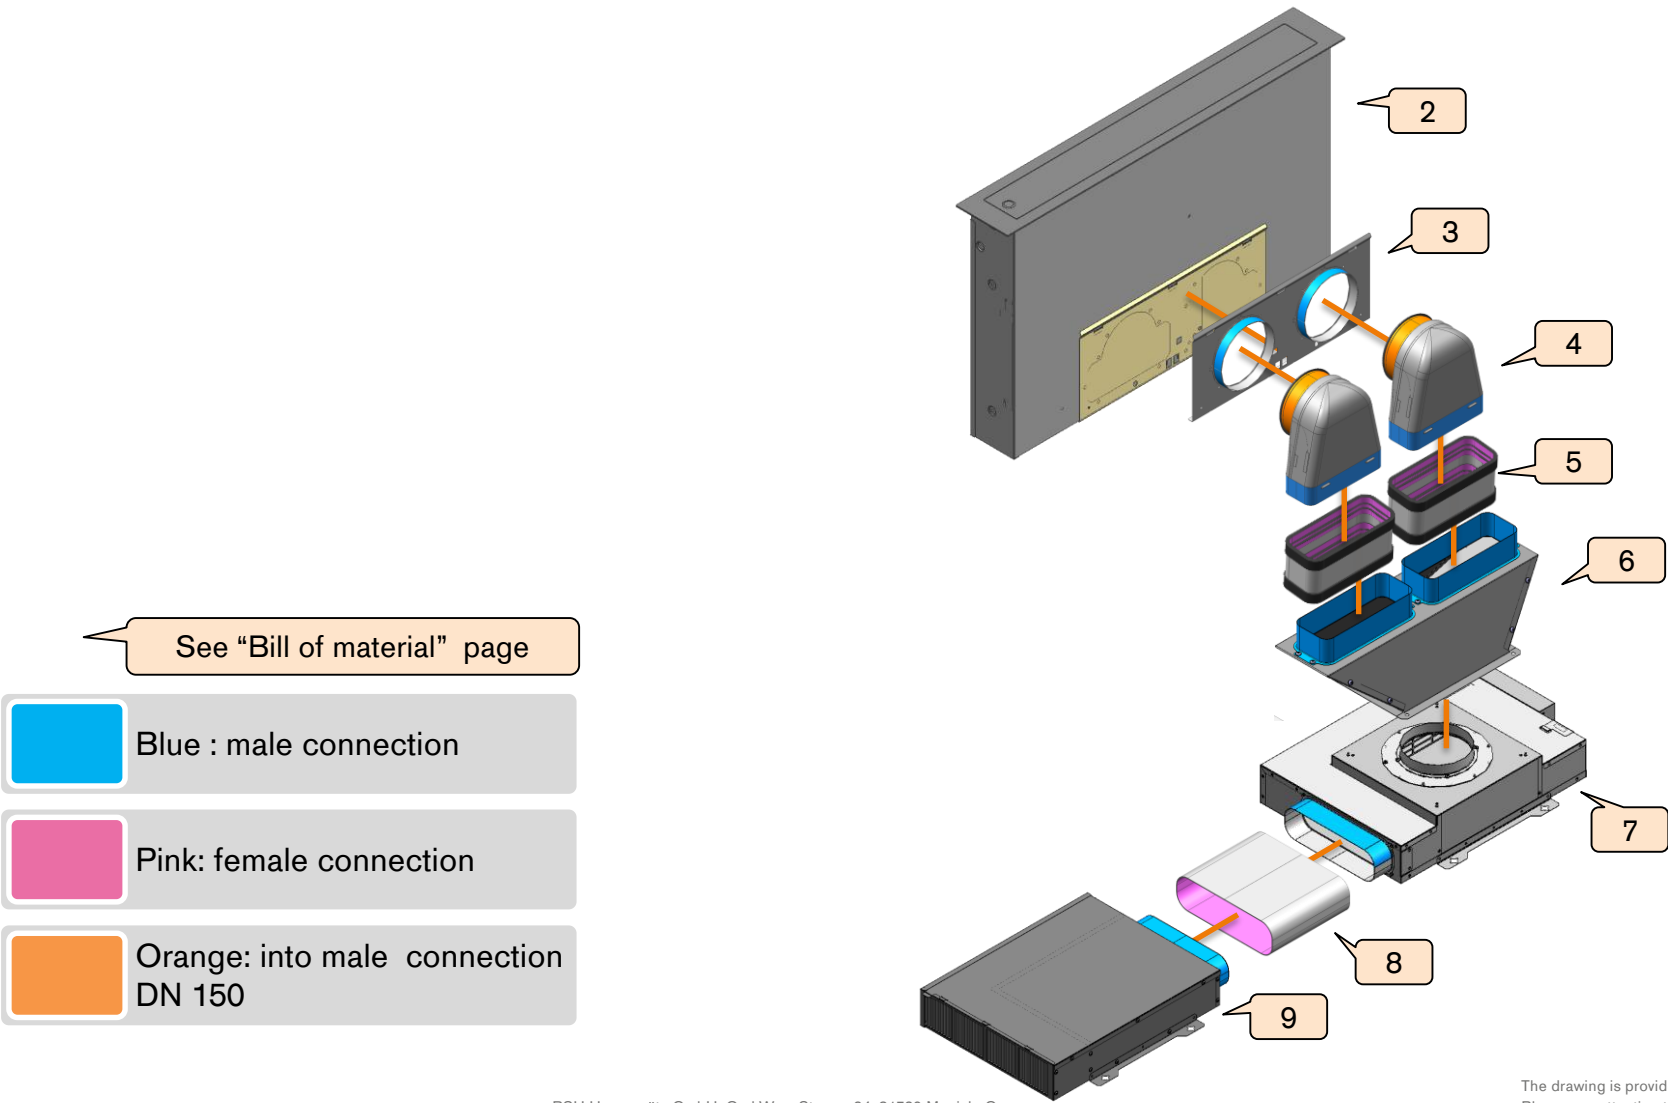

9 March 2023

Configuration	AL400792+AR413722	Min. Work depth	37 5/8" (956mm)	Ventilation mode	Air recirculation
Type reference cooktops	CX 492 611	Type reference ventilation appliance	AL 400 792	Type reference remote fan unit	AR 413 722

Bill of material

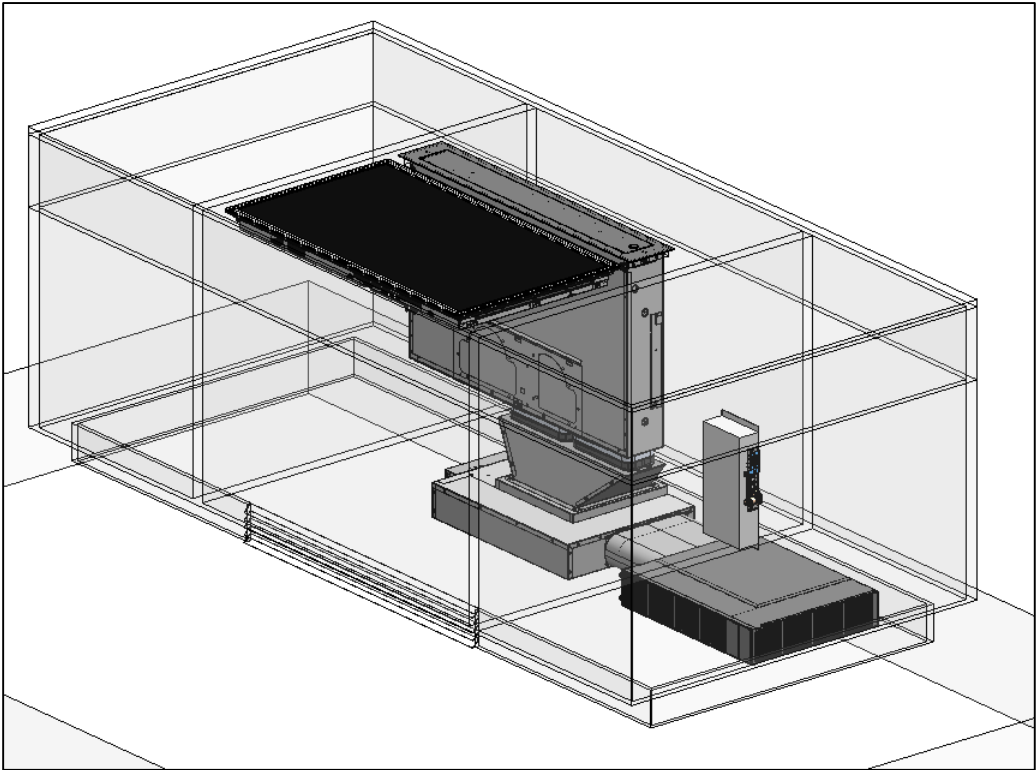

Position	Quantity	Part number	Appliance Design / Accessories Design
1	1	CX 492 611	Vario 400 series full surface induction cooktop
2	1	AL 400 792	Retractable downdraft (36")
3	1	AD 754 049	Connecting piece AL DN150
4	2	AD 854 032	Flat Duct adapter Round 90°
5	2	AD 858 010	Flat Duct flex pipe L 1000mm
6	1	AD 704 050	Air collector box flat 2x DN150 flat to remote fan (AL)
7	1	AR 413 722	Recirculation blower 400 CFM
8	1	AD 413 722	Oval flex duct
9	1	AA 413 722	Recirculation kit
10	1	AA 409 401	Furniture support 47 7/16" for 36" AL 400 792
11	1	AA 010 410	Air exhaust grill (or custom grill)

Please check the availability of the products in your country.